



**Northeast  
Utilities System**

107 Selden Street, Berlin, CT 06037

Northeast Utilities Service Company  
P.O. Box 270  
Hartford, CT 06141-0270  
(860) 665-2036

ORIGINAL

John R. Morissette  
Manager – Transmission Siting and  
Permitting

January 8, 2010

RECEIVED  
JAN - 8 2010

CONNECTICUT  
SITING COUNCIL

Daniel F. Caruso, Chairman  
Connecticut Siting Council  
Ten Franklin Square  
New Britain, CT 06051

**Re: *Petition No. 906. Amendment Letter for the 345-kV Middletown Rebuild Project***

Dear Chairman Caruso:

The Connecticut Light and Power Company ("CL&P") has identified a change to the 345-kV Middletown Rebuild Project Petition #906 ("Petition") filed with the Connecticut Siting Council ("Council") on June 12, 2009. A portion (approximately 350 feet) of the 3533 line was not included with the original Petition; however, this line impacts the load of the 3533 line and Kleen Electric Generating Facility (Docket #225). This portion of the line will limit the load, as stated in the Petition, required to maintain regional power transfers.

CL&P is hereby requesting the Council to consider Petition No. 906 as approved on June 12, 2009 with the following change:

- Reconductor the approximately 350 foot span from the Scovill Rock Substation to the first structure (#12069) on the 3533 line outside of the substation from a single 2156 ACSR per phase to a bundle of (2) 954 ACSR per phase. (see Attachment A: Drawing 22823)


The proposed line to be reconducted lies 2.6 miles from the work being conducted under the Petition to structure #12069. A CL&P scientist has surveyed the areas and proposed work will not create any potential environmental impacts or wetlands disturbance.

The Petition schedule will not be altered due to this amendment.

A courtesy notification of this change was provided to the Town of Middletown.

Enclosed are an original and twenty (20) copies. Should you have any questions on this matter, please direct them to me at 860-665-2036.

Sincerely,

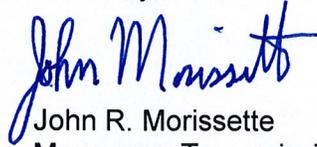

John R. Morissette  
Manager – Transmission Siting and Permitting


Attachment A: Drawing No. 22823 Scovill Rock Substation

cc: Sebastian N. Giuliano, Mayor of Middletown

LEGEND:  
 3533 LINE -----  
 PROPOSED 3533 LINE RECONDUCTOR - - - - -

TO  
KLEEN  
SITE

APPROXIMATE PROPERTY LINE

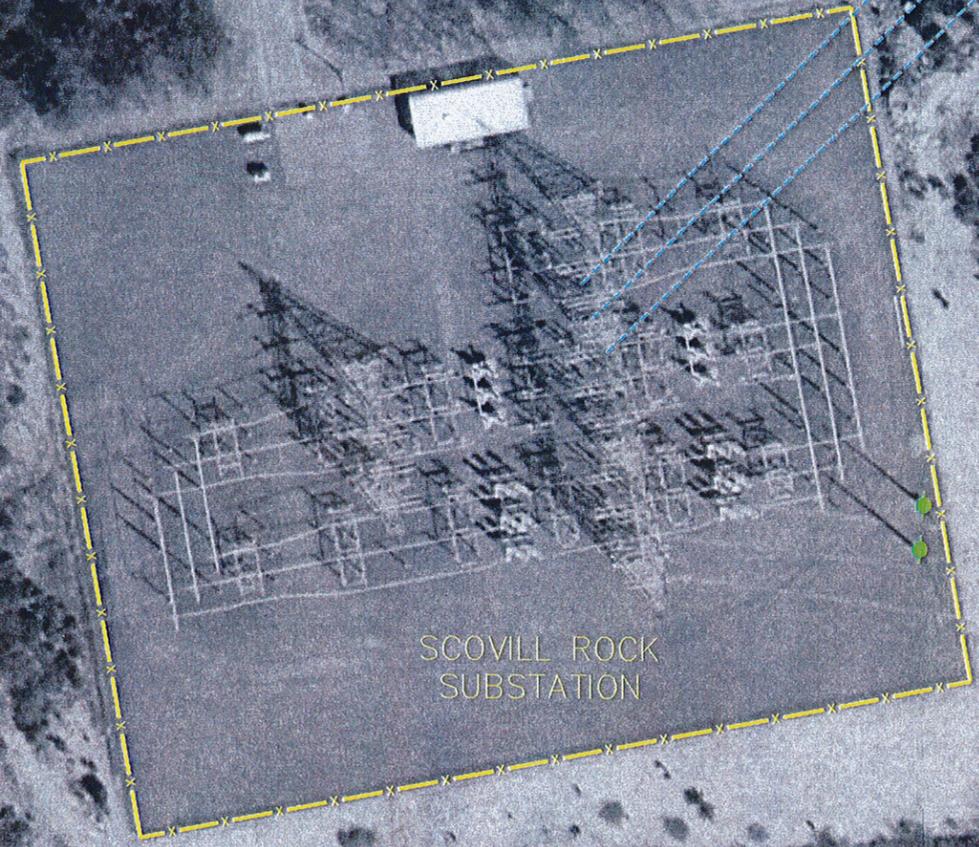

SCOVILL ROCK  
SUBSTATION

STR.#  
23000

STR.#  
19083

STR.#  
12069

STR.#  
15121

STR.#  
27024

STR.#  
15122

STR.#  
12068

STR.#  
19084

STR.#  
15123

STR.#  
12067

STR.#  
19085

		<b>Northeast Utilities Service Co.</b>	
FOR THE CONNECTICUT LIGHT & POWER COMPANY			
TITLE SCOVILL ROCK SUBSTATION EASTERN REGION			
589 FREEMAN ROAD MIDDLETOWN, CONNECTICUT			
BY	SGC	CHKD	SAS
DATE	12/18/2009	DATE	12/18/2009
H-SCALE	1"=50'	SIZE	ARCH D
V-SCALE	V.S.	CAD	REDWG.
R.E. PROJ. NUMBER	082-03.604	NUSCO	22823

01/08/2010 14:17PM - gsmeng - P:\082-MIDDLETOWN\_CT\03-SUBSTATION\04-SCOVILLE\_ROCK\22823.dwg