



# QUISENBERRY ARCARI ARCHITECTS, LLC

318 Main Street, Farmington, CT 06032    www.qa-architects.com    t (860) 677 - 4594    f (860) 677 - 8534

REHABILITATION / RECONSTRUCTION WORK FOR:

## MONROE AND BEVERLY WEBSTER

APPLICANT #1491

ISSUE DATE: FEBRUARY 5, 2015

9 CROWN STREET

WATERBURY, CT

### LIST OF DRAWINGS

	COVER
G1.1	GENERAL NOTES
A1.1	PLANS, ELEVATIONS & DETAILS

### COMMUNITY DEVELOPMENT BLOCK GRANT DISASTER RECOVERY PROGRAM (CDBG-DR)

### OWNER OCCUPIED REHABILITATION & REBUILDING PROGRAM (OORR)

SPONSORED IN CONJUNCTION WITH FUNDING FROM  
THE CONNECTICUT DEPARTMENT OF HOUSING



### LOCATION MAP



ABBREVIATIONS			
A.F.F.	Above Finish Floor	HGT.	Height
A.C.	Acoustic, Acoustical	H.M.	Hollow Metal
A.C.T.	Acoustical Tile	HORIZ.	Horizontal
AC	Air Conditioning	H.B.	Hose Bbb
A.H.U.	Air Handling Unit	IN.	Inch
ALT.	Alternate	INCL.	Included
ALUM.	Aluminum	INFO.	Information
ALF.	Aluminum Frame	I.D.	Inside Diameter
ANCH.	Anchor, Anchorage	INSUL.	Insulation
AB.	Anchor Bolt	INT.	Interior
L	Angle	JT.	Joint
ANOD.	Anodized	K.P.	Kick Plate
APFR.	Approved	LAB	Laboratory
ARCH.	Architect, Architectural	LAV.	Lavatory
ASB.	Asbestos	LTG.	Lighting
A.P.B.O.	As Provided By Owner	MACH.	Machine
A.S.B.O.	As Selected By Owner	MAINT.	Maintenance
ASPH.	Asphalt	MFRG.	Manufacturer
ASSY.	Assembly	M.BD.	Marker Board
ASST.	Assistant	MA5.	Masonry
AUTO.	Automatic	M.O.	Masonry Opening
BM	Beam	MAT.	Material
BRG.	Bearing	MAX.	Maximum
BEV.	Bevel, Beveled	MECH.	Mechanical
BIT.	Bituminous	MEZZ.	Mezzanine
BK.	Block	MIN.	Minimum
BK.G.	Blocking	MISC.	Miscellaneous
BD.	Board	N	North
BOT.	Bottom	N.I.C.	Not In Contract
B.O.	Bottom Of	N.T.S.	Not To Scale
B.E.J.	Brick Expansion Joint	OFF.	Office
BLDG.	Building	O.C.	On Center
B.U.R.	Built Up Roofing	O.H.	Overhead
CAB.	Cabinet	O.D.	Outside Diameter
C.U.H.	Cabinet Unit Heater	PTD.	Painted
CAP.	Capacity	PR.	Pair
CASE	Casement	P.T.D.	Paper Towel Dispenser
CLG.	Ceiling	PASS.	Passage
CLGHT.	Ceiling Height	PERP.	Perpendicular
CEM.	Cement	PLAS.	Plaster
CTR.	Center	PLAM.	Plastic Laminate
CL	Centerline	PL	Plate
C.T.	Ceramic Tile	PLUMB.	Plumbing
C.BD.	Chalk Board	PLYWD.	Plywood
CLO.	Closet	PVC.	Polyvinylchloride
COL.	Column	P.E.J.	Precast Expansion Joint
CONC.	Concrete	PREFAB.	Prefabricated
CONF.	Conference	QTY.	Quantity
CJ	Control Joint	Q.T.	Quarry Tile
CONT.	Continuous	RAD.	Radius
CONTR.	Contractor	RWC	Rain Water Conductor
CORR.	Corridor	RECV.	Receiving
CRS.	Course, Courses	REFR.	Refrigerator
DEG.	Degree	REINF.	Reinforce
DEMO.	Demolition	REM	Remove
DEPT.	Department	REQD	Required
DET.	Detail	REV.	Revised, Revision
DIA.	Diameter	R.	Riser
DIM.	Dimension	R.D.	Roof Drain
DIST.	Distance	RM.	Room
DR.	Door	S.N.D.	Sanitary Napkin Dispenser
DBL.	Double	S.N.R.	Sanitary Napkin Receptacle
D.H.	Double Hung	SCHED.	Schedule
DN	Down	SC.	Scupper
D.S.	Downspout	SECT.	Section
DWG.	Drawing	S.J.	Seismic Joint
D.F.	Drinking Fountain	SHT.	Sheet
EA.	Each	SIM.	Similar
ELEC.	Electric, Electrical	S.D.	Soap Dispenser
EWC.	Electric Water Cooler	S.T.D.	Sound Transmission Class
EL	Elevation	S.T.C.	Sound Transmission Coefficient
ELEV.	Elevator	SPEC.	Specifications
EMERG.	Emergency	SQ.	Square
EQ.	Equal	S.F.	Square Feet
EQUIP.	Equipment	S.S.	Stainless Steel
EXIST.	Existing	STD.	Standard
E.T.R.	Existing To Remain	STL.	Steel
EXP.	Expansion	STOR.	Storage
E.J.	Expansion Joint	STRUCT.	Structure, Structural
EXT.	Exterior	S.STL.	Structural Steel
E.I.F.S.	Exterior Insulation Finish System	SUSP.	Suspend, Suspension
FT.	Feet, Foot	S.A.T.C.	Susp. Acoustic Tile Ceiling
F.R.G.P.	Fiber Reinforced Gypsum Panel	T.BD.	Tack Board
FIN.	Finish, Finish	THRU	Through
F.E.	Fire Extinguisher	T.P.D.	Toilet Paper Dispenser
F.R.	Fire Retardant	T.M.E.	To Match Existing
FPRFG.	Fireproofing	T&G	Tongue and Groove
FIXT.	Fixture	T.O.	Top Of
FLASH	Flashing	T.	Tread
FLR.	Floor	TYP.	Typical
F.D.	Floor Drain	U.L.	Underwriter's Laboratory
FLR.FIN.	Floor Finish	U.H.	Unit Heater
FTG.	Footing	U.V.	Unit Ventilator
FDN	Foundation	U.O.N.	Unless Otherwise Noted
FURN.	Furnish, Furnishings, Furniture	VEST.	Vestibule
FURR.	Furred, Furring	VCT.	Vinyl Composition Tile
GA.	Gauge	W.P.	Waterproofing
GALV.	Galvanized	W.W.F.	Welded Wire Fabric
GYP. BD.	Gypsum Board	W.BD.	White Board
G.C.	General Contractor	W	With
H.C.	Handicapped	WD.	Wood

FINISHES (AS APPLICABLE)	
<b>GYPHUM BOARD</b>	
1.	PROVIDE AND INSTALL GYPSUM WALL BOARD IN ACCORDANCE WITH AMERICAN STANDARD SPECIFICATIONS FOR THE APPLICATION AND FINISHING OF GYPSUM WALLBOARD, AS APPROVED BY THE AMERICAN STANDARDS ASSOCIATION, LATEST EDITION; APPLICABLE PARTS THEREOF ARE HEREBY MADE A PART OF THIS SPECIFICATION EXCEPT WHERE MORE STRINGENT REQUIREMENTS ARE CALLED FOR IN THE SPECIFICATION, IN LOCAL CODES, OR BY THE MANUFACTURER OF THE GYPSUM WALLBOARD, WHOSE REQUIREMENTS SHALL BE FOLLOWED.
2.	PROVIDE AND INSTALL MOISTURE-RESISTANT GYPSUM WALLBOARD WHERE REQUIRED. PROVIDE TYPE X GYPSUM BOARD AS CALLED FOR ON THE DRAWINGS.
<b>PAINT</b>	
1.	APPLICATION OF PAINT OR OTHER COATING SHALL BE IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. READY-MIXED PAINT SHALL NOT BE THINNED, EXCEPT AS PERMITTED IN THE APPLICATION INSTRUCTIONS.

THERMAL & MOISTURE PROTECTION (AS APPLICABLE)	
1.	PROVIDE AND INSTALL BUILDING THERMAL INSULATION IN ACCORDANCE WITH THE FOLLOWING: A. EXTERIOR WALLS: R-19 MINIMUM B. SLOPED CEILINGS: R-30 MINIMUM C. FLAT CEILINGS: R-38 MINIMUM D. CEILINGS OVER UNCONDITIONED SPACE: R-21 MINIMUM E. CEILINGS OVER BASEMENT: R-21 MINIMUM
2.	INSTALL VENTING IN SLOPED CEILING AREAS TO PERMIT AIRFLOW ALONG THE COOL SIDE OF THE INSULATION FROM THE EAVE TO RIDGE.
3.	DO NOT LEAVE KRAFT-PAPER FACED INSULATION EXPOSED. INSTALL TYPE FSK FOIL TO PROTECT EXPOSED INSULATION.
4.	INSTALL EITHER INTERIOR AND/OR EXTERIOR FOUNDATION INSULATION AS REQUIRED BY LOCAL BUILDING CODES.

ELECTRICAL NOTES (AS APPLICABLE)	
1.	FINAL LOCATIONS OF ALL ELECTRICAL DEVICES AND THEIR INTENDED OPERATION IS TO BE COORDINATED WITH THE OWNER.
2.	ELECTRICAL CONTRACTOR SHALL PURCHASE AND INSTALL ALL NEW COMPONENTS AS REQUIRED TO PROPERLY SERVICE THE SPACES AFFECTED BY THIS CONSTRUCTION PROJECT. IF THE MODIFICATION OF EXISTING ELECTRICAL SYSTEMS IS NECESSARY, SUCH MODIFICATIONS SHALL NOT ADVERSELY AFFECT THE OPERATION OF THESE SYSTEMS.
3.	ELECTRICAL CONTRACTOR SHALL VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING WORK.
4.	COORDINATE ELECTRICAL WORK WITH THE WORK OF OTHER TRADES. DO NOT ALTER THE WORK OF PREVIOUS TRADES WITHOUT PRIOR APPROVAL.
5.	ELECTRICAL CONTRACTOR MUST PROVIDE AND INSTALL ALL DUCT WORK ASSOCIATED WITH EXHAUST FANS.
6.	PERFORM ALL NEW ELECTRICAL WORK IN ACCORDANCE WITH LOCAL CODES AND ACCEPTED STANDARDS OF PRACTICE.

ELECTRICAL MOUNTING HEIGHTS (AS APPLICABLE)	
1.	ALL DIMENSIONS ARE TO THE CENTER OF THE DEVICE UNLESS OTHERWISE NOTED. SEE ELECTRICAL DRAWINGS FOR TYPES AND LOCATIONS.
2.	RECEPTACLES: 18" A.F.F. (AT LOCATIONS ABOVE CASEWORK, MOUNT BOTTOM OF RECEPTACLE AT 2" ABOVE BACKSPASH, AT LOCATIONS BELOW CASEWORK, MOUNT AT 24" A.F.F.)
3.	EXTERIOR RECEPTACLES: 24" A.F.G. (20" A.F.F.)
4.	SWITCHES: 48" A.F.F.
5.	DATA / PHONE OUTLETS: 18" A.F.F.
6.	TV OUTLETS: 18" A.F.F. OR 18" BELOW FINISHED CEILING
7.	WALL PHONE: 48" A.F.F. TO CENTER OF EARPIECE

CONCRETE (AS APPLICABLE)	
1.	ALL CONCRETE WORK SHALL BE IN COMPLIANCE WITH THE "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" (ACI 318) AND "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDING" (ACI 301).
2.	CONCRETE SHALL HAVE THE FOLLOWING MINIMUM COMPRESSIVE STRENGTH AT THE AGE OF 28 DAYS: 3000PSI, EXCEPT 4000PSI FOR EXTERIOR WORK.
3.	CONCRETE SHALL HAVE A SLUMP NOT EXCEEDING 5", EXCEPT FOR 4" SLABS.
4.	CONTRACTOR SHALL PROVIDE ADEQUATE PROTECTION FOR THE CURING OF CONCRETE AS DIRECTED BY ACI 301. USE OF CALCIUM CHLORIDE SHALL NOT BE PERMITTED.
5.	CONTRACTOR SHALL INSTALL ALL ANCHORS, ANCHOR BOLTS, LEVELING PLATES, AND ALL INSERTS TO BE SET IN CONCRETE AS REQUIRED FOR THE WORK OF ALL TRADES.
6.	ALUMINUM OBJECTS SHALL NOT BE EMBEDDED OR IN CONTACT WITH CONCRETE.

METALS (AS APPLICABLE)	
1.	STRUCTURAL STEEL COMPONENTS SHALL CONFORM TO THE CURRENT SPECIFICATIONS FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS AS ADOPTED BY THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION.
2.	UNLESS OTHERWISE NOTED, ALL STRUCTURAL STEEL SHALL BE IN ACCORDANCE WITH ASTM SPECIFICATIONS A-36. STEEL FOR PIPE COLUMNS SHALL BE IN ACCORDANCE WITH ASTM SPECIFICATIONS A-501.
3.	ALL STEEL-TO-STEEL CONNECTIONS SHALL BE FABRICATED IN ACCORDANCE WITH INDUSTRY STANDARD PRACTICES FOR BOLTED OR WELDED CONNECTIONS.
4.	ALL STEEL SHALL BE PAINTED WITH ONE SHOP COAT OF RED-OXIDE PRIMER. GALVANIZED MEMBERS SHALL BE UTILIZED WHERE SHOWN ON THE DRAWINGS.

WOOD (AS APPLICABLE)	
1.	ALL STRUCTURAL WOOD SHALL BE IN ACCORDANCE WITH THE "NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION" AND THE "MANUAL OF HOUSE FRAMING" AS PUBLISHED BY THE NATIONAL FOREST PRODUCTS ASSOCIATION (NFPA), INCLUDING PROVISIONS FOR NAILING, FIRE STOPPING, ANCHORAGE, FRAMING AND BRACING.
2.	UNLESS NOTED OTHERWISE ON THE DRAWINGS, STRUCTURAL LUMBER SHALL BE AS FOLLOWS: A. INTERIOR EXPOSURE: STRUCTURAL WOOD PROTECTED FROM MOISTURE SHALL BE HEM-FIR #2 OR BETTER B. EXTERIOR EXPOSURE: STRUCTURAL WOOD EXPOSED TO MOISTURE, THE WEATHER, IN CONTACT WITH CONCRETE, LOCATED WITHIN 8 INCHES OF SOIL, OR LESS THAN 18 INCHES FROM THE FLOOR OF A CRAWL SPACE SHALL BE PRESERVATIVE TREATED SOUTHERN YELLOW PINE #2 OR BETTER, WITH RETENTION MEETING OR EXCEEDING THE REQUIREMENTS OF THE BUILDING CODE. C. PLYWOOD: PLYWOOD SHALL BE IN ACCORDANCE WITH THE AMERICAN PLYWOOD ASSOCIATION (APA) SPECIFICATIONS (Y 510). PLYWOOD FLOOR DECKING SHALL BE CONTINUOUS OVER TWO OR MORE SPANS WITH THE FACE-GRAIN RUNNING PERPENDICULAR TO SUPPORT JOISTS. I. ROOF SHEATHING: C-D/EXT-APA, 1/2" THICK II. WALL SHEATHING: C-D/EXT-APA, 1/2" THICK III. SUBFLOORING: C-D/EXT-APA, 3/4" THICK
3.	NAILING SCHEDULE SHALL BE IN ACCORDANCE WITH THE LOCAL BUILDING CODES "RECOMMENDED FASTENING SCHEDULE". NAIL PLYWOOD SHEATHING AND SUBFLOORING 6" O.C. AT EDGES AND 12" O.C. ALONG INTERMEDIATE SUPPORTS, LEAVING SPACES BETWEEN PANELS AS RECOMMENDED BY THE APA. UTILIZE RING-SHANK OR SCREW TYPE NAILS FOR PLYWOOD SUBFLOORING AND APPLY APPROPRIATE CONSTRUCTION ADHESIVE TO ADEQUATELY SECURE PLYWOOD TO FLOOR JOISTS.
4.	INSTALL JOIST HANGERS, COLUMN CAPS AND BASES WHERE REQUIRED. METAL FABRICATIONS SHALL BE OF APPROPRIATE SIZE AND TYPE FOR THE MEMBERS AND SUPPORT CONDITIONS. WHERE FLANGE SUPPORT JOIST HANGARS ARE USED IN CONJUNCTION WITH STEEL BEAMS, CARE SHALL BE TAKEN TO INSTALL THE HANGERS CLEAR OF CONTACT WITH THE STEEL BEAM BY INSTALLING 2X WOOD TOP PLATES.

FOUNDATION (AS APPLICABLE)	
1.	ALL FOOTINGS SHALL REST ON UNDISTURBED SOIL WITH A MINIMUM BEARING CAPACITY OF 4000 PSF. BACKFILL OVER-EXCAVATION WITH CONCRETE, NOT ADDITIONAL SOIL.
2.	NO BACKFILLING OF FOUNDATION WALLS SHALL BE UNDERTAKEN UNTIL SUITABLE WALL BRACING (TEMPORARY OR PERMANENT) HAS BEEN INSTALLED.
3.	DO NOT POUR FOOTINGS ON FROZEN SOIL. REMOVE ALL FROST PRIOR TO POURING CONCRETE.
4.	BOTTOM OF FOOTINGS SHALL BE INSTALLED BELOW GRADE TO PROVIDE PROTECTION FROM FROST PENETRATION. CONSULT WITH LOCAL BUILDING OFFICIALS REGARDING REQUIRED DEPTH IN THE LOCAL WHERE THE FOUNDATION IS CONSTRUCTED.
5.	PROVIDE 2-#5 REINFORCING BARS CONTINUOUS IN THE TOP AND BOTTOM OF WALLS, AND IN CONTINUOUS FOOTINGS. SEE FOUNDATION PLAN FOR ADDITIONAL REINFORCING REQUIRED AT COLUMN FOOTINGS.
6.	PROVIDE 1/2" DIAMETER ANCHOR BOLTS AT 6'-0" O.C. MAXIMUM TO SECURE FRAMING SILL TO FOUNDATION.
7.	PROVIDE EXTERIOR AND/OR INTERIOR FOOTING DRAINS AS REQUIRED BY SITE CONDITIONS.
8.	INSTALL FOUNDATION WATERPROOFING TO BELOW GRADE SURFACES.
9.	INSTALL FOUNDATION INSULATION AS REQUIRED BY LOCAL CODES.

DEMOLITION NOTES (AS APPLICABLE)	
1.	ENSURE THAT ANY ITEMS BEING REMOVED WITH THE INTENTION OF BEING REUSED ARE STORED IN AN ENCLOSED PROTECTED SPACE.
2.	ENSURE THAT ALL UTILITIES ARE PROPERLY DISCONNECTED AND THAT ALL ABANDONED UTILITY MATERIALS ARE REMOVED FROM THE SITE. REFER TO MEP DRAWINGS & SPECIFICATIONS.

DESIGN CRITERIA	
CODES THIS PROJECT WAS DESIGNED TO:	
2009 INTERNATIONAL RESIDENTIAL CODE W/ 2013 CONNECTICUT AMENDMENT	
2009 INTERNATIONAL ENERGY CONSERVATION CODE W/ 2013 CONNECTICUT AMENDMENT	
2011 NATIONAL ELECTRICAL CODE (NFPA 70) W/ 2013 CONNECTICUT AMENDMENT	

ARCHITECTURAL SYMBOLS	
	EXISTING WALL
	WALL TO BE DEMOLISHED
	NEW STUD WALL
	NEW CMU WALL
	NEW FOUNDATION WALL
	KITCHEN HARDWOOD 15'-0"x12'-0"
	SECTION MARKER
	ELEVATION MARKER
	WINDOW IDENTIFICATION
	ELEVATION MARKER
	EXISTING DOOR
	NEW DOOR

GENERAL NOTES	
1.	ALL CONSTRUCTION ON THIS HOME, AND ANY CHANGES MADE TO THE DESIGN OF THIS HOME, EITHER BEFORE OR DURING CONSTRUCTION SHALL BE DONE IN ACCORDANCE WITH THE BUILDING CODE. NOTHING REPRESENTED WITHIN THESE PLANS SHALL ALLEVIATE THE APPLICABLE CODE REQUIREMENTS FOR THE CONSTRUCTION RELATED TO THIS PROJECT.
2.	NOTIFY QUISENBERRY ARCARI ARCHITECTS, LLC AT (860) 677-4594 IMMEDIATELY IF PROBLEMS SHOULD ARISE DURING THE CONSTRUCTION ON THIS HOME WITH RESPECT TO STRUCTURAL INTEGRITY, FRAMING CONFLICTS, OR GENERAL CONCERNS.
3.	THESE DRAWINGS DO NOT REPRESENT ALL COMPONENTS OR DETAILS REQUIRED TO PROPERLY CONSTRUCT THIS HOME. IT IS ASSUMED THAT THE WORK WILL BE PERFORMED BY COMPETENT, SKILLED AND LICENSED TRADE CONTRACTORS IN ACCORDANCE WITH INDUSTRY STANDARDS AND CARE.
4.	UNLESS OTHERWISE NOTED ON THE DRAWINGS, ALL NEW FINISHES (ROOFING, SIDING, TRIM, ETC.) SHALL MATCH EXISTING.
5.	PATCH EXISTING AREAS AFFECTED BY THE NEW WORK. MATCH EXISTING FINISHES UNLESS DIRECTED OTHERWISE BY THE OWNER.
6.	EXTEND EXISTING SERVICES (MECHANICAL, PLUMBING, ELECTRICAL, ETC.) TO ACCOMMODATE THE NEW CONSTRUCTION. PROVIDE UPGRADES TO EXISTING COMPONENTS AS NECESSARY TO PROVIDE SATISFACTORY PERFORMANCE WITHIN THE COMPLETED STRUCTURE.

**QUISENBERRY ARCARI ARCHITECTS, LLC**  
www.qa-architects.com  
T (860) 677-4594  
F (860) 677-8534  
318 Main Street  
Farmington, CT 06032

NOT FOR CONSTRUCTION  
ISSUED FOR REVIEW ONLY


**REHABILITATION/RECONSTRUCTION WORK FOR:**  
**MONROE AND BEVERLY WEBSTER**  
APPLICANT #1491  
9 CROWN STREET  
WATERBURY, CT

Sheet Description:	
<b>GENERAL NOTES</b>	
Issue Dates:	
FEBRUARY 5, 2015	
No Scale	
Project #:	Drawn By:
QA 1346-47	JcB
Sheet #:	
<b>G1.1</b>	




WHERE NEW DOOR WILL BE INSTALLED INTO ABANDONED DOOR OPENING. REMOVE EXISTING ALUMINUM SIDING AND EXISTING WALL INFILL TO ALLOW EXISTING DOOR OPENING TO BE REUSED. ENSURE THAT EXISTING FRAMING IS SUITABLE FOR INSTALLATION AND OPERATION OF NEW DOOR. CONTRACTOR TO FIELD VERIFY CONDITIONS DURING DEMOLITION.  
 ADD ALT#2  
 RESERVE ALL EXTERIOR ALUMINUM SIDING THAT IS REMOVED TO BE REUSED TO CLOSE OFF EXISTING EXTERIOR WINDOW.



PHOTO

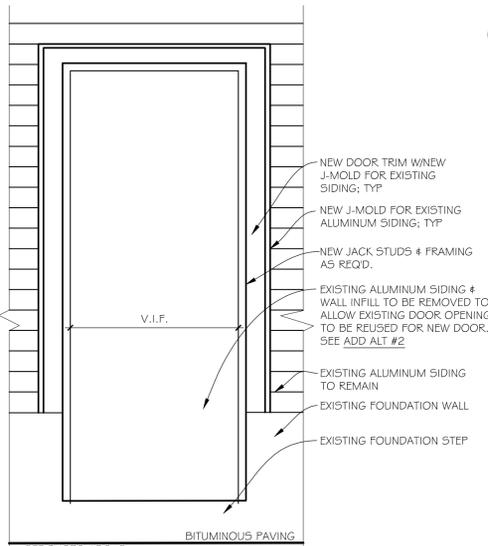



**DETAIL AT EXTERIOR DOOR**  
 SCALE: 3/4"=1'-0"

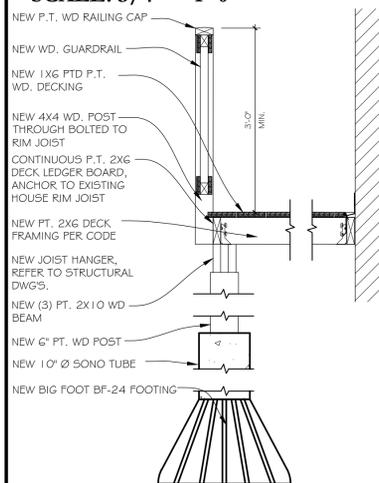


**DECK DETAILS**  
 SCALE: 3/4"=1'-0"

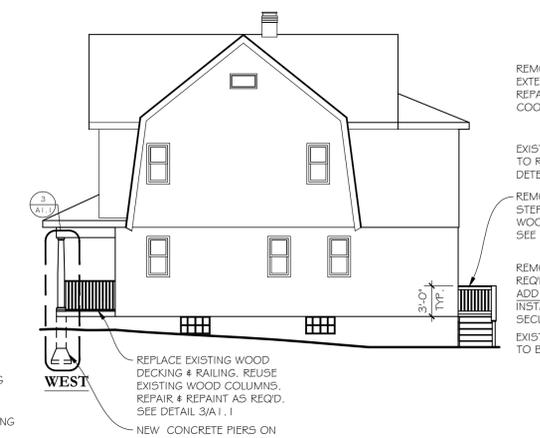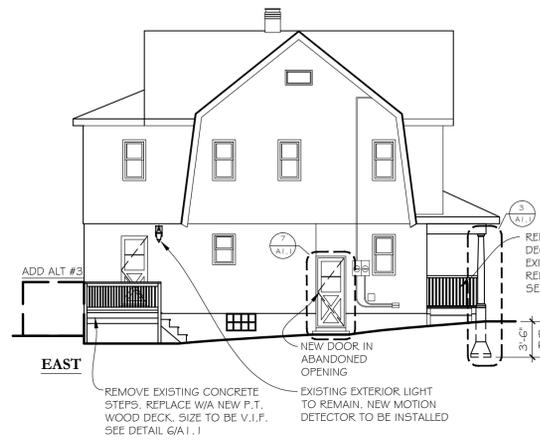


**EXTERIOR ELEVATIONS**  
 SCALE: 1/8"=1'-0"

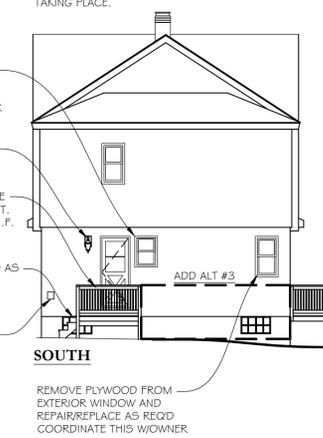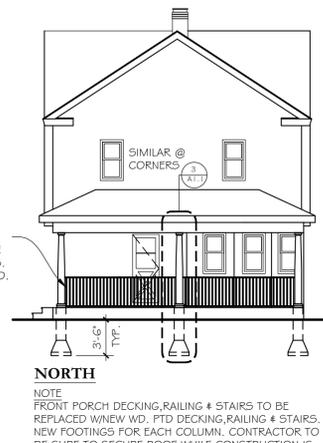



**DETAIL AT EXTERIOR WALL**  
 SCALE: 3/4"=1'-0"

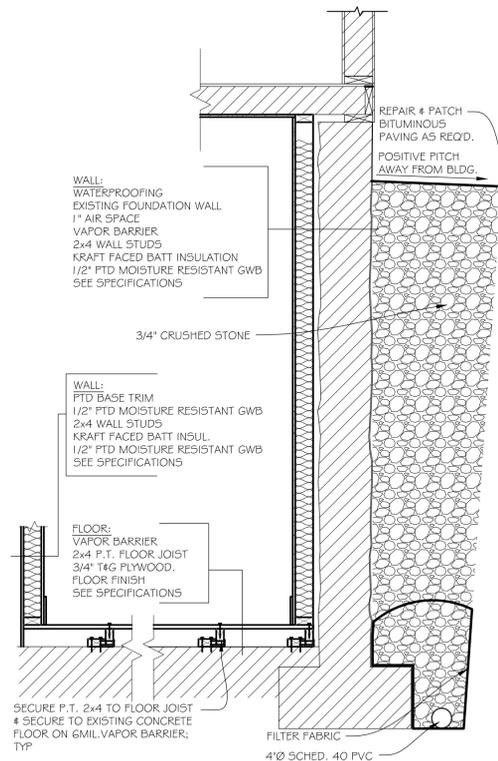


**DETAIL AT PORCH**  
 SCALE: 3/4"=1'-0"

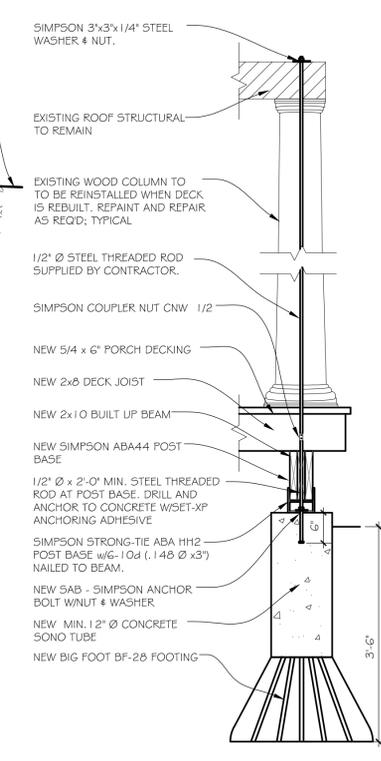

**FIRST FLOOR PLAN**  
 SCALE: 1/4"=1'-0"

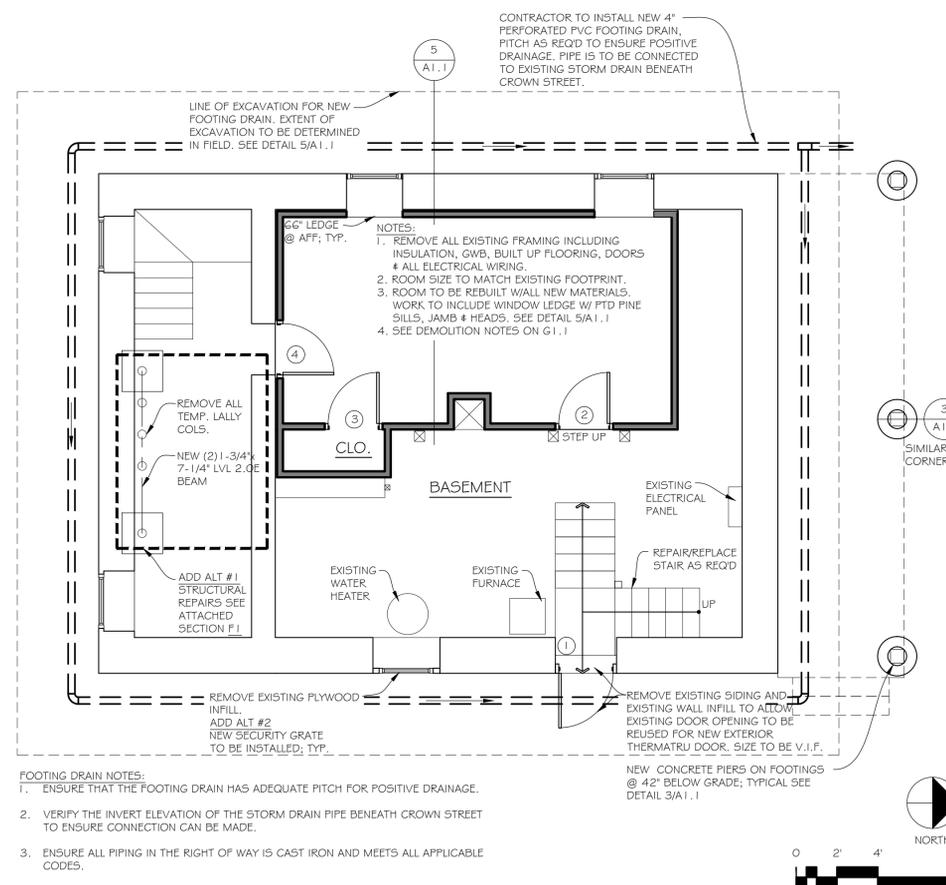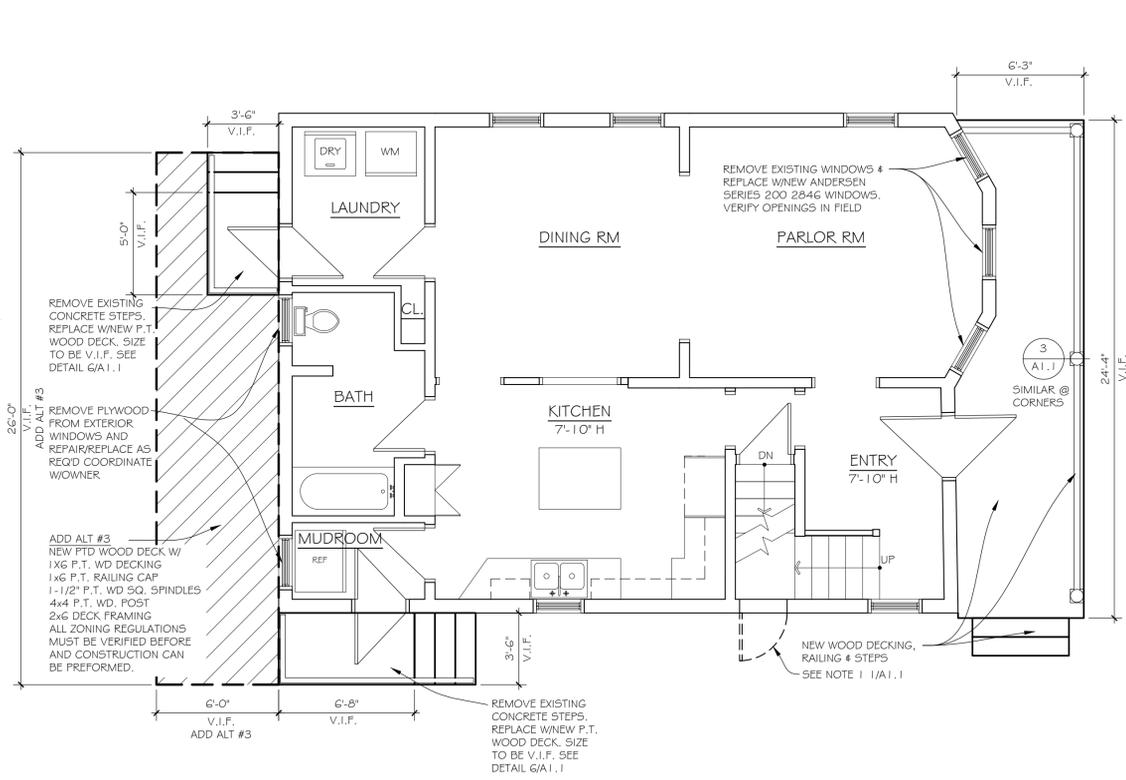

**FOUNDATION PLAN**  
 SCALE: 1/4"=1'-0"



**QUISENBERRY ARCARI ARCHITECTS, LLC**  
 www.qa-architects.com  
 T (860) 677-4594  
 F (860) 677-8534  
 318 Main Street  
 Farmington, CT 06032

NOT FOR CONSTRUCTION  
 ISSUED FOR REVIEW ONLY

REHABILITATION/RECONSTRUCTION WORK FOR:  
**MONROE AND BEVERLY WEBSTER**  
 APPLICANT #1491  
 WATERBURY, CT  
 9 CROWN STREET


Sheet Description:  
**PLANS, ELEVATIONS AND DETAILS**

Issue Dates:  
 FEBRUARY 5, 2015

Project #:  
 QA 1346-47

Drawn By:  
 JcB

Sheet #:  
**A1.1**

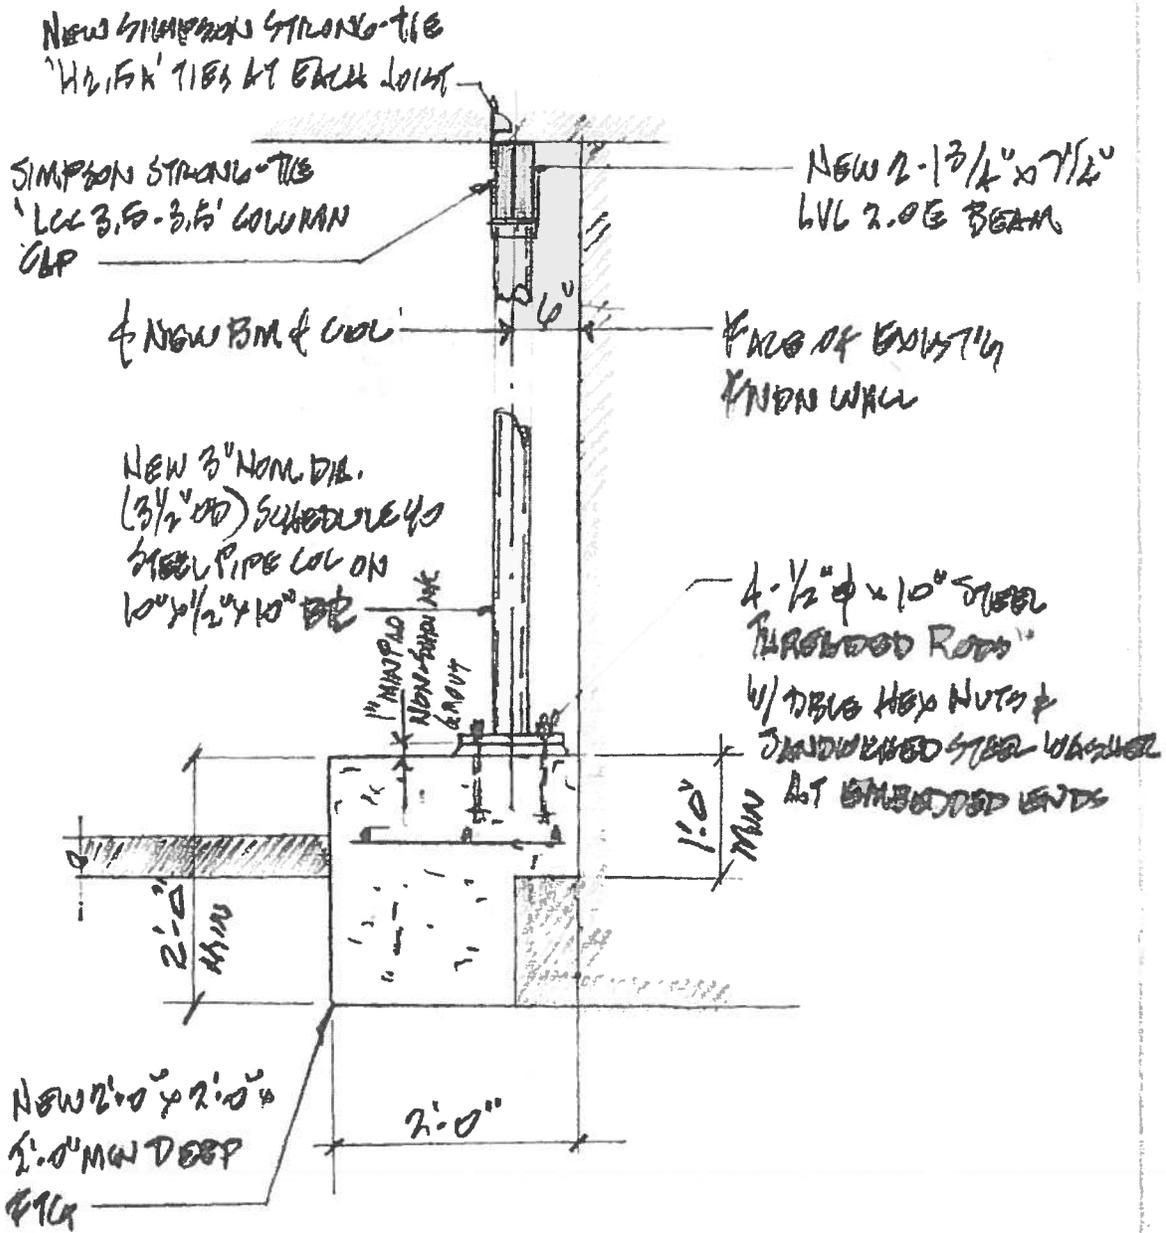

SECTION F1

SECTION F1

Scale: N.T.S.

<p>QUISENBERRY ARCARI ARCHITECTS, LLC          www.qa-architects.com          T (860) 677-4594          F (860) 677-8534          318 Main Street          Farmington, CT 06032</p>	<p><b>MONROE AND BEVERLY WEBSTER</b>          Hurricane Sandy Disaster Recovery Program</p>		<p>Issue Date: 02.05.15</p>	
	<p>9 CROWN STREET WATERBURY CT</p>		<p>Sheet #: <b>SKA-020515a</b></p>	
			<p>Project #: 1346-47</p>	<p>Drawn By: JcB</p>