

STATE OF CONNECTICUT DEPARTMENT OF HOUSING

Community Development Block Grant
Disaster Recovery Program
Project: B-13-DS-09-001

Merritt Construction Services, Inc.
1177 High Ridge Road
Stamford, Connecticut 06905

Applicant Number 2097
3 Weed Circle
Stamford, Connecticut 06902

CODES:

THE DESIGN AND CONSTRUCTION DOCUMENTS PROVIDED WERE PREPARED IN ACCORDANCE WITH THE FOLLOWING CODES:
THE 2009 INTERNATIONAL RESIDENTIAL CODE AS MODIFIED BY:
2009 AND 2013 AMENDMENT TO THE STATE OF CONNECTICUT BUILDING CODE
2009 INTERNATIONAL ENERGY CONSERVATION CODE
2011 AMENDMENT TO THE 2009 INTERNATIONAL ENERGY CODE
2008 CONNECTICUT STATE FIRE SAFETY CODE AND
2009 AMENDMENT TO THE CONNECTICUT FIRE SAFETY CODE
2003 INTERNATIONAL PLUMBING CODE
2003 INTERNATIONAL MECHANICAL CODE
2011 NATIONAL ELECTRICAL CODE

DRAWING LIST:

T-1.0	TITLE SHEET	DP-1.0	BASEMENT PLUMBING DEMOLITION PLAN
SE-1	SITE DEVELOPMENT PLAN	DP-2.0	FIRST FLOOR PLUMBING DEMOLITION PLAN
SE-2	NOTES	DM-1.0	BASEMENT MECHANICAL DEMOLITION PLAN
SE-3	DETAILS	DM-2.0	FIRST FLOOR MECHANICAL DEMOLITION PLAN
EBLS	EXISTING BUILDING LOCATION SURVEY	DE-1.0	BASEMENT ELECTRICAL DEMOLITION PLAN
ZLS	ZONING LOCATION SURVEY	DE-2.0	FIRST FLOOR ELECTRICAL DEMOLITION PLAN
PP1	EPB PLANING PLAN	P-1.0	BASEMENT PLUMBING PLAN
D-1.0	FOUNDATION DEMOLITION PLAN	P-2.0	FIRST FLOOR PLUMBING PLAN
A-1.0	FOUNDATION PLAN	M-1.0	BASEMENT MECHANICAL PLAN
A-2.0	FIRST FLOOR PLAN	M-2.0	FIRST FLOOR MECHANICAL PLAN
A-3.0	ATTIC PLAN	M-3.0	ATTIC FLOOR MECHANICAL PLAN
A-4.0	ELEVATIONS	E-1.0	FIRST FLOOR ELECTRICAL PLAN
A-5.0	ELEVATIONS	E-2.0	ATTIC FLOOR ELECTRICAL PLAN
SO	STRUCTURAL NOTES		
S1	FOUNDATION PLAN		
S2	DETAILS		

NOT FOR
CONSTRUCTION

Revisions	Date
BID SET	3.16.15
BID SET	2.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16
PERMIT SET	03.25.16
BID SET	06.08.16

© ARIS CRIST AIA 2015. THIS
TECHNICAL DRAWING AND THE
ARCHITECTURAL WORK DEPICTED
ARE COPYRIGHTED BY
ARIS CRIST AIA

Aris Crist Architects
34 East Putnam Avenue
Greenwich, Connecticut 06830
203 661 0661

RESIDENCE: 2097


3 WEED CIRCLE
STAMFORD CT, 06902

FOUNDATION DEMOLITION PLAN

Drawn
L. F. O.
Checked
Date
06/03/14
Scale
As Noted
Job Number
Sheet

T-1.0

Owner of record is Andree Kaminsky.
 CT Department of Housing Community
 Development Block Grant - Disaster
 Recovery Applicant #2097

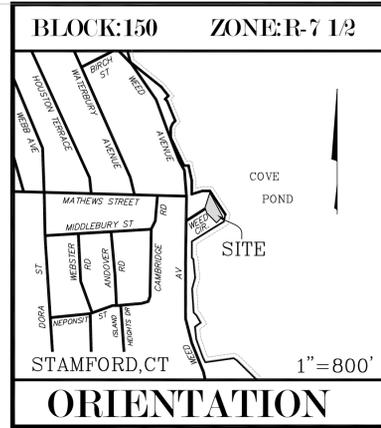

Revisions	Date
EPB Comments	11.19.15
Building Revisions	1.20.16
Eng Comments	2.22.16
EPB Comments	3.24.16

REDNISS & MEAD
 LAND SURVEYING
 PLANNING & ARCHITECTURAL CONSULTING
 22 First Street | Stamford, CT 06905
 Phone: 203.376.1118
 www.rednissandmead.com


Bret D. Holzwarth
 BRET D. HOLZWARTH, CT P.E. 27812
 March 24, 2016
 DATE
 This document and copies thereof are valid only if they bear the
 signature and seal of the professional engineer. Unauthenticated alterations render any declaration herein null & void.

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE: 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 SITE DEVELOPMENT PLAN


Drawn
M. J. L.
Checked
B. D. H.
Date
03/16/15
Scale
1" = 10'
Job Number
1933
Sheet
SE-1

NOT FOR CONSTRUCTION

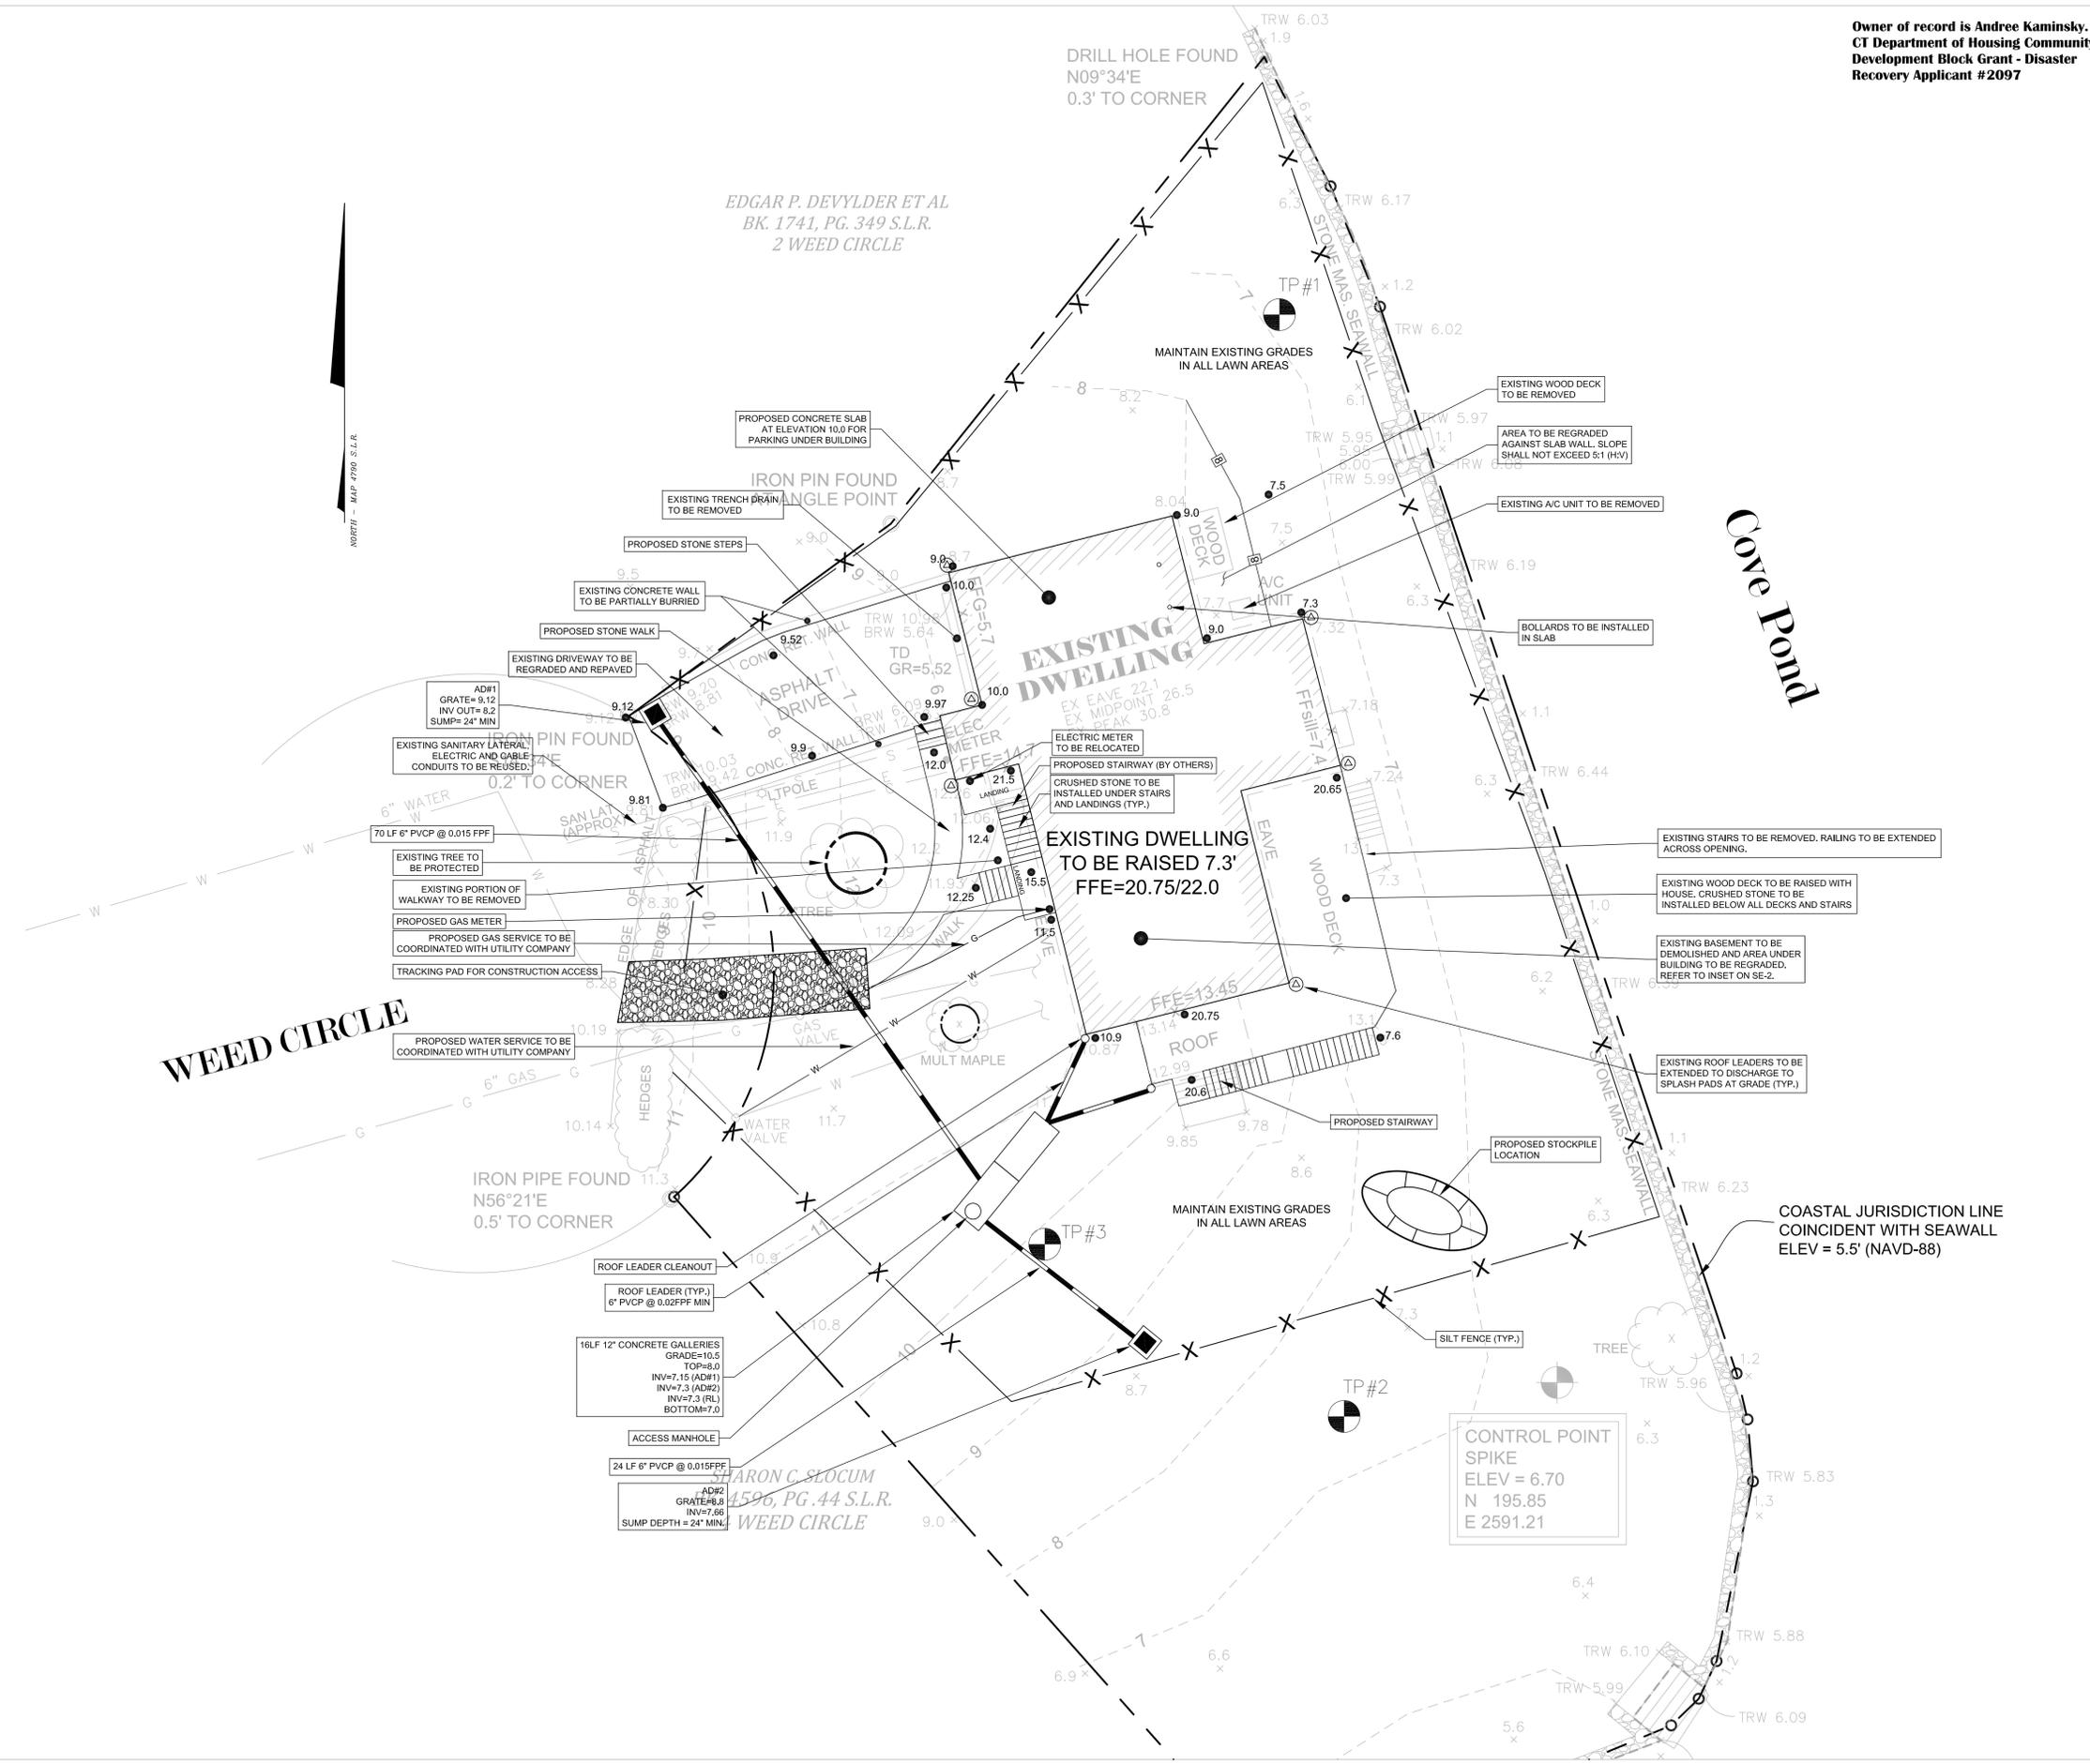

WEED CIRCLE

Cove Pond

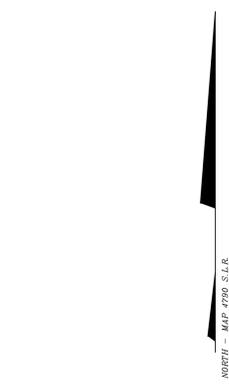

EDGAR P. DEVELDER ET AL
 BK. 1741, PG. 349 S.L.R.
 2 WEED CIRCLE

SHARON C. SLOCUM
 BK. 1596, PG. 44 S.L.R.
 WEED CIRCLE

GENERAL NOTES:

- These drawings are intended only to depict the design of site grading, paving, utilities and sediment & erosion controls. This drawing is for approval purposes only. No construction may begin prior to obtaining all necessary permits and approvals.
- All survey data, boundary lines, topography, building locations and area calculations are from a survey prepared by Redniss & Mead entitled Existing Building Location Survey revised 11-19-2015. Elevations depicted or labeled are based on NAVD-88.
- Refer to drawings by Aris Crist, Architect for information regarding building plans.
- Property lies in Zone R-7.5.
- All construction shall comply with the City of Stamford requirements, the State of Connecticut Basic Building Code Americans with Disabilities Act (ADA), the Connecticut Guidelines for Soil and Erosion and Sediment Control, OSHA, CT DOT Form 816 (latest edition), and FEMA Flood Regulations.
- Contractor shall supply complete shop drawings including manufacturer's product data sheets to the Site Engineer, for all construction material used in conjunction with these drawings. Contractor shall allow a 5 day review period, prior to fabrication and installation.
- Information on existing utilities has been compiled from various sources including utility company records, municipal record maps and field survey and is not guaranteed to be correct or complete. The contractor is solely responsible for determining actual locations and elevations of all utilities including underground services.
- The property is served by public water and sewers.

- Prior to any excavation the Contractor and/or Applicant, in accordance with Public Act 77-350, shall be required to contact "Call Before You Dig" at 1-800-922-4455 for mark-out of underground utilities. Dig test pit(s) at utility crossing(s) to check actual clearances with new utilities prior to construction. If conflicts are found the contractor shall notify the engineer, at which time the sewer in question shall be redesigned. If such redesign is not possible, the existing pipes or utilities shall be relocated to avoid the conflict. Such relocation shall be done with knowledge of and in accordance with the owner of the utility.
- It shall be the responsibility of the contractor to provide any excavation safeguards, necessary barricades, flagmen, etc. for traffic control and site safety. All work shall be done in accordance with OSHA requirements. The contractor shall be responsible for compliance with OSHA requirements.
- When preparing the existing site for the proposed development, all materials removed shall be disposed of in conformance with all governing agencies.
- The work shall be done in conformance with the plans unless changes have been approved in writing by the design engineer prior to the work being done.

- EARTHWORK & GRADING:**
- Grade away from building walls at 2% minimum (typical).
 - After the areas to be topsoiled have been brought to grade, the subgrade shall be loosened by scarifying to a depth of at least 2" to ensure bonding of the topsoil and subsoil.
 - Fill or topsoil shall not be placed nor compacted while in a frozen or muddy condition or while subgrade is frozen.

- FLOOD PROTECTION:**
- The property lies within FEMA Special Flood Hazard Area VE Zone, Base Flood Elevation (BFE) (100 year storm) is 14.0 NAVD-88 as depicted on Flood Insurance Rate Map No. 09001C0517G Panel S17 of 626, revised date July 8, 2013.
 - The construction of this development must follow the requirements set forth in the Federal Emergency Management Administration (FEMA) regulations for flood protection.
 - All utilities shall be installed per FEMA regulations for flood protection. All utilities (i.e., meters, etc.) must be set at least one foot above the BFE or waterproofed.
 - The first floor of the rated building shall be set a minimum of one foot above the calculated 100 Flood Elevation of 14.0.

- STORM AND SANITARY SEWER SYSTEMS:**
- Existing sewer lateral shall be reused if approved by Water Pollution Control Authority. Video inspection may be required to determine condition of pipe.
 - All pipe shall be installed straight and at the vertical and horizontal alignment shown. Pipes shall have a uniform slope as specified.
 - Minimum cover on all pipes shall be two feet (2') unless otherwise noted.
 - All storm pipe specified as Poly Vinyl Chloride Pipe (PVC) shall be SDR 35 with rubber gasketed joints and meet the requirements of ASTM D3034 and D3212.
 - All sanitary sewer pipe shall be Poly Vinyl Chloride Pipe (PVC) and shall be Schedule 40 with solvent weld joints.
 - All catch basins and area drains shall have a two foot (2') sump with bell traps or 90° PVC elbows.
 - All existing and proposed catch basins, manhole rims and utility facilities shall be raised or lowered to be flush with finished grade.
 - Flow in existing sewer system must not be interrupted. Any temporary routing of this sewer flow must be done in conformance with all applicable rules and regulations.
 - All crushed stone shall be Gradation No. 4 as per CT DOT Form 816, Article M.01.01. Stone shall consist of sound, tough, durable particles free from soft, thin, elongated, laminated, friable, micaceous, or disintegrated pieces of mud, dirt or other deleterious material.
 - At the end of construction, after the site has been fully stabilized, all new and previously existing storm sewer facilities including, but not limited to, catch basins, area drains, and manholes shall be fully cleaned with equipment designed for that purpose to the satisfaction of the inspecting engineer.

- STORM WATER INFILTRATION SYSTEM:**
- All gallery sections to have holes broken to allow flow prior to placement.
 - There shall be a minimum of one foot (1') of crushed stone on the sides of the outer galleries.
 - There shall be 6" of 1/4" crushed stone below all galleries.
 - The infiltration systems are to remain disconnected until up gradient areas are fully stabilized.
 - The infiltration systems shall be a minimum of 12" above high groundwater and shall be a minimum of 10' from any footing drain.
 - Each gallery run to have access MH's as shown on plan. Use standard City of Stamford MH casting. Casting cover shall be equal pattern to No. 1201 as manufactured by Campbell Foundry Company, Harrison, NJ. Raise casting the grade using solid concrete block and mortar.
 - Roof runoff to go to the detention gallery system as specified. Roof shall be pipes to gallery with 6" diameter PVC at 1/8" per foot minimum with 6" minimum cover in landscaped areas and 18" cover below pavement.
 - Contact the Design Engineer three (3) days prior to excavation for the galleries. During the excavation, the Design Engineer may revise the elevations of the galleries if field conditions dictate.
 - Maintenance of all onsite drainage facilities shall be the responsibility of the property owner.

- UTILITIES:**
- Proposed electric, cable, gas and water services are shown for schematic purposes only and are subject to change pending utility company review. These utilities shall be designed by others and installed in conformance to the requirements of the governing utility companies.
 - Where necessary, existing utilities shall be reinstalled to meet all minimum coverage requirements.
 - Utility connections at building face shall be coordinated with the building contractors.
 - In general, each utility shall have a minimum clearance of three feet to any other underground utility.
 - Any and all utilities abandoned shall be capped or removed in accordance with utility companies' requirements.
 - All utilities shall be installed per FEMA regulations for flood protection. All utilities (i.e., HVAC condensers, electric transformers, etc.) must be set one foot above the Base Flood Elevation (BFE) or waterproofed.
 - Electric, telephone, cable, gas and water services shall be compliant with the City of Stamford Zoning Regulations Section 7.1 - Flood Prone Area Regulations, and shall be installed in conformance to the requirements of the governing utility companies.
 - Gas service to the meter shall be installed by the utility company.

PAVEMENT:

- Areas of asphalt pavement that are disturbed by the construction of this project shall be replaced in accordance with the asphalt pavement repair detail. The finished grade of asphalt paving shall blend to existing grade and the edge of the concrete pavement smoothly with no slopes exceeding 4%.
- Existing features such as but not limited to walls, curbs, and pavement damaged by construction activities shall be repaired at no additional cost to the owner.
- Bituminous curbs damaged by the project shall be replaced with the new bituminous curbing machine laid Class 3 as described in Sections 8.15 and M.04 of the CT DOT Form 816.
- Saw cut perimeter of area to be excavated. Saw cut shall be straight and vertical.
- Compaction shall be constructed as specified in the CT DOT FORM 816 (latest edition), Section 4.06 specification, the drawings and the details. Testing lab shall verify compaction of each course of pavement as directed by the Site Engineer.
- Finished paving shall be free of "bird baths" and be smooth at the slopes specified on the plans.
- The pavement shall be protected from vehicular traffic of any kind with the use of barricades, etc. for a minimum period of 24 hours after final rolling. Maintain and protect asphalt surface from scrapes, tears, spills, hydraulic leaks, and any other construction damage for the remainder of construction until Owner's Representative acceptance. Contractor is responsible for clearing, repairing, seal coating, patching, and re-striping as necessary to obtain Owner's Representative's final approval/acceptance.

- CITY OF STAMFORD STANDARD NOTES**
- A Street Opening Permit is required for all work within the City of Stamford Right-of-Way
 - All work within the City of Stamford Right-of-Way shall be constructed to City of Stamford requirements, the State of Connecticut Basic Building Code and the Connecticut Guidelines for Soil Erosion and Sedimentation Control.
 - The Engineering Bureau of the City of Stamford shall be notified three days prior to any commencement within the City of Stamford Right-of-Way.
 - Trees within the City of Stamford Right-of-Way to be removed shall be posted in accordance with the Tree Ordinance.
 - Prior to any excavation the Contractor and/or Applicant/Owner, in accordance with Public Act 77-350, shall be required to contact "Call Before You Dig" at 1-800-922-4455 for mark out of underground utilities.
 - All retaining walls greater than three (3) feet are required to be designed, and certified during construction by a Professional Engineer licensed in the State of Connecticut. Inspection of the retaining shall be required prior to issuance of a Certificate of Occupancy and/or bond release.
 - Certification will be required by a professional engineer licensed in the State of Connecticut that work has been completed in compliance with the approved drawings.
 - A Final Location Plan will be required by a professional land surveyor licensed in the State of Connecticut.
 - Sediment and erosion controls shall be maintained and repaired as necessary throughout construction until the site is stabilized.


- SEDIMENT AND EROSION CONTROL NOTES:**
- All sediment and erosion controls shall be done in conformance with the "Connecticut Guidelines for Soil Erosion and Sediment Control" dated May 2002 prepared by The Connecticut Council on Soil and Water Conservation.
 - The contractor is assigned the responsibility for implementing this sediment and erosion control plan. This responsibility includes the installation and maintenance of control measures, informing all parties engaged on the construction site of the requirements and objectives of the plan notifying the Zoning Department of any transfer of this responsibility.
 - Temporary sediment control measures and tree protection must be installed in accordance with drawings and manufacturer recommendations prior to work in any upland areas.
 - No construction or construction equipment or storage of materials will be allowed on the downhill side of the silt fence or within fenced off areas, except during construction of the proposed facilities shown beyond the fences.
 - Where existing trees are to be saved, trees shall be protected with trunk armoring where shown. Tree limbs shall be trimmed as needed to protect the trees from damage by construction operations. Such trimming shall be minimized. Armoring and any limb trimming should be done before construction begins. Tree protection should be maintained during construction. Equipment Trafficking and materials storage over the tree roots shall be avoided.
 - Anti-tracking pads shall be installed at start of construction and maintained in an effective condition throughout the duration of construction. Pads consist of 2" x 4" crushed stone, 6" minimum thickness and extend the width of the construction access. The length of the access shall be sufficient to prevent dirt from being tracked onto off site roads (minimum length of 50').
 - Silt fence shall be Mirafi environments, Amoco siltstop or equivalent approved by Site Engineer. Filter fabric used shall be Mirafi 100x or equivalent. Install silt fence according to manufacturer's instruction, particularly, bury lower edge of fabric into ground.
 - Land disturbance shall be kept to a minimum. All disturbed area shall be planted in where permanent plantings are called for as soon as practicable. Seed and mulch disturbed areas with grass seed where permanent plantings are not called for, as soon as practicable. Prepare seedbed (4" thick minimum) with topsoil. Seed, rake, roll, water and mulch areas according to mixes below. Water as often as necessary (up to 3 times per day) to establish cover. Mulch seeded areas at 1 to 2 tons/acre with salt hay. Maintain mulch and watering until grass is 3" high with 85% cover. Reseed or overseed if necessary.

- TEMPORARY SEED MIX:**
- | | | |
|--------------------|-------------|-------------------|
| Perennial ryegrass | 40 lbs/acre | (1 lb/1000 sq ft) |
|--------------------|-------------|-------------------|

- PERMANENT LAWS:**
- | | |
|------------------------|-------------------------------|
| Kentucky Bluegrass | 20 lbs/acre |
| Creeping Red Fescue | 20 lbs/acre |
| Perennial Ryegrass | 5 lbs/acre |
| Optimum Seeding Dates: | 45 lbs/acre (1 lb/1000 sq ft) |

- Any disturbed area shall be restored to the preconstruction condition. Disturbed areas shall be top soiled, seeded with grass and mulched in a manner conforming to the recommendations of the "Guidelines for Soil Erosion and Sediment Control", published by The Connecticut Council on Soil and Water Conservation, May 2002.
- If disturbed areas can not be seeded immediately due to the time of year, mulch area until seeding can occur; remove mulch and seed and re-mulch when season permits.
- Haybales shall be new and are to be replaced whenever their condition deteriorates beyond reasonable usability.
- Affected portions of off site roads and sidewalks must be swept clean when required to keep down dust and prevent safety hazards or at least once a week during construction and as directed by Site Engineer.
- Dust control to be achieved with watering down disturbed areas as required.
- After each storm event or once bi-weekly, all sediment and erosion controls shall be inspected. Any corrective actions to mitigate environmental concerns will be ordered by the site engineer or environmental engineer.
- Additional sediment and erosion control measures may be installed during the construction period if found necessary by the inspecting engineer or any Governing Agency.
- Periodically and upon completion of the job, clean silt from any affected storm sewer systems including pipes and inlets. Use silt during final landscaping or dispose off-site legally.

Subsurface Soil Investigation	
Soil Profile	
Test Pit #: 1	Date: 09/17/2015
Inspector: BDH	Sanitarian: N/A
Ledge at: NONE	Mottling at: NONE
Water at: 67"	Roots at: 15"
Depth: 72"	Soil Description
0"-24"	TOPSOIL/FILL
24"-30"	BLACK, ORGANIC COURSE SAND W/ SHELLS
30"-72"	SAND & GRAVEL - LOOSE
Subsurface Soil Investigation	
Soil Profile	
Test Pit #: 2	Date: 09/17/2015
Inspector: BDH	Sanitarian: N/A
Ledge at: NONE	Mottling at: 24"
Water at: 75"	Roots at: NONE
Depth: 79"	Soil Description
0"-10"	TOPSOIL
10"-79"	TAN SAND & GRAVEL - LOOSE
Subsurface Soil Investigation	
Soil Profile	
Test Pit #: 3	Date: 09/17/2015
Inspector: BDH	Sanitarian: N/A
Ledge at: NONE	Mottling at: NONE
Water at: 101"	Roots at: 85"
Depth: 102"	Soil Description
0"-17"	TOPSOIL
17"-23"	ORANGE BROWN COMPACTED SILTY LOAM
23"-102"	SAND & GRAVEL - LOOSE

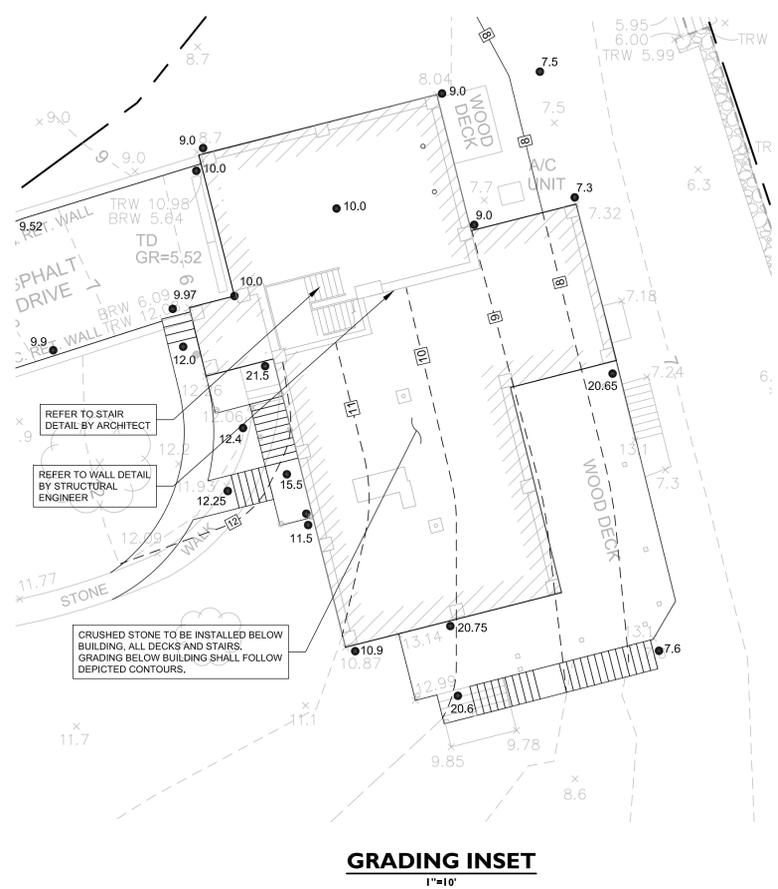

Revisions	Date
EPB Comments	11.19.15
Building Revisions	1.20.16
Eng Comments	2.22.16
EPB Comments	3.24.16

REDNISS & MEAD
 LAND SURVEYING
 PLANNING & ARCHITECTURE
 22 First Street | Stamford, CT 06905
 Tel: 203.327.1118
 www.rednissandmead.com

Bret D. Holzwarth
 BRETT D. HOLZWARTH CT.P.E. 27812
March 24, 2016
 DATE
This document and copies thereof are valid only if they bear the signature of the professional engineer. Unauthenticated alterations render any declaration herein null & void.


Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE: 2097
3 WEED CIRCLE
STAMFORD CT, 06902
NOTES


M. J. L.	Drawn
	Checked
	Date
03/16/15	Scale
1"=10'	Job Number
1933	Sheet

NOT FOR CONSTRUCTION

SE-2

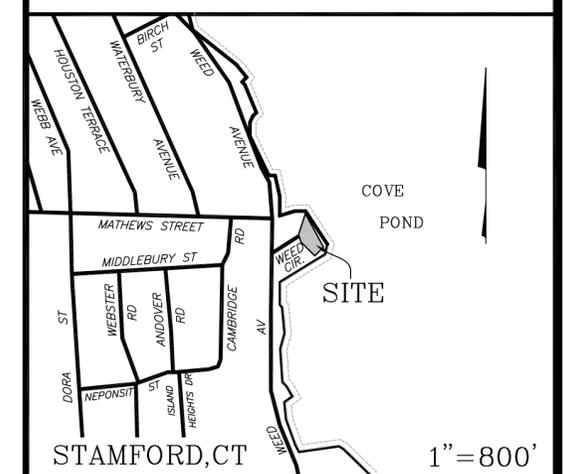

ORIENTATION

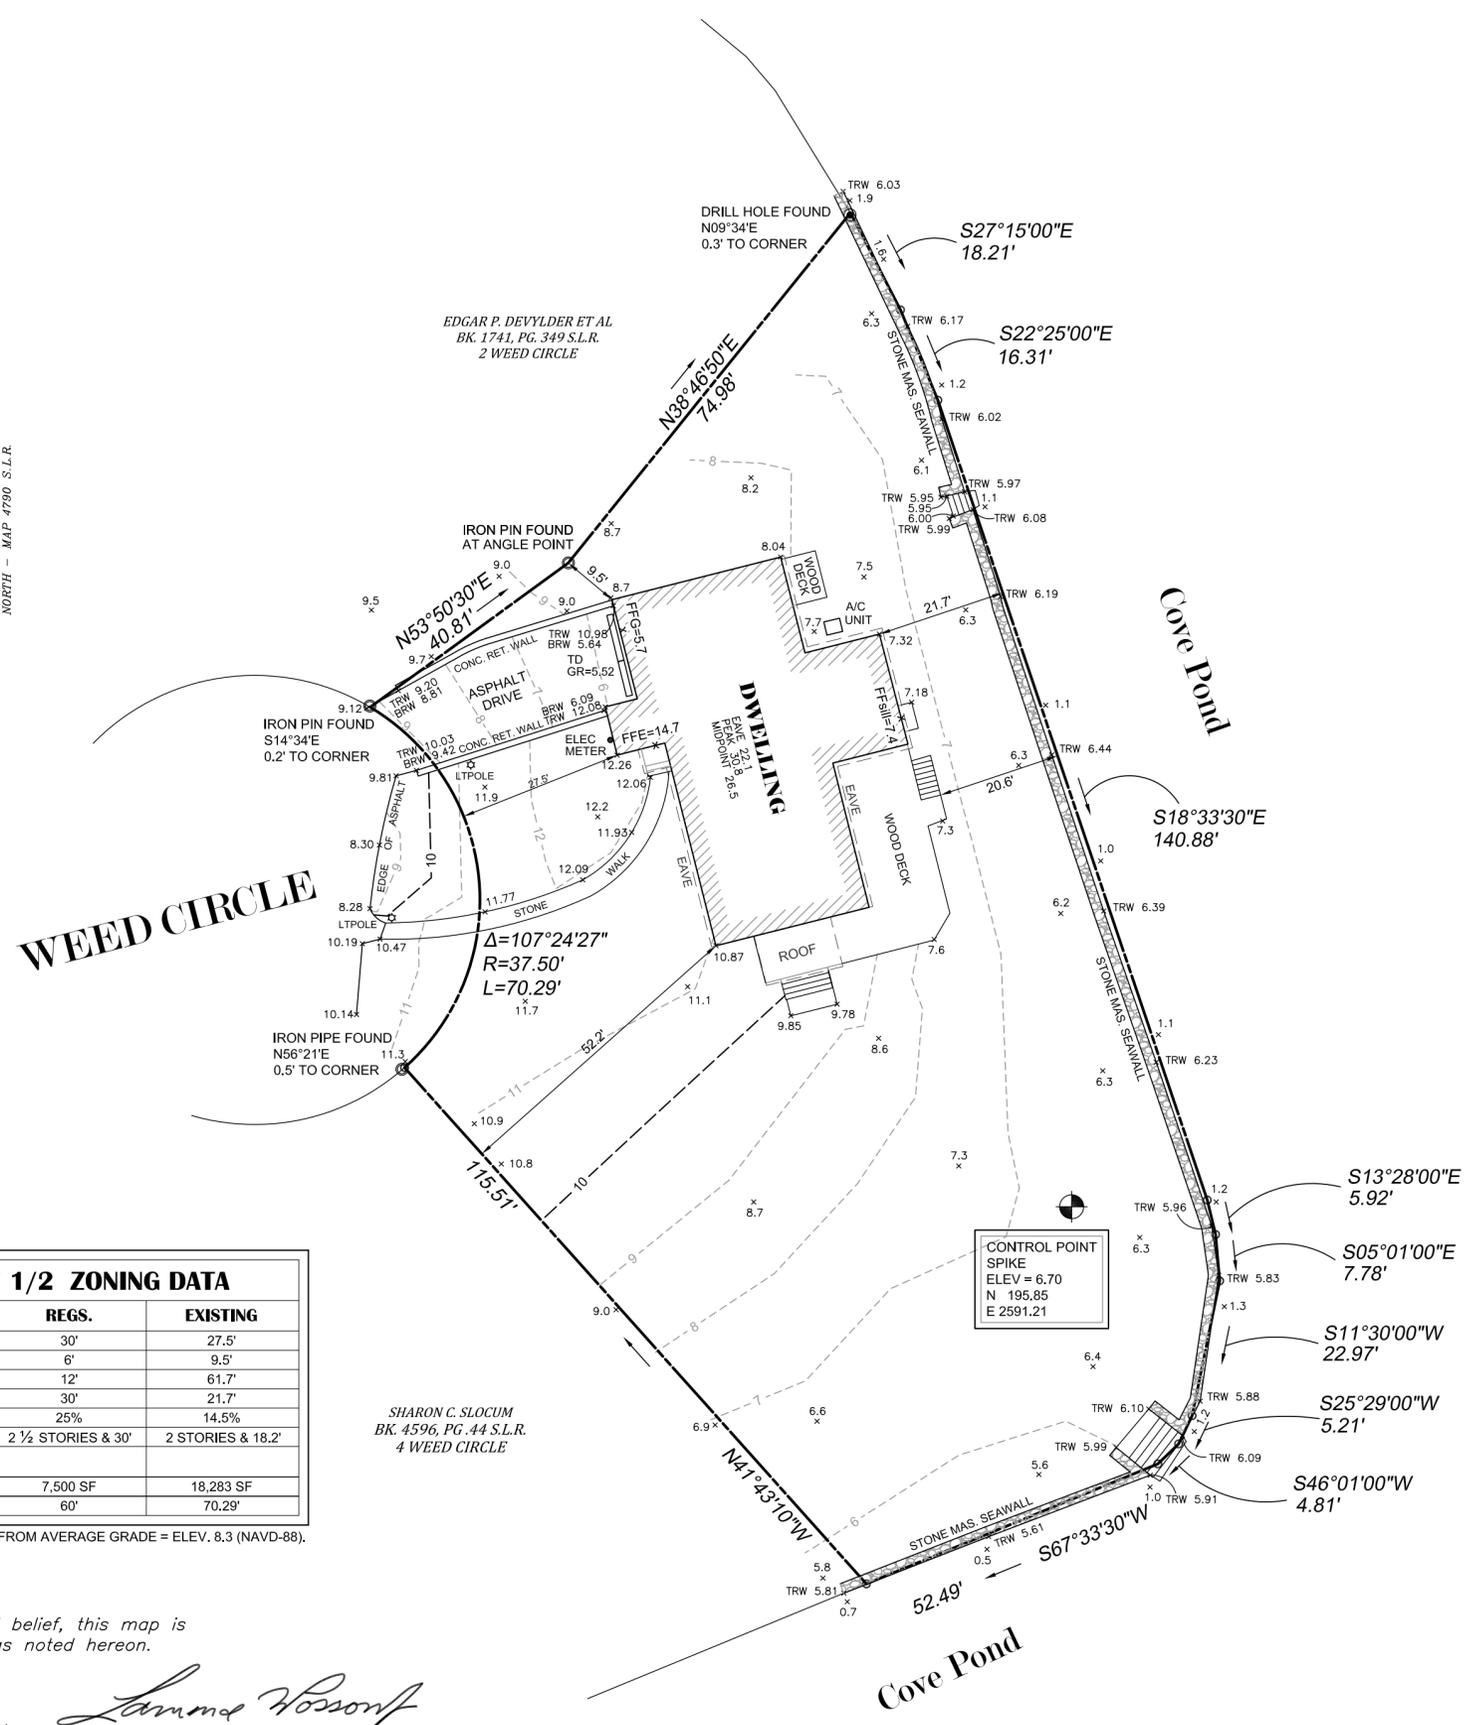

NOTES:

1. This survey has been prepared in accordance with Sections 20-300 b-1 thru 20-300b-20 of the Regulations of Connecticut State Agencies and the Standards for Surveys and Maps in the State of Connecticut as adopted by the Connecticut Association of Land Surveyors, Inc. as an Existing Building Location Survey the Boundary Determination Category of which is a Resurvey conforming to Horizontal Accuracy Class A-2 and Topographic Accuracy Class T-2 and intended to be used for verification of zoning compliance with respect to the location of improvements depicted hereon.
2. Total area of the surveyed parcel = 18,283 SF OR 0.4197 Acres.
3. Building Area = 2,652 SF or 14.5%
4. Reference is made to Lot 3, Map 4790 and 2 Parcel B, Map 4760 S.L.R.
5. Reference is made to deed found in Volume 6061 at Page 1 S.L.R.
6. Reference is made to FEMA Flood Insurance Rate Map Panel No. 517 of 626, Map No. 09001C0517G, Map revised July 8, 2013. Subject Parcel lies within Special Flood Hazard Area Zone VE (EL14).
7. Owner of record is Andree Kaminsky.
8. Elevations depicted hereon are based on North American Vertical Datum of 1988 (NAVD-88). Reference is made to benchmark NGS LX1194.

ZONE R-7 1/2 ZONING DATA		
PRIMARY STRUCTURE	REGS.	EXISTING
STREET LINE	30'	27.5'
SIDE YARD (one side)	6'	9.5'
SIDE YARD (both sides)	12'	61.7'
REAR YARD	30'	21.7'
MAX. BUILDING AREA	25%	14.5%
MAX. BUILDING HEIGHT *	2 1/2 STORIES & 30'	2 STORIES & 18.2'
LOT (MINIMUM)		
LOT AREA	7,500 SF	18,283 SF
LOT FRONTAGE	60'	70.29'

*BUILDING HEIGHT MEASURED FROM AVERAGE GRADE = ELEV. 8.3 (NAVD-88).

To my knowledge and belief, this map is substantially correct as noted hereon.

On 11/19/2015 By Lawrence W. Posson, Jr. CT Lic. No. 18130

This document and copies thereof are valid only if they bear the signature and embossed seal of the designated licensed professional. Unauthorized alterations render any declaration hereon null and void.

Redniss & Mead
 ENGINEERS · SURVEYORS · PLANNERS · WWW.REDNISSMEAD.COM
 ESTABLISHED 1957 22 FIRST STREET · STAMFORD, CONNECTICUT 06905 · 203-327-0500


EXISTING BUILDING LOCATION SURVEY
 DEPICTING
#3 WEED CIRCLE
 STAMFORD, CONNECTICUT
 PREPARED FOR
MERRITT CONSTRUCTION SERVICES, INC.

1933A-1_EBLS.dwg


JOB NO.:	1933A-1	DATE:	9/11/2014
DRAWN BY:	KAJ/CJV	CHECKED BY:	
SCALE: 1" = 20'			

ZONE R-7 1/2 ZONING DATA			
PRIMARY STRUCTURE	REGS.	EXISTING	PROPOSED
STREET LINE *	30'	27.5'	24.6'
STREET CENTER *	55'	65'	62.1'
SIDE YARD (one side)	6'	9.5'	9.5'
SIDE YARD (both sides)	12'	61.7'	61.7'
REAR YARD *	30'	21.7'	21.7'
MAX. BUILDING AREA	25%	14.5%	14.2%
MAX. BUILDING HEIGHT **	2 1/2 STORIES & 30'	1 1/2 STORIES & 12.7'	1 1/2 STORIES & 20.0'
LOT (MINIMUM)			
LOT AREA	7,500 SF	18,283 SF	18,283 SF
LOT FRONTAGE	60'	70.29'	70.29'

* PURSUANT TO SECTION 7 C & D OF THE STAMFORD ZONING REGULATIONS, OPEN DECKS AND PORCHES MAY EXTEND UP TO 6' INTO THE FRONT AND REAR YARD.
 ** BUILDING HEIGHT MEASURED FROM BASE FLOOD ELEV. TO ROOF MID POINT.

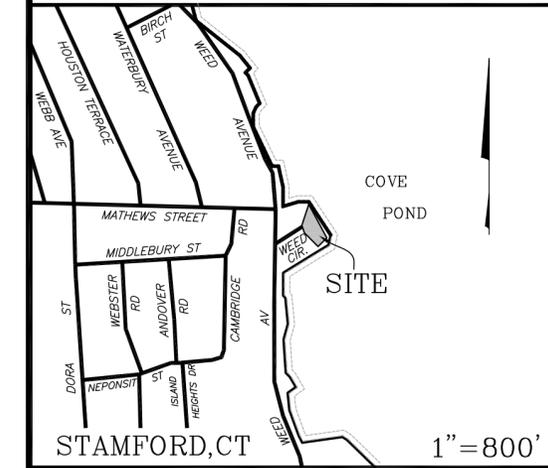

ORIENTATION

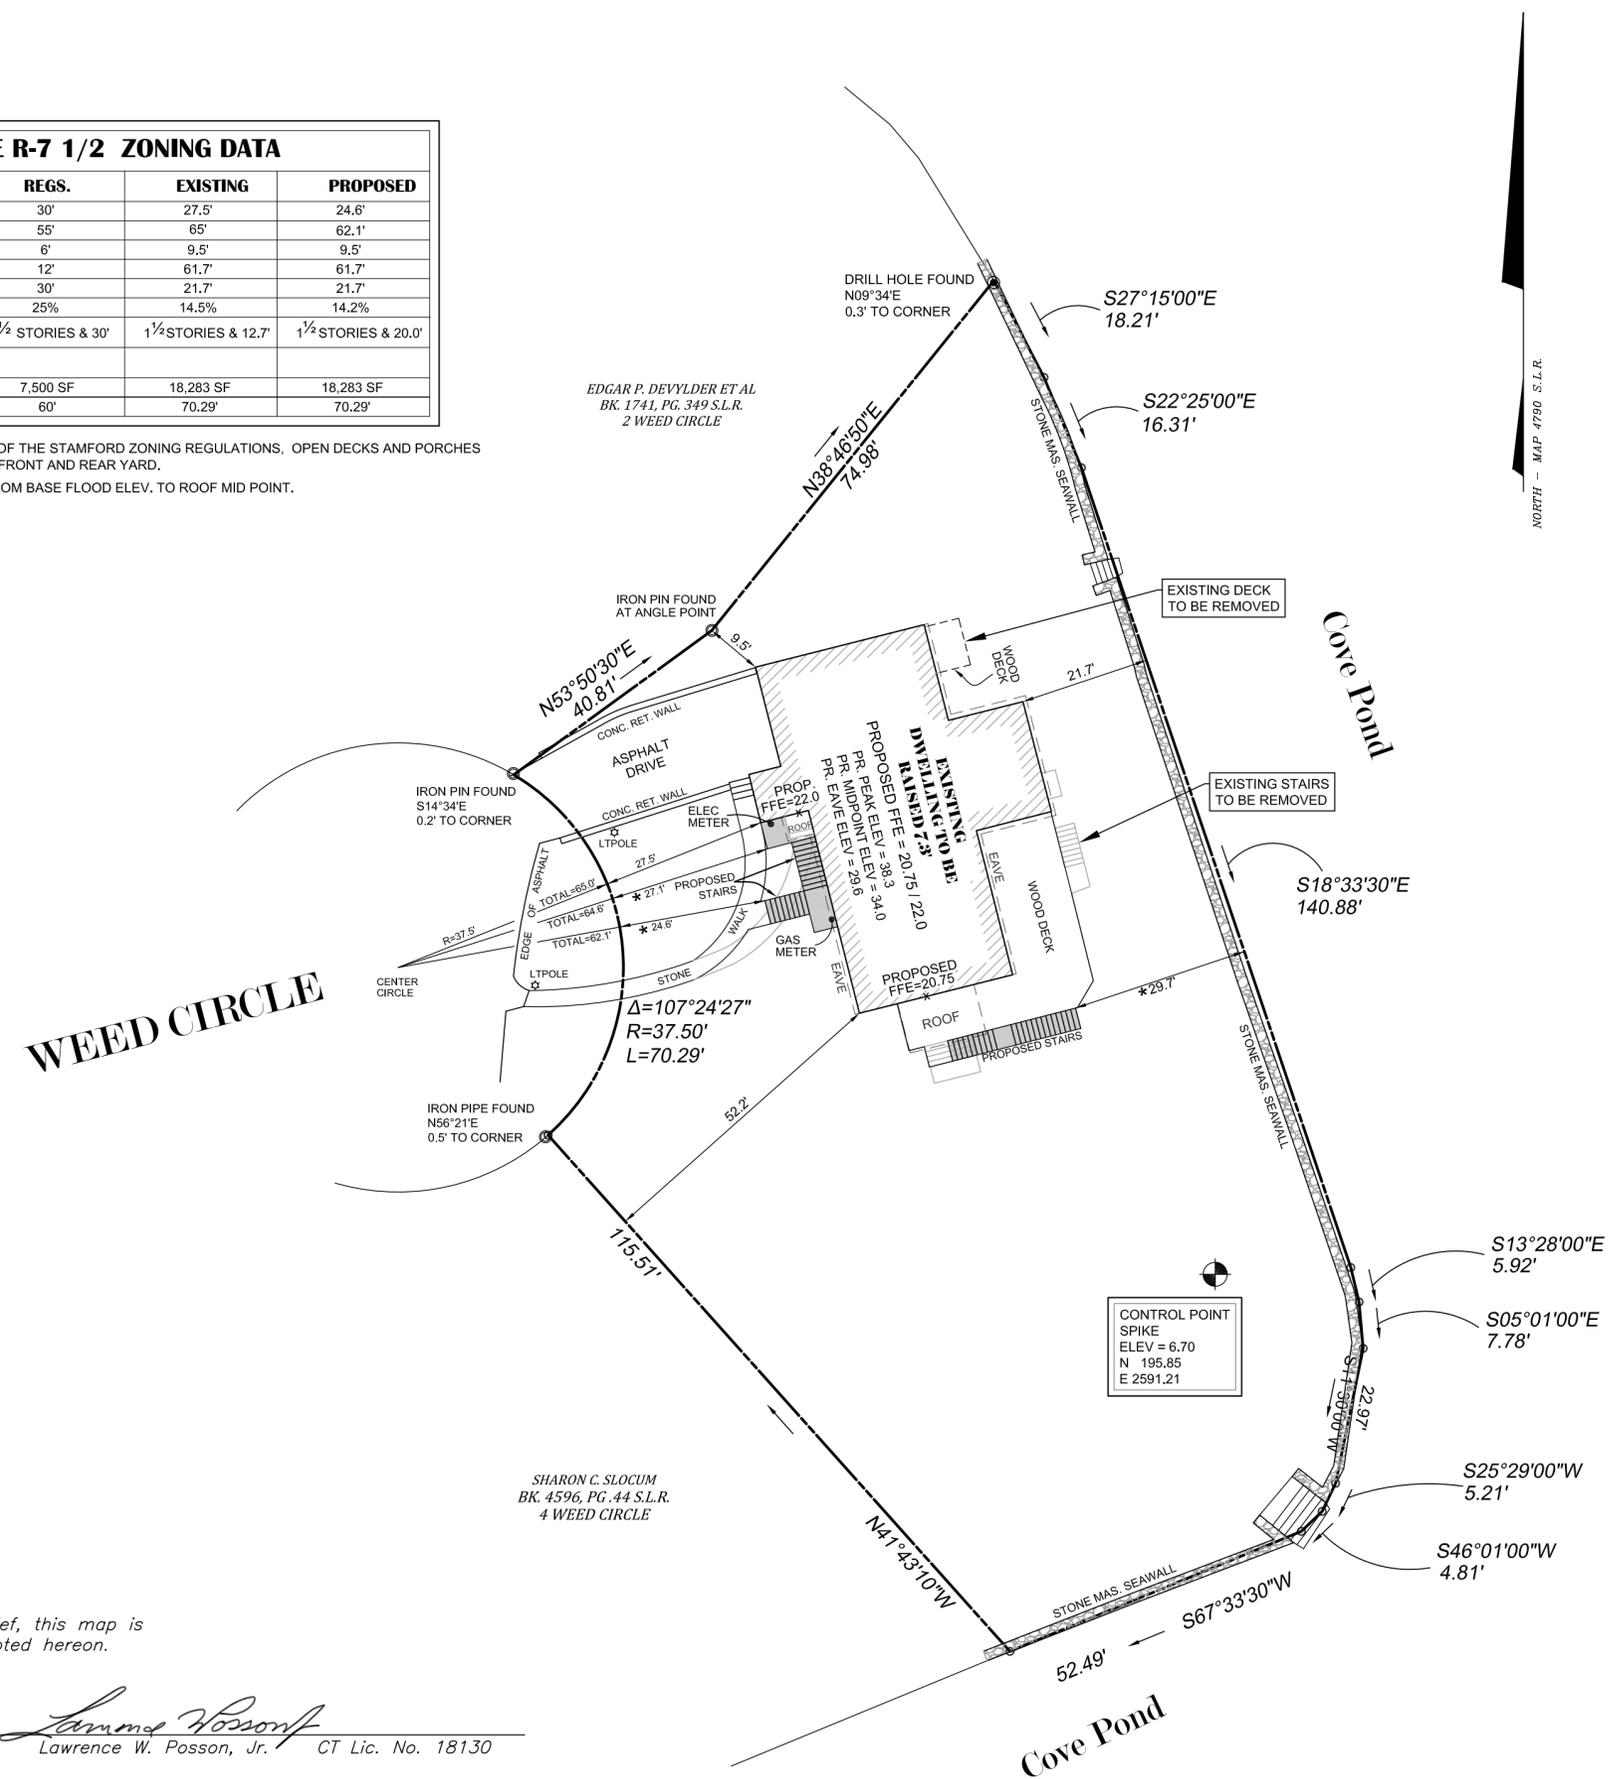

NOTES:

- This survey has been prepared in accordance with Sections 20-300 b-1 thru 20-300b-20 of the Regulations of Connecticut State Agencies and the Standards for Surveys and Maps in the State of Connecticut as adopted by the Connecticut Association of Land Surveyors, Inc. as an Zoning Location Survey the Boundary Determination Category of which is a Resurvey conforming to Horizontal Accuracy Class A-2 and Vertical Accuracy Class V-2 and intended to be used for verification of zoning compliance with respect to the location of improvements depicted hereon.
- Total area of the surveyed parcel = 18,283 SF OR 0.4197 Acres.
- Proposed Building Area = 2,596 SF or 14.2%
- Reference is made to Lot 3, Map 4790 and 2 Parcel B, Map 4760 S.L.R.
- Reference is made to deed found in Volume 6061 at Page 1 S.L.R.
- Reference is made to FEMA Flood Insurance Rate Map Panel No. 517 of 626, Map No. 09001C0517G, Map revised July 8, 2013. Subject Parcel lies within Special Flood Hazard Area Zone VE (EL14).
- Owner of record is Andree Kaminsky. CT Department of Housing Community Develop Block Grant- Disaster Recovery Applicant # 2097

ZONING LOCATION SURVEY
 DEPICTING
PROPOSED IMPROVEMENTS
#3 WEED CIRCLE
 STAMFORD, CONNECTICUT
 PREPARED FOR
MERRITT CONSTRUCTION SERVICES, INC.

JOB NO.:	1933	DATE:	08/07/2015
DRAWN BY:	CJV/BDH	CHECKED BY:	
SCALE:			

To my knowledge and belief, this map is substantially correct as noted hereon.

On 1/20/2016 By Lawrence W. Posson, Jr. CT Lic. No. 18130

This document and copies thereof are valid only if they bear the signature and embossed seal of the designated licensed professional. Unauthorized alterations render any declaration hereon null and void.

Redniss & Mead
 ENGINEERS · SURVEYORS · PLANNERS · WWW.REDNISSMEAD.COM
 ESTABLISHED 1957 22 FIRST STREET · STAMFORD, CONNECTICUT 06905 · 203-327-0500



PROJECT
NORTH

COASTAL JURISDICTION LINE
COINCIDENT WITH SEAWALL
ELEV = 5.5' (NAVD-88)

Cove Pond

STONE MAS. SEAWALL

EX. TREE

9 SG

9 SG

STONE SEAWALL

Cove Pond

LAWN

WOOD DECK

A/C UNIT

7 PV
9 NE
9 NE

MP
12 IG
7 IS

EXISTING
DWELLING
TO BE RAISED

12 PV

7 SG

4 MP

AC

5 CA

20 NE

5 AA

SHARON C. SLOCUM
BK. 4596, PG. 44 S.L.R.
4 WEED CIRCLE


EDGAR P. DEVYLDER ET AL
BK. 1741, PG. 349 S.L.R.
2 WEED CIRCLE

PLANT LIST

QTY	KEY	BOTANICAL NAME	COMMON NAME	SIZE	ROOT
1	AC	AMELANCHIER CANADENSIS	SHADBLOW	4-5' HT.	B&B
5	AA	ARONIA ARBUTIFOLIA 'BRILLIANTISSIMA'	RED CHOKEBERRY	2-3' HT.	CONT.
5	CA	CLETHRA ALNIFOLIA 'COMPACTA'	CLETHRA	2-3' HT.	CONT.
12	IG	ILEX GLABRA 'SHAMROCK'	SHAMROCK INKBERRY	2-3' HT.	CONT.
7	IS	ILEX 'STEEDS'	STEEDS HOLLY	30-36" HT.	CONT.
5	MP	MYRICA PENNSYLVANICA	NORTHERN BAYBERRY	2-3' HT.	CONT.
38	NE	ASTER NOVAE-ANGLIAE	NEW ENGLAND ASTER		1 GAL.
19	PV	PANICUM VIRGATUM	SWITCHGRASS		1 GAL.
25	SG	SOLIDAGO SEMPERVIRENS	SEASIDE GOLDENROD		1 GAL.

NOTES:

- EXISTING AND PROPOSED SITE INFORMATION TAKEN FROM A DIGITAL AUTOCADD SITE PLAN SUPPLIED BY REDNISS & MEAD.
- EXACT LOCATION OF PROPOSED PLANTINGS AND SPECIES TYPES MAY VARY FROM THIS PLAN BASED ON SITE PLAN REVISIONS AND/OR ACTUAL FIELD CONDITIONS.
- PLANT SPECIES SUBSTITUTIONS MAY BE MADE WITH THE APPROVAL OF THE PROJECT LANDSCAPE ARCHITECT PRIOR TO PLANTING.
- THIS PLAN FOR PLANTING PURPOSES ONLY. SEE PLANS BY OTHERS FOR ADDITIONAL INFORMATION.

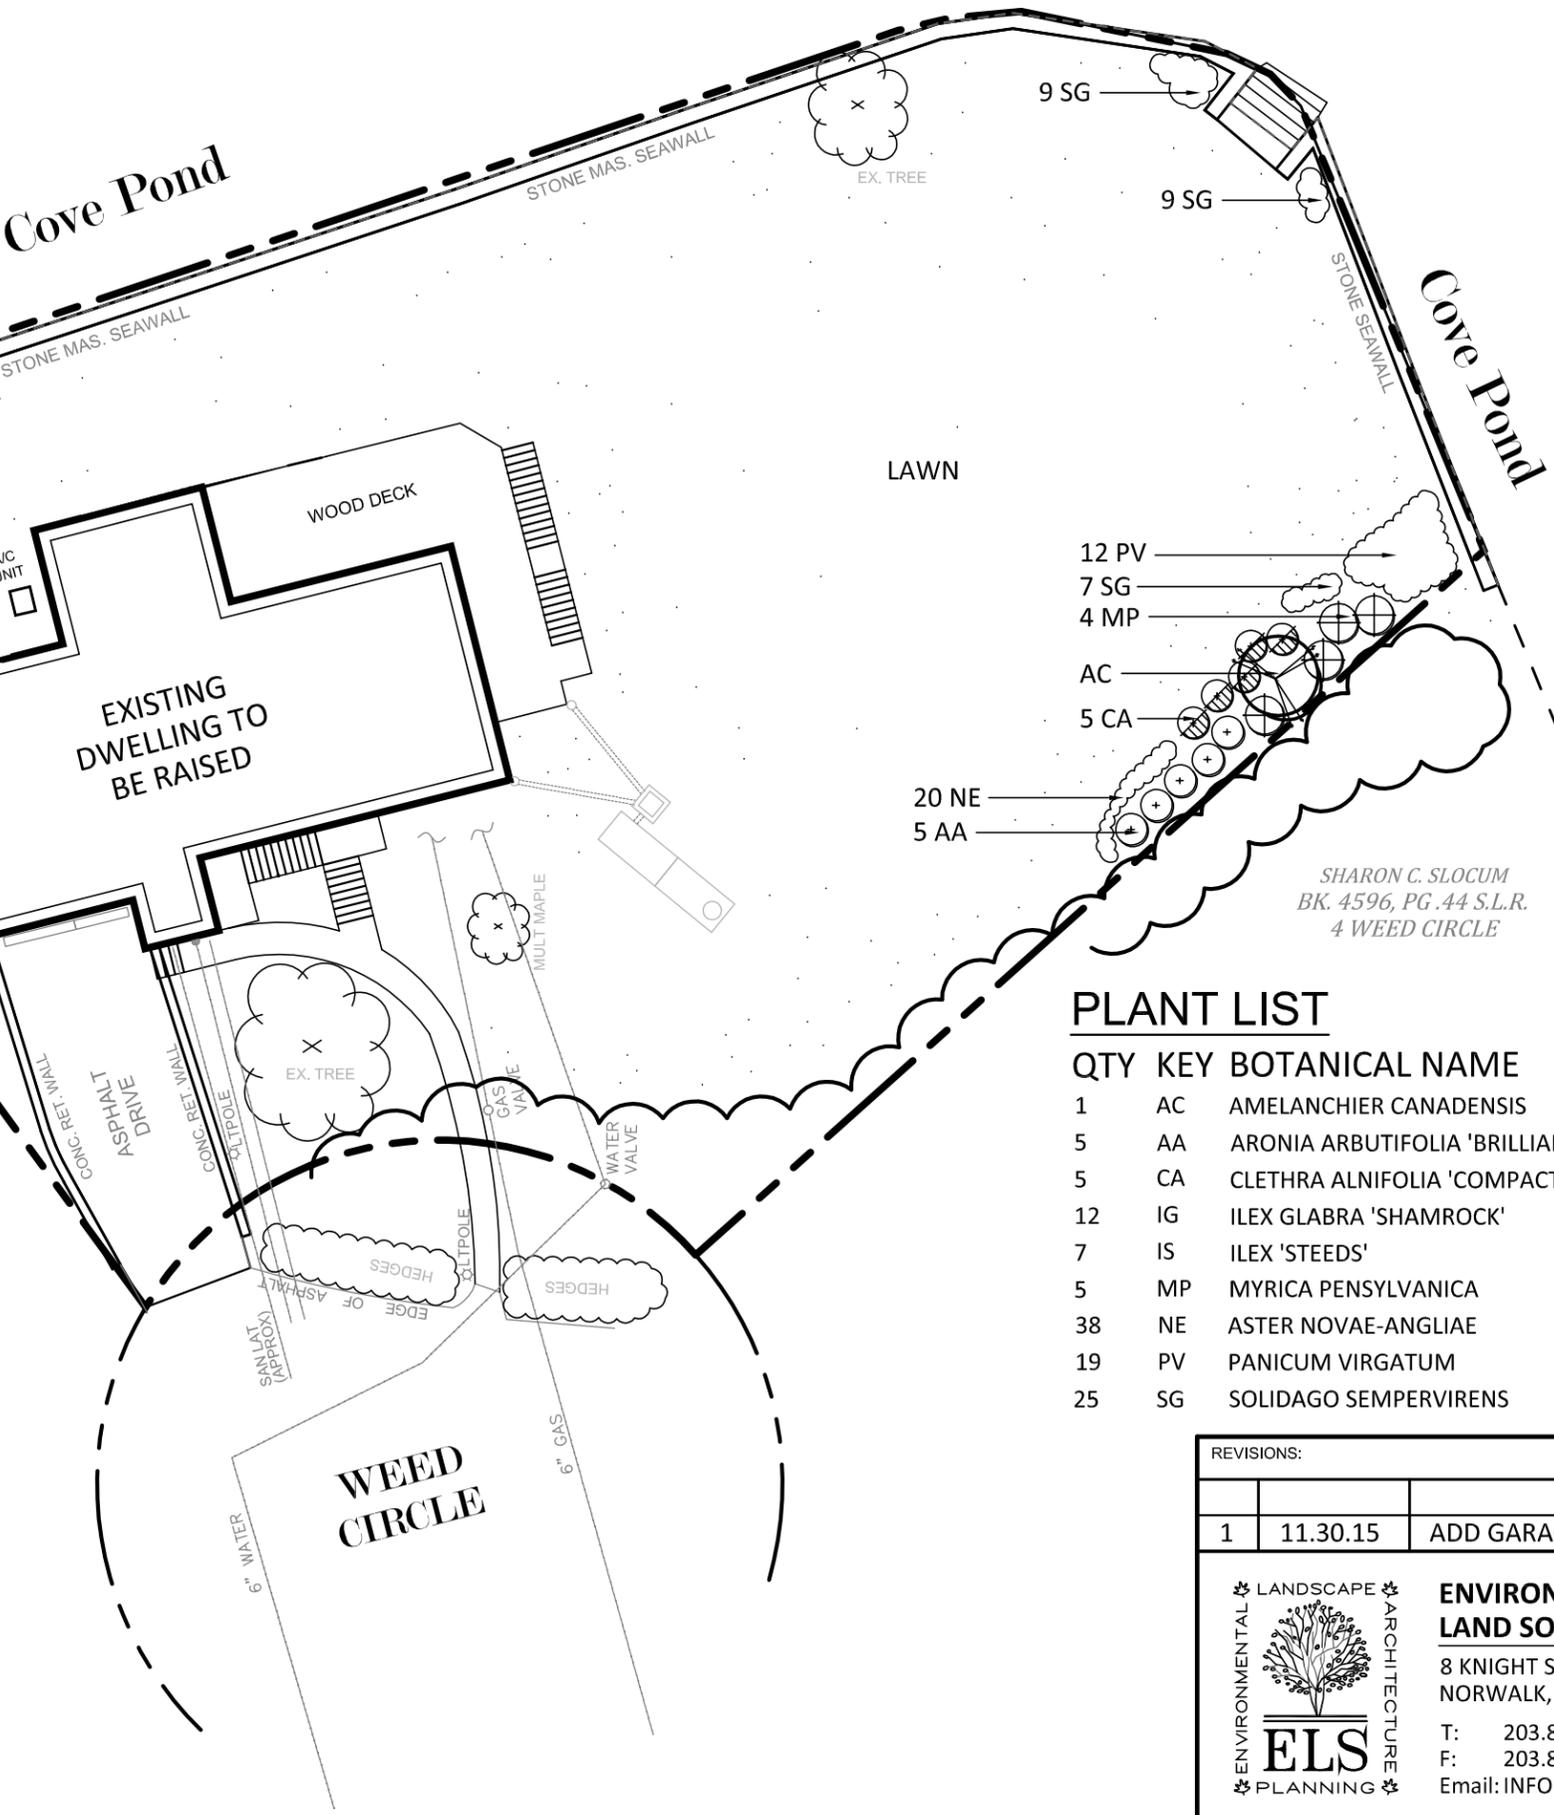

REVISIONS:			DRAWING TITLE:	
1	11.30.15	ADD GARAGE SCREENING	EPB PLANTING PLAN	
PROJECT:			3 WEED CIRCLE STAMFORD, CONNECTICUT	
ENVIRONMENTAL LAND SOLUTIONS, LLC 8 KNIGHT STREET, SUITE 203 NORWALK, CT 06851 T: 203.855.7879 F: 203.855.7835 Email: INFO@ELSLLC.NET			DATE: 9.24.15	DRAWING NO.: PP.1
SCALE: 1"=20'				

Revisions	Date
BID SET	3.16.15
BID SET	2.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16




© ARIS CRIST AIA 2015. THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE: 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 FOUNDATION DEMOLITION PLAN

L.F.O.	Drawn
	Checked
06/03/14	Date
As Noted	Scale
	Job Number
	Sheet

D-1.0

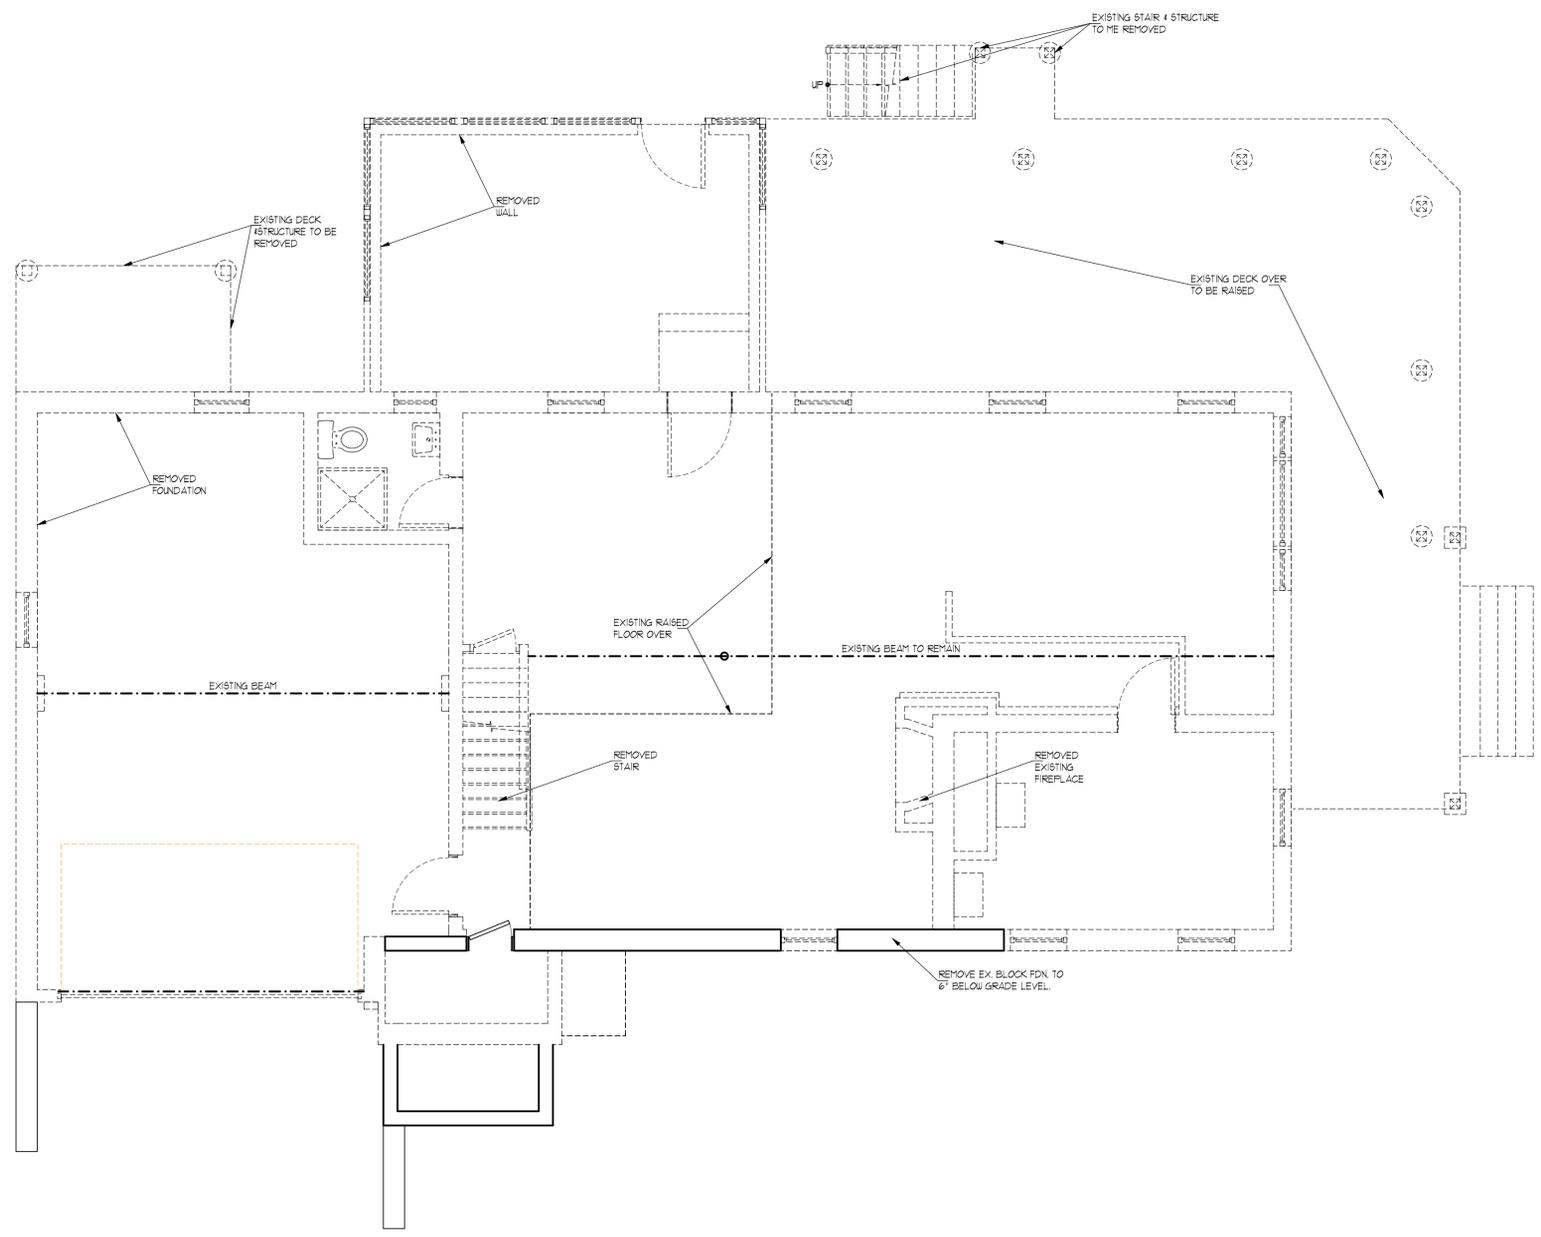

FOUNDATION DEMOLITION PLAN
 SCALE: 1/4"=1'-0"

— EXISTING WALL TO REMAIN
 - - - WALL TO BE DEMOLISHED

NOT FOR CONSTRUCTION

PAINT SPECS:
 SHERWIN WILLIAMS PRO MAR 400
 CEILINGS, 1 COAT PRIMER, CEILING WHITE 2 COAT, FLAT
 WALLS, 1 COAT PRIMER, 2 COATS BONE WHITE FLAT
 TRIM & DOORS, 1 COAT PRIMER, BRITE WHITE SEMI GLOSS, 2 COATS

Revisions	Date
BID SET	3.16.15
BID SET	4.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16


© ARIS CRIST AIA 2015. THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE: 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 PROPOSED FOUNDATION PLAN

Drawn	L.F.O.
Checked	
Date	03/12/15
Scale	As Noted
Job Number	
Sheet	

A-1.0

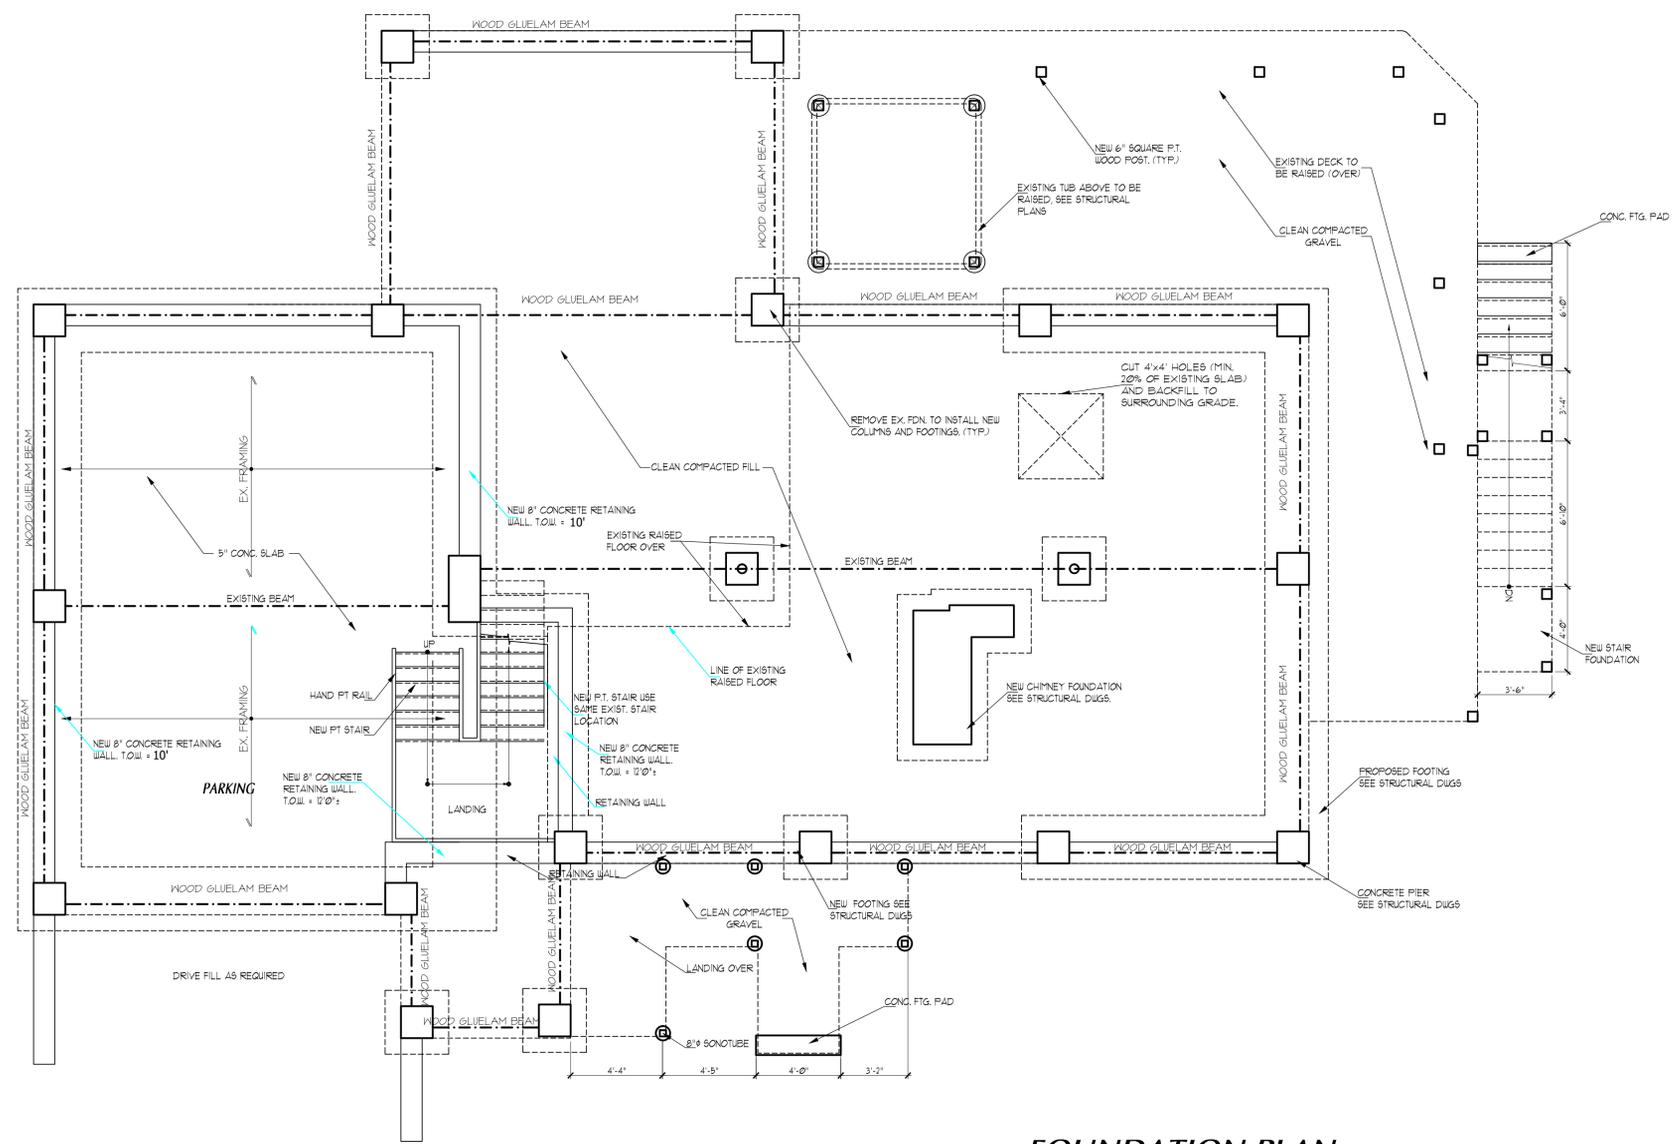

FOUNDATION PLAN
 SCALE: 1/4"=1'-0"

NOT FOR CONSTRUCTION


PAINT SPECS:
 SHERWIN WILLIAMS PRO MAR 400
 CEILINGS, 1 COAT PRIMER, CEILING WHITE 2 COAT, FLAT
 WALLS, 1 COAT PRIMER, 2 COATS BONE WHITE FLAT
 TRIM & DOORS, 1 COAT PRIMER, BRITE WHITE SEMI GLOSS, 2 COATS

Revisions	Date
BID SET	3.16.15
BID SET	4.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16

© ARIS CRIST AIA 2015. THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE: 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 PROPOSED FIRST FLOOR PLAN

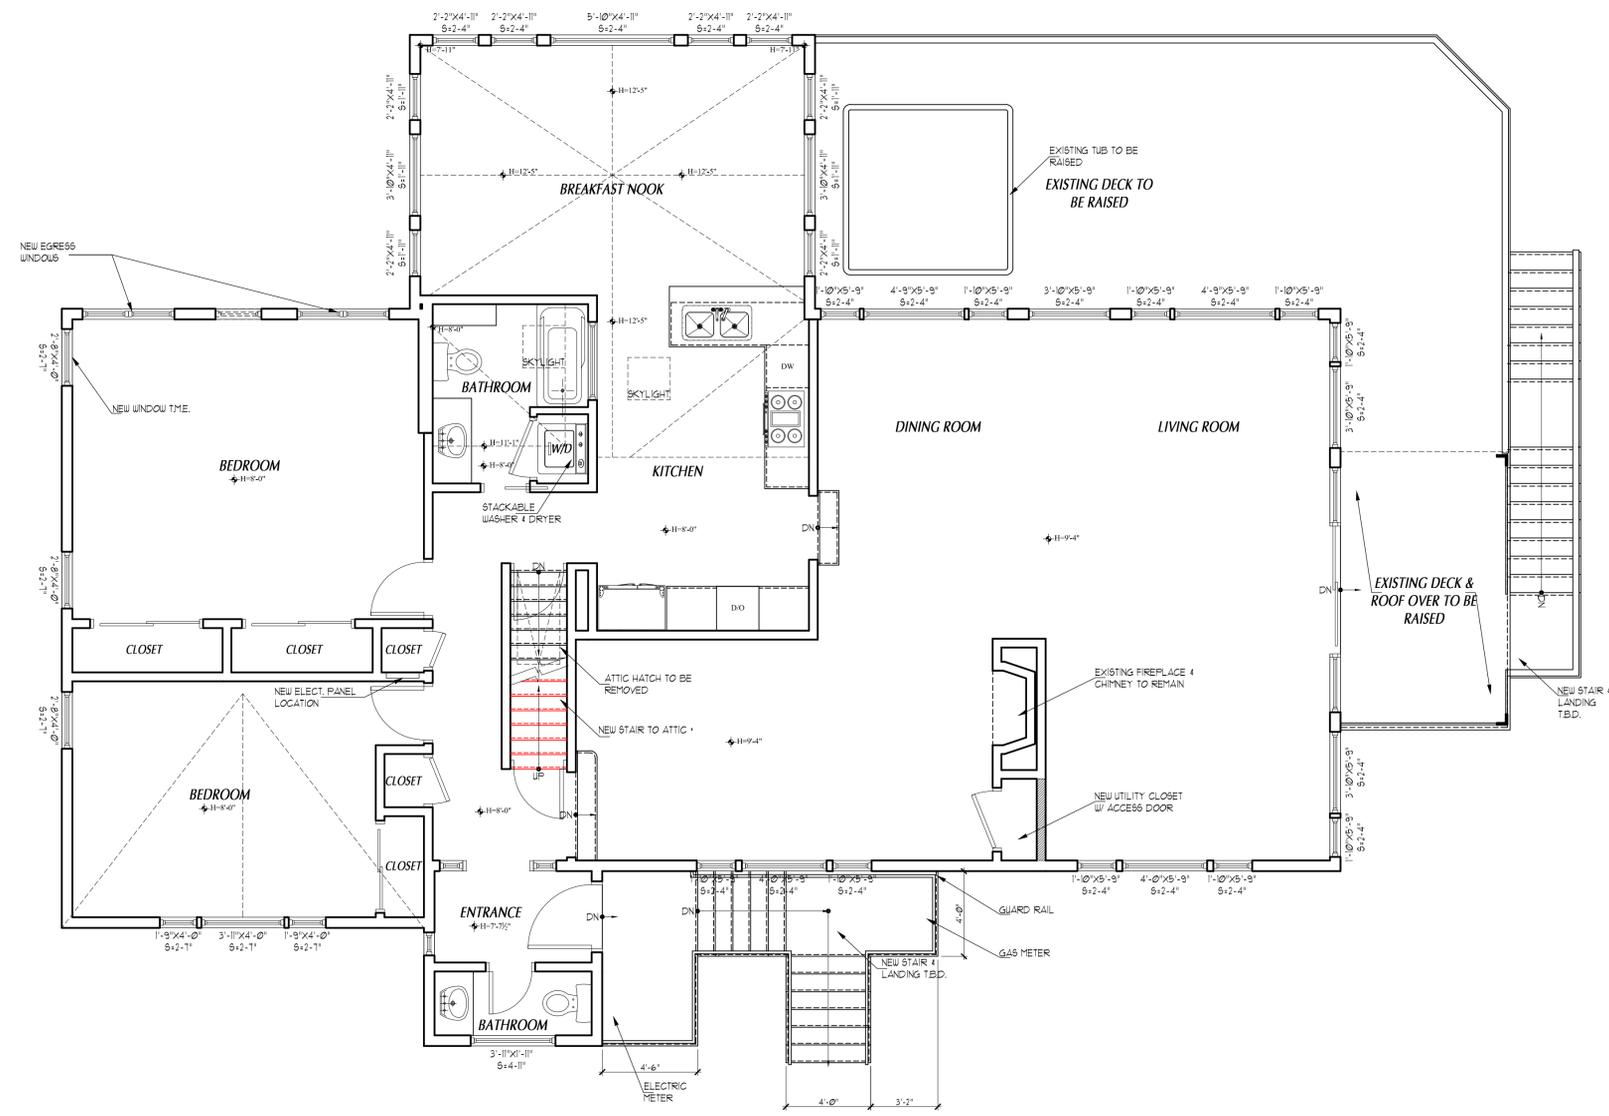

PROPOSED FIRST FLOOR PLAN
 SCALE: 1/4"=1'-0"

[Solid Line] EXISTING WALL TO REMAIN
 [Dashed Line] NEW WALL
 [Dotted Line] WALL TO BE DEMOLISHED
 * AS PER APPROVAL BY THE STAMFORD BUILDING INSPECTOR

NOT FOR CONSTRUCTION

Drawn	L.F.O.
Checked	
Date	03/12/15
Scale	As Noted
Job Number	
Sheet	A-2.0


PAINT SPECS:
 SHERWIN WILLIAMS PRO MAR 400
 CEILINGS, 1 COAT PRIMER, CEILING WHITE 2 COAT, FLAT
 WALLS, 1 COAT PRIMER, 2 COATS BONE WHITE FLAT
 TRIM & DOORS, 1 COAT PRIMER, BRITE WHITE SEMI GLOSS, 2 COATS

Revisions	Date
BID SET	3.16.15
BID SET	4.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16

© ARIS CRIST AIA 2015. THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE: 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 PROPOSED ATTIC PLAN

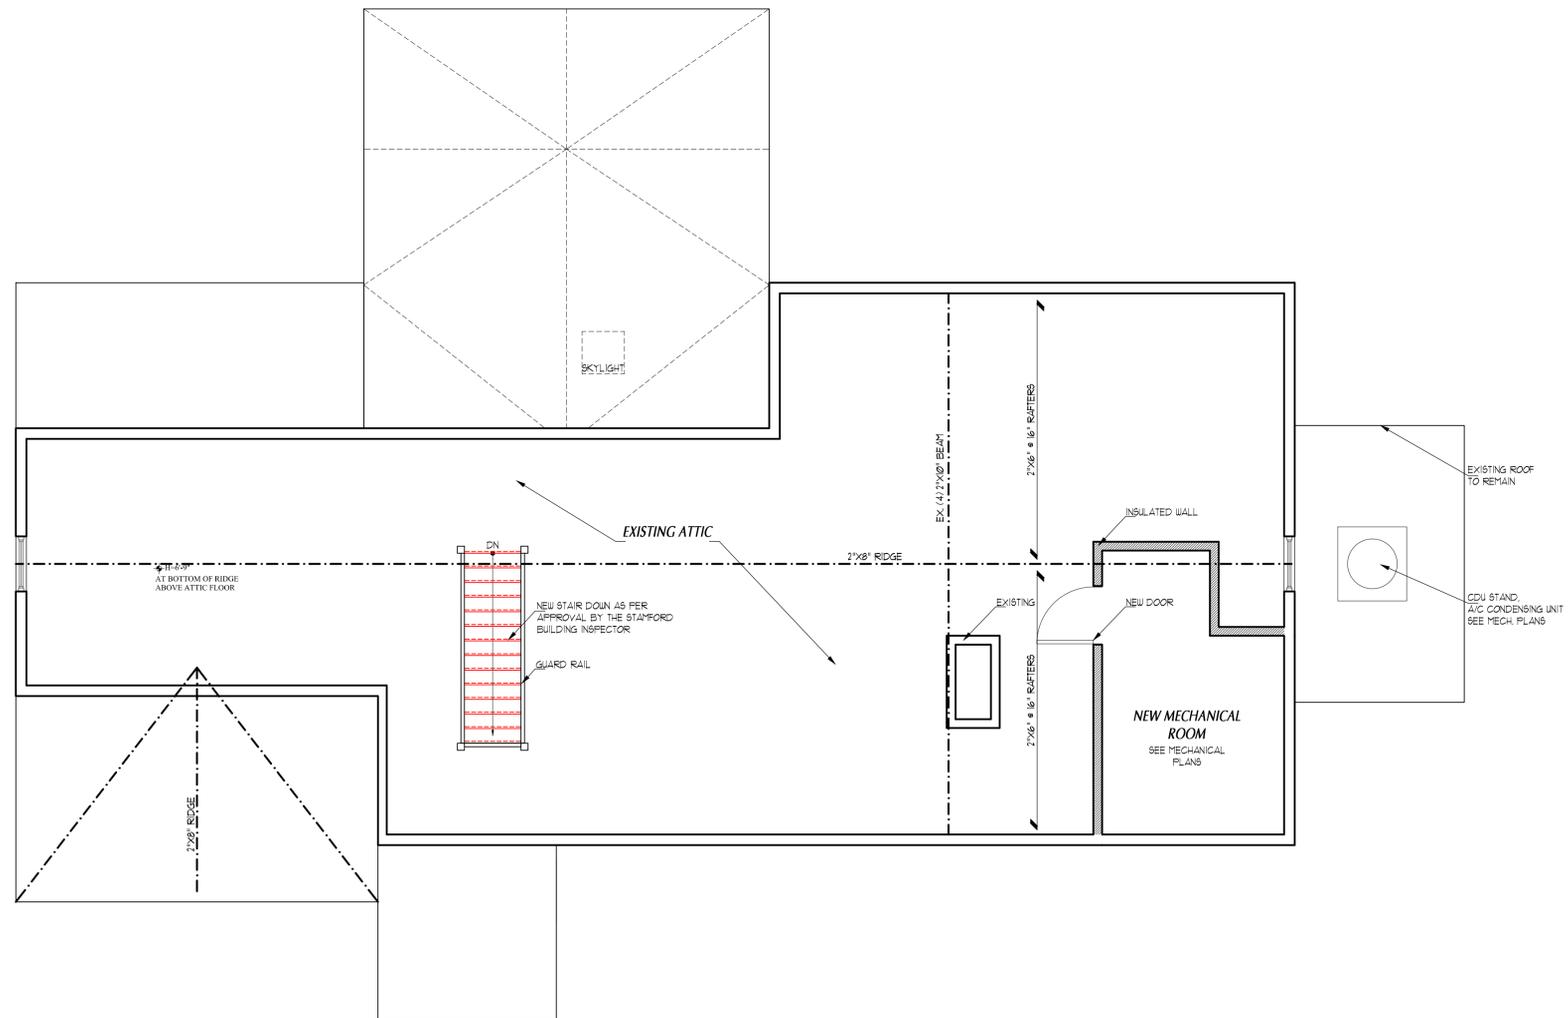

ATTIC PLAN
 SCALE: 1/4"=1'-0"

[Solid line] EXISTING WALL TO REMAIN
 [Dashed line] NEW WALL
 [Dotted line] WALL TO BE DEMOLISHED

AS PER APPROVAL BY THE STAMFORD BUILDING INSPECTOR

NOT FOR CONSTRUCTION

Drawn	L.F.O.
Checked	
Date	03/12/15
Scale	As Noted
Job Number	
Sheet	

A-3.0

Revisions	Date
BID SET	3.16.15
BID SET	4.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16


© ARIS CRIST AIA 2015. THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661


RESIDENCE: 2097
3 WEED CIRCLE
STAMFORD CT, 06902
 PROPOSED ELEVATIONS

L.F.O.	Drawn
	Checked
	Date
06/03/14	Scale
As Noted	Job Number
	Sheet

A-4.0

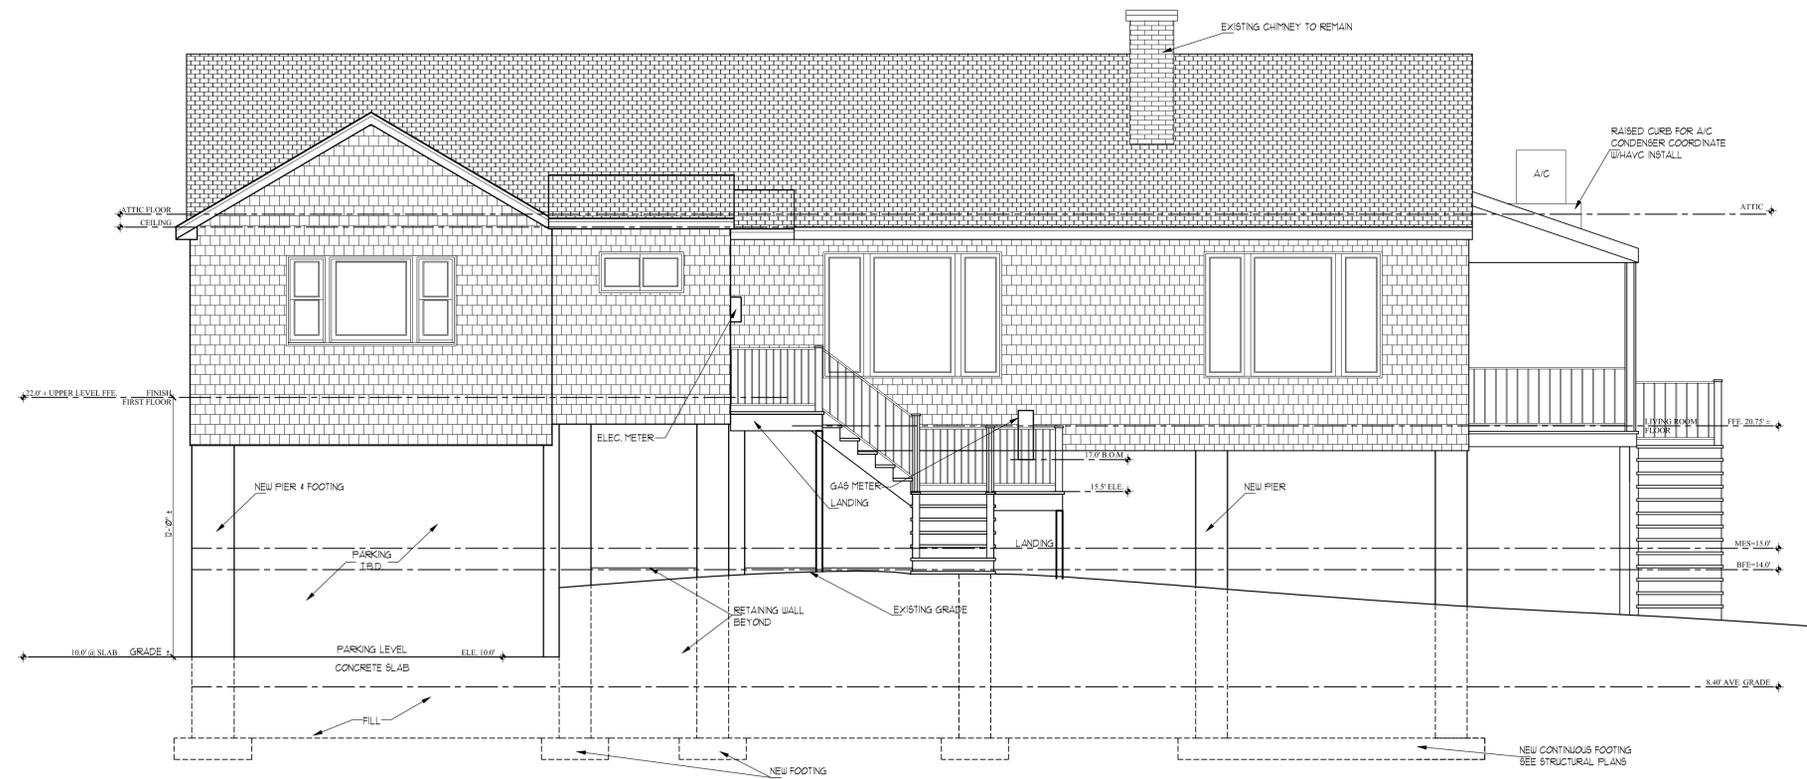

PROPOSED FRONT ELEVATION
 SCALE: 1/4"=1'-0"

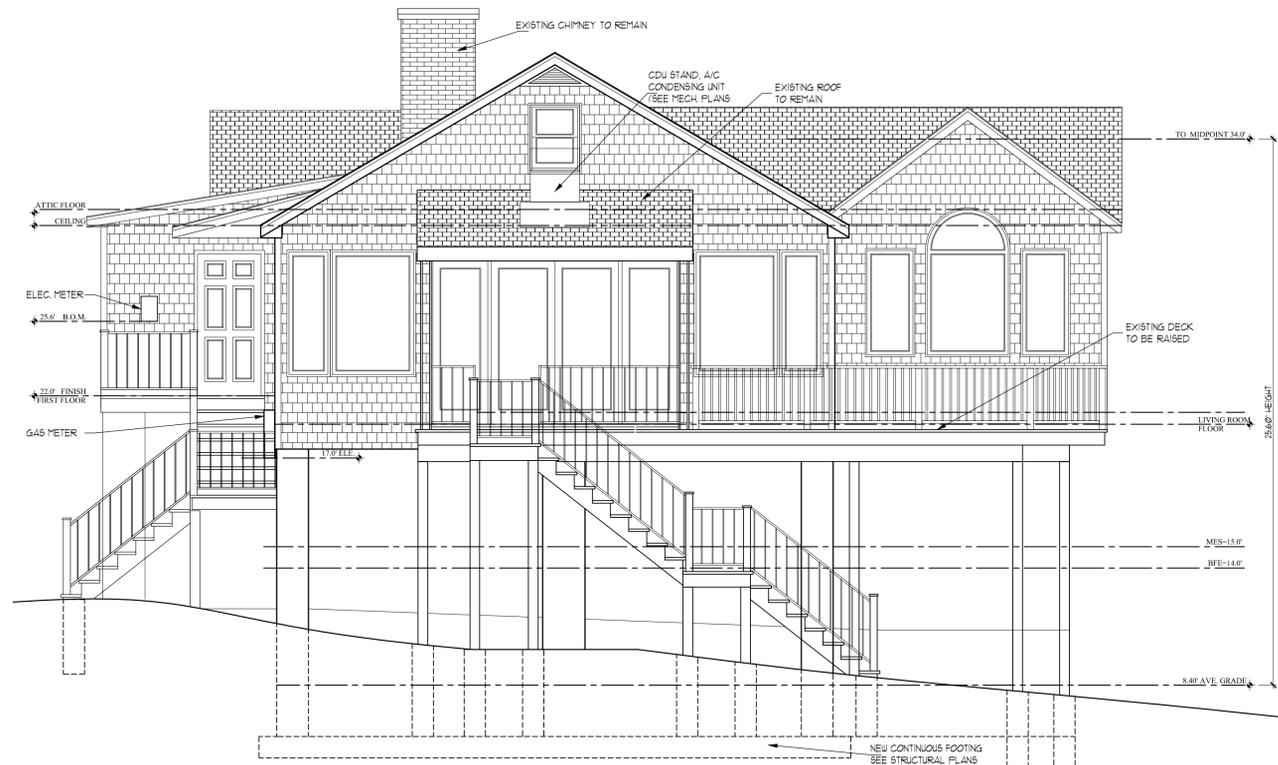

PROPOSED RIGHT SIDE ELEVATION
 SCALE: 1/4"=1'-0"

NOT FOR CONSTRUCTION

Revisions	Date
BID SET	3.16.15
BID SET	4.24.15
For Stamford Eng. Review	10.9.15
For Stamford Eng. Review	10.28.15
Revision	01.12.16


© ARIS CRIST AIA 2015. THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661


RESIDENCE: 2097
3 WEED CIRCLE
STAMFORD CT, 06902
 PROPOSED ELEVATIONS

L.F.O.	
Drawn	
Checked	
Date	06/03/14
Scale	As Noted
Job Number	
Sheet	

A-5.0

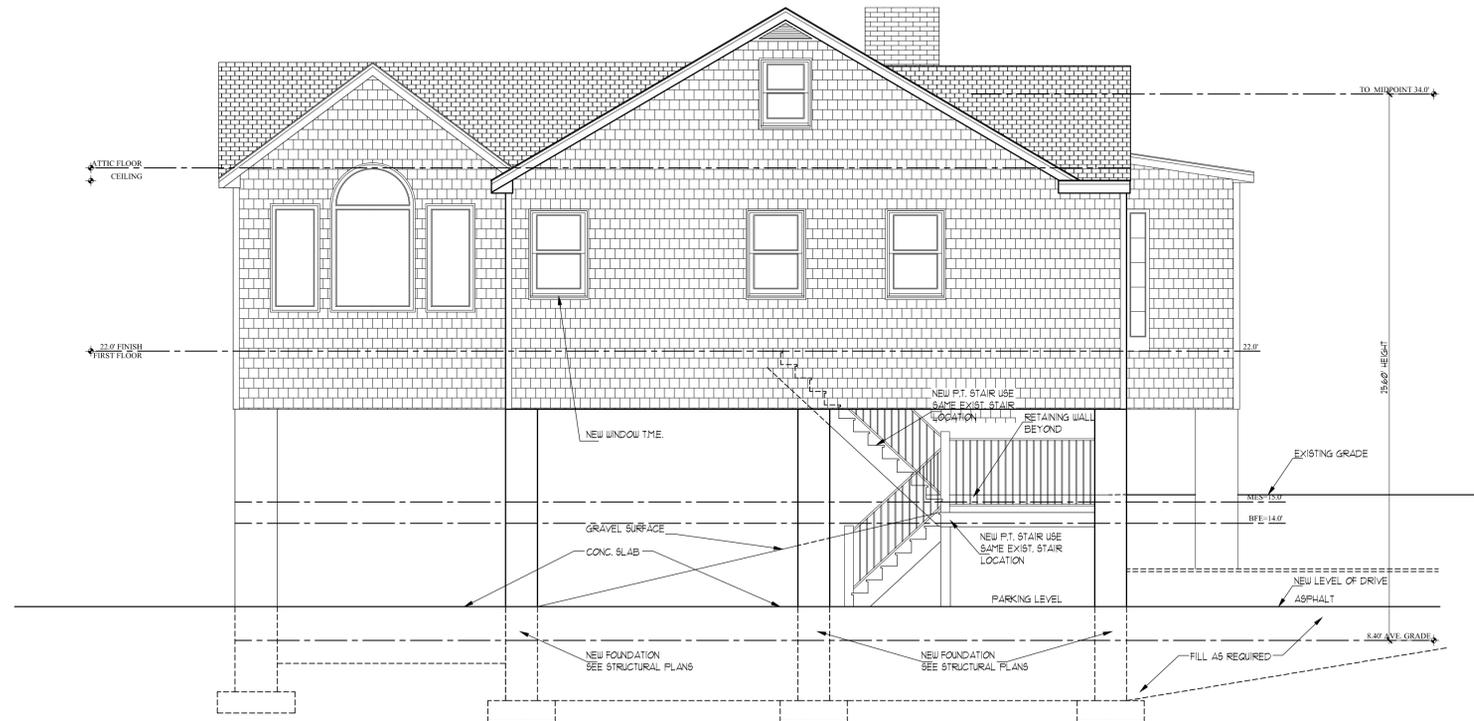

PROPOSED LEFT SIDE ELEVATION
 SCALE: 1/4"=1'-0"

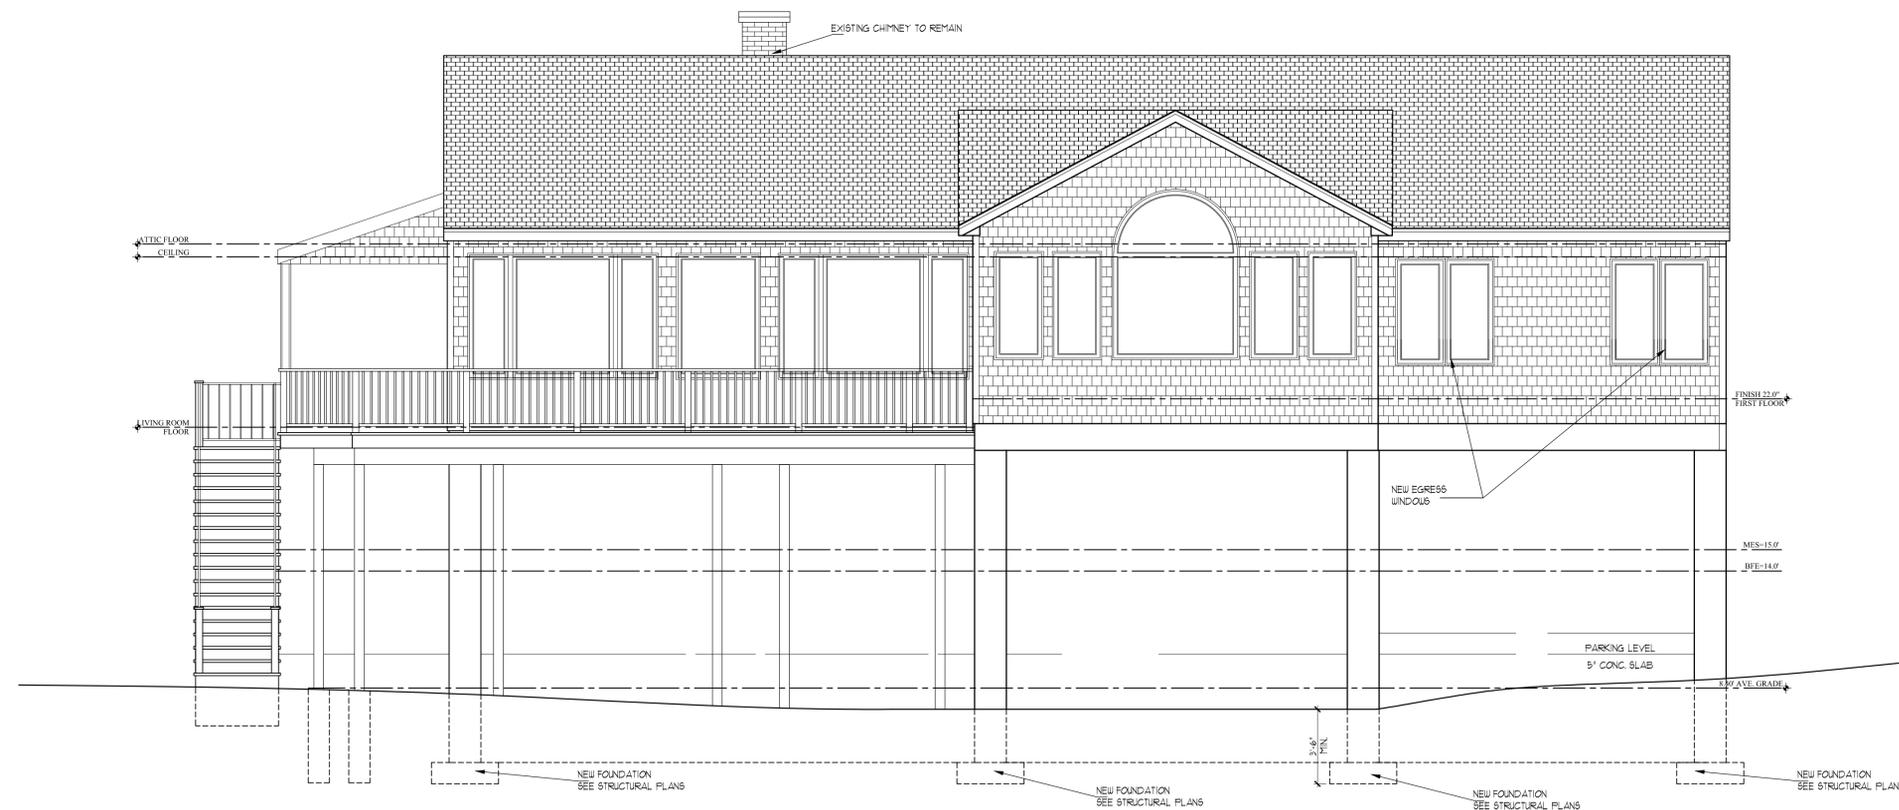

PROPOSED REAR ELEVATION
 SCALE: 1/4"=1'-0"

NOT FOR CONSTRUCTION

GENERAL NOTES:

- THE PURPOSE OF THE WORK IS TO RAISE THE EXISTING HOUSE AT 3 WEED CIRCLE IN STAMFORD, CT 6 FEET.
- THE WORK SHOWN ON THESE DRAWINGS HAS BEEN DESIGNED IN ACCORDANCE WITH THE STRUCTURAL REQUIREMENTS OF THE 2005 CONNECTICUT STATE RESIDENTIAL BUILDING CODE WHICH IS THE 2009 INTERNATIONAL RESIDENTIAL CODE (IRC), EXCEPT AS AMENDED, ALTERED OR DELETED BY THE PROVISIONS OF THE 2013 CONNECTICUT AMENDMENT.
- THE STRUCTURAL COMPONENTS HAVE BEEN DESIGNED FOR THE FOLLOWING LIVE LOADS:

FLOOR LIVE LOADS:	
ROOMS OTHER THAN SLEEPING ROOMS	40 PSF
SLEEPING ROOMS	30 PSF
STAIRS	40 PSF
DECKS	40 PSF
- ATTIC LIVE LOAD:
 WITH STORAGE, ROOF SLOPE EXCEEDS 3:12 20 PSF
 WITHOUT STORAGE, ROOF SLOPE 3:12 OR LESS 10 PSF
- ROOF SNOW LOAD:
 GROUND SNOW LOAD (Pg) 30 PSF
- WIND DESIGN DATA:
 BASIC WIND SPEED (3-SECOND GUST) 110 MPH
 EXPOSURE C
 FLOOD ZONE: VE-14
 - REFER TO WAVE ANALYSIS CALCULATIONS BY R.A.C.E. DATED JUNE 12, 2015.
 - UNDERSIDE OF HOUSE FREE FROM OBSTRUCTIONS AND STAIRS/LANDINGS DESIGNED AS PER FEMA BULLETIN NO. 5
 - THE FLOOD-PROOFING METHODS ARE DESIGNED IN ACCORDANCE WITH THE "1000 PRONE AREA REGULATIONS OF THE CITY OF STAMFORD" (SECTION 7.1 OF THE ZONING REGULATIONS) AND ARE CAPABLE OF WITHSTANDING THE FLOOD DEPTHS, PRESSURES, VELOCITIES, IMPACT AND UPLIFT FORCES AND OTHER FACTORS ASSOCIATED WITH THE BASE FLOOD.
- ALL STRUCTURAL WORK SHOWN OR SPECIFIED ON THESE DRAWINGS IS SUBJECT TO REVIEW BY THE STRUCTURAL ENGINEER OF RECORD. ASPECTS OF THE WORK FOUND TO BE DEFECTIVE BECAUSE IT DOES NOT MEET THE REQUIREMENTS SHOWN OR SPECIFIED SHALL BE CORRECTED BY THE CONTRACTOR AT NO EXTRA COST TO THE OWNER AS DIRECTED BY THE ENGINEER.
- THIS WORK HAS BEEN DESIGNED TO BE SELF-SUPPORTING AND STABLE AFTER THE CONSTRUCTION HAS BEEN COMPLETED. THE STABILITY OF THE FOUNDATION PRIOR TO COMPLETION IS SOLELY THE RESPONSIBILITY OF THE CONTRACTOR. THIS RESPONSIBILITY EXTENDS TO ALL ASPECTS OF THE CONSTRUCTION ACTIVITY INCLUDING, BUT NOT LIMITED TO, JOBSITE SAFETY, ERECTION METHODS, ERECTION SEQUENCE, TEMPORARY BRACING AND SHORING, USE OF EQUIPMENT AND SIMILAR CONSTRUCTION PROCEDURES. REVIEW OF CONSTRUCTION BY THE ENGINEER IS FOR CONFORMANCE WITH THE DESIGN ASPECTS ONLY, NOT TO REVIEW THE CONTRACTOR'S CONSTRUCTION PROCEDURES. LACK OF COMMENT ON THE PART OF THE ENGINEER WITH REGARD TO CONSTRUCTION PROCEDURES IS NOT TO BE INTERPRETED AS APPROVAL OF THOSE PROCEDURES.
- SHOP DRAWINGS SUBMITTALS TO THE ENGINEER FOR APPROVAL ARE REQUIRED FOR:
 A. CONCRETE REINFORCEMENT
 FABRICATION AND/ OR DELIVERY TO THE SITE OF THESE MATERIALS PRIOR TO RECEIPT OF APPROVAL BY THE ENGINEER IS SOLELY AT THE CONTRACTOR'S OWN RISK.
- SOME DETAILS OF THE WORK MAY BE SHOWN ON THE ARCHITECTURAL DRAWINGS. A CAREFUL REVIEW AND STUDY OF THESE DETAILS ARE NECESSARY BEFORE THE FULL WORK CAN BE COMPREHENDED.
- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, ELEVATION, AND ANGLES WITH ARCHITECTURAL DRAWINGS AND EXISTING CONDITIONS BEFORE PROCEEDING WITH ANY WORK.
- DO NOT SCALE DRAWINGS.

FOUNDATION AND EXCAVATION NOTES:

- THE FOUNDATIONS HAVE BEEN DESIGNED TO REST ON INORGANIC, UNDISTURBED SOIL OR COMPACTED GRANULAR FILL HAVING A PRESUMPTIVE BEARING VALUE OF 1500 PSF. THIS IS BASED ON SOILTESTING, INC.'S SOIL BORING REPORT DATED FEBRUARY 3, 2015. SUCH BEARING STRATA IS ANTICIPATED AT THE BOTTOM OF FOOTING ELEVATIONS NOTED ON THE FOUNDATION PLAN. ALL BEARING STRATA SHALL BE REVIEWED BY THE ENGINEER PRIOR TO PLACING CONCRETE IN ORDER TO VERIFY THE PRESUMPTIVE BEARING VALUE. NO FOUNDATIONS SHALL BEAR ON FILL.
- THE SLAB-ON-GRADE SUB-BASE AND FILL UNDER HOUSE AND DECK SHALL BE CRUSHED STONE PASSING A 2" SIEVE AND WITH LESS THAN 10% BY WEIGHT, PASSING A #100 SIEVE.
- THE BOTTOM OF EXTERIOR FOOTINGS NOT ON SOLID ROCK SHALL BE AT LEAST 3'-6" BELOW FINISHED GRADE. THE SURFACE OF THE SOIL BELOW ALL FOOTINGS SHALL BE MECHANICALLY COMPACTED PRIOR TO SETTING FOOTING FORMS. FOOTINGS ON LEDGE SHALL REST ON BROOM CLEAN SOLID ROCK. IF THE SLOPE OF THE ROCK SURFACE EXCEEDS 1 ON 6, THE FOOTING SHALL BE DOWELED TO THE LEDGE WITH 3/4" STEEL RODS DRILLED 10" INTO THE ROCK SURFACE AT 2'-0" O.C.
- NOT UNDERMINING EXISTING OR NEWLY PLACED FOUNDATIONS BY EXCAVATING WITHIN A ZONE DIRECTLY BELOW THESE FOUNDATIONS AND EXTENDING DOWN AND OUTWARDS AT A 45 ANGLE.
- PROTECT ALL SOIL UNDER FOUNDATIONS FROM FREEZING DURING CONSTRUCTION. DO NOT POUR CONCRETE ON FROZEN SOIL.
- KEEP FOUNDATION EXCAVATIONS FREE FROM WATER AT ALL TIMES.
- IF STANDING WATER IS PRESENT IN THE FOOTING EXCAVATION, A 4" TO 6" THICK LAYER OF 3/4" CRUSHED STONE SHALL BE COMPACTED INTO THE BOTTOM OF THE EXCAVATION AND DOWELING METHODS SHALL BE USED THAT WILL UNDERMINE THE BEARING OF ANY ADJACENT FOOTINGS.
- IN PLACING AND COMPACTING FILL AND BACKFILL MATERIAL, DO NOT DAMAGE NOR DISPLACE CONCRETE WORK ALREADY IN PLACE BY CONTACT FROM COMPACTOR MACHINERY OR SUBJECTING IT TO OVERTURNING FROM HEAVY COMPACTING LOADINGS, OR ANY OTHER CAUSE. AT FROST WALLS BRING FILL AGAINST SUCH CONCRETE AT THE SAME RATE AS THE REMAINDER OF FILL COMPACTING UNIFORMLY ON BOTH SIDES USING HAND OPERATED TAMPERS. IN BASEMENT AND CRAWL SPACE AREAS DO NOT BACKFILL AGAINST WALLS UNTIL THE FLOOR OR ROOF DECK BEARING ON THE WALLS HAS BEEN INSTALLED AND FULLY ATTACHED TO THE TOP OF THE FOUNDATION.
- INVERTS OF FOOTING DRAIN, IF REQUIRED, ARE TO BE SET A MINIMUM OF 2" ABOVE THE BOTTOM OF ADJACENT FOOTINGS.
- USE LEAN CONCRETE (f'c = 1500 PSI) OVER-EXCAVATION OF FOOTINGS.
- WHERE FOOTINGS ARE IN CLOSE PROXIMITY OF SUB-SURFACE PIPING, BOTTOM OF FOOTINGS SHALL BE AT LEAST 8" BELOW ELEVATION OF PIPING, UNLESS OTHERWISE SHOWN ON THE DRAWINGS.
- EXISTING UTILITIES: LOCATE EXISTING UNDERGROUND UTILITIES IN AREAS OF EXCAVATION WORK. PROVIDE ADEQUATE MEANS OF SUPPORT AND PROTECTION DURING EARTHWORK OPERATIONS.

CONCRETE NOTES:

- STRUCTURAL CONCRETE WORK SHALL CONFORM TO ALL THE REQUIREMENTS OF ACI 318-08, "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE" IN ITS ENTIRETY. CERTAIN PORTIONS OF THIS SPECIFICATION ARE PRESENTED HERE ONLY FOR CLARIFICATION AND THE CONTRACTOR'S CONVENIENCE AND ARE NOT INTENDED TO REPLACE OR AMEND THIS SPECIFICATION.
- CONCRETE SHALL BE NORMAL WEIGHT AND DEVELOP A MINIMUM STRENGTH IN 28 DAYS AS FOLLOWS:

LOCATION	STRENGTH	MAX. WATER/CEMENTitious (W/C) RATIO
FOOTINGS	3000 PSI	0.50
PIERS, RETAINING WALLS & EXTERIOR SLABS	4500 PSI	0.45
- PORTLAND CEMENT SHALL BE TYPE I OR TYPE II AND CONFORM TO ASTM C150.
- OTHER CEMENTitious MATERIAL, SUCH AS FLYASH OR GROUND GRANULATED BLAST-FURNACE SLAG MAY BE BLENDED WITH CEMENT FOR USE IN THE CONCRETE MIX. FLYASH SHALL CONFORM TO ASTM C618 AND MAY REPLACE CEMENT IF THE FOLLOWING RANGES FOR THE 2 CLASSES OF FLYASH CLASS C, 20 TO 35% CLASS F, 15 TO 25%. GROUND GRANULATED BLAST-FURNACE SLAG SHALL CONFORM TO ASTM C989 AND MAY NOT EXCEED 50% OF TOTAL WEIGHT OF CEMENTitious MATERIALS.
- COARSE AGGREGATE SHALL BE 3/4" AND CONFORM TO ASTM C33.
- REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 60. ALL REINFORCEMENT SHALL BE GALVANIZED, THE FOLLOWING WILL APPLY:
 THE BAR REINFORCEMENT SHALL BE CLASS 1 GALVANIZED AFTER BAR FABRICATION, IN ACCORDANCE WITH ASTM A767, ZINC-COATED (GALVANIZED) STEEL BARS FOR CONCRETE REINFORCEMENT, WITH AN AVERAGE COATING THICKNESS FROM A MINIMUM OF 3 TESTS, OF BE 3.5 OZ/SF OR 6 MILS.
 ZINC-RICH PAINT USED FOR THE FIELD REPAIR OF GALVANIZED COATINGS SHALL MEET THE FOLLOWING REQUIREMENTS:
 1. ONE APPLICATION OF THE MATERIAL SHALL PROVIDE A DRY COATING THICKNESS OF AT LEAST 2.0 MILS.
 2. THE APPLIED COATING SHALL PROVIDE BARRIER PROTECTION AND SHALL PREFERABLY BE ANODIC TO STEEL.
 3. APPLICATION OF THE COATING MATERIAL SHALL BE POSSIBLE UNDER SHOP OR FIELD CONDITIONS.
 4. THE DRIED FILM SHALL HAVE A MINIMUM ZINC DUST CONTENT EQUAL TO 94% (BY WEIGHT).
- THE BRAND OF MATERIAL USED SHALL BE APPROVED BY THE GALVANIZER, AND SHALL BE COMPATIBLE WITH THE GALVANIZING, AND INERT IN CONCRETE.
- FIELD REPAIR - GALVANIZED COATING. THE CONTRACTOR SHALL BE REQUIRED TO FIELD REPAIR ANY DAMAGE TO THE GALVANIZED COATING AND TO REPLACE BARS EXHIBITING SEVERELY DAMAGED COATINGS. THESE REPAIR PROCEDURES ARE ALLOWED ONLY FOR THOSE FIELD REPAIRS DIRECTED BY THE ENGINEER. ALL REPAIRS SHALL BE MADE AT THE CONTRACTOR'S COST. THE GALVANIZED COATING IS TO BE REPAIRED WITH A ZINC-RICH PAINT BY THE FOLLOWING METHOD:
 1. CLEAN THE DAMAGED AREA BY WIRE BRUSHING. THE SURFACE SHALL ALSO BE CLEAN, DRY AND FREE OF OIL, GREASE, FLUX RESIDUE, CORROSION PRODUCTS, AND ANY OTHER FOREIGN SUBSTANCE.
 2. USING A MINIMUM OF TWO COATS, AND THE METHODS RECOMMENDED BY THE MANUFACTURER OF THE ZINC-RICH PAINT, SPRAY OR BRUSH APPLY THE ZINC-RICH PAINT TO THE AREA IN A MANNER TO ACHIEVE THE APPLICABLE ASTM ADHERENCE AND QUALITY REQUIREMENTS OF THE ORIGINAL COATING, AND A MINIMUM DRY FILM THICKNESS OF 4 MILS.
- NO WELDING OF REINFORCING WILL BE PERMITTED.
- NO ADMIXTURES ARE PERMITTED WITHOUT THE ENGINEER'S WRITTEN PERMISSION. CONCRETE EXPOSED TO THE WEATHER SHALL CONTAIN 5% ± 1% ENTRAINED AIR.
- GROUT FOR USE UNDER STEEL PLATES SHALL BE CEMENT-BASED, NON-SHRINK, NON-METALLIC GROUT HAVING A MINIMUM 7 DAY STRENGTH OF 5000 PSI, SUCH AS FIVE STAR GROUT MANUFACTURED BY THE U.S. GROUT CORPORATION.
- THE FOLLOWING CONCRETE COVER SHALL BE PROVIDED FOR REINFORCEMENT, UNLESS OTHERWISE NOTED ON PLANS:

CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH:	COVER (INCHES)
3	
CONCRETE EXPOSED TO EARTH OR WEATHER:	
#5 THROUGH #18 BARS:	2
#5 BAR AND SMALLER:	1 1/2
CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND:	
SLABS, WALLS, JOISTS:	
#11 BAR AND SMALLER	3/4
BEAMS, COLUMNS - PRIMARY REINFORCEMENT, TIES, STRIPPUS, SPIRALS	1 1/2

- THE CONTRACTOR SHALL BE RESPONSIBLE FOR LIMITING POURS TO MINIMIZE SHRINKAGE CRACKING. IN GENERAL, WALLS SHALL NOT BE POURED IN CONTINUOUS LENGTHS EXCEEDING 30 FEET AND SLABS NOT EXCEEDING 20 FEET WITHOUT CONTROL JOINTS. THE LOCATION AND CONFIGURATION OF JOINTS EXPOSED TO VIEW SHALL BE COORDINATED WITH THE ARCHITECT.
- MINIMUM ANCHOR BOLT REQUIREMENTS FOR ATTACHMENT OF SUPERSTRUCTURE TO FOUNDATION SHALL BE AS FOLLOWS:

CRAWL SPACES, SLABS ON GRADE:	1/2" x 4" AT 6'-0" O.C. MAX SPACING
FULL HEIGHT BASEMENT:	3/4" x 4" AT 4'-0" O.C. MAX SPACING

- EMBED ANCHOR BOLTS A MINIMUM OF 15" INTO MASONRY, 7" INTO CAST CONCRETE. INSTALL BOLTS WITHIN 1'-0" OF ALL CORNERS AT ALL WALLS. ALL SILL PIECES SHALL HAVE A MINIMUM OF TWO ANCHOR BOLTS.

CONCRETE NOTES CONTINUED:

- SIZES AND LOCATIONS OF ALL REQUIRED EMBEDDED ITEMS FOR ALL TRADES SUCH AS ANCHOR BOLTS, PIPING SLEEVES, HOLLOW ANCHORS, ETC. SHALL BE COORDINATED BY THE GENERAL CONTRACTOR WITH OTHER TRADES.
- CONCRETE FORMWORK SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 6, ACI 318. FABRICATION AND PLACEMENT OF REINFORCEMENT SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 5, ACI 318. CONSTRUCTION JOINTS AND EMBEDDED ITEMS, SUCH AS PIPING SLEEVES, SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 6, ACI 318. THE PRODUCTION OF CONCRETE SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 5, ACI 318.
- THE CONVEYANCE AND PLACEMENT OF THE CONCRETE SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 5, ACI 318. MECHANICAL VIBRATORS ARE TO BE USED TO CONSOLIDATE THE FRESHLY CAST CONCRETE AROUND THE REINFORCING AND AGAINST FORM SURFACES AND TO PREVENT THE FORMATION OF AIR OR STONE POCKETS, HONEYCOMBS, PITTING OR PLANES OF WEAKNESS. HOWEVER, CARE MUST BE USED TO AVOID OVER VIBRATION THAT CAN LEAD TO AGGREGATE SEGREGATION.
- THE INSTALLATION OF SLABS SHALL CONFORM TO THE REQUIREMENTS OF ACI 302.1R-04. INTERIOR FINISH SLAB SURFACES ARE TO HAVE A CLASS A STEEL TROWEL FINISH. EXTERIOR FINISH SLAB SURFACES FORMING THE SUBSTRATE FOR HUD JOBS ARE TO HAVE A CLASS C SCRATCHED SURFACE. EXTERIOR SLAB SURFACES ARE TO HAVE A CLASS B TOLERANCE WITH THE FINISH AS SPECIFIED ON THE ARCHITECTURAL DRAWINGS.
- THE CURING AND PROTECTION OF CONCRETE SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 5, ACI 318. CONCRETE SLABS SHALL BE PROTECTED FROM LOSS OF SURFACE FINISH BY THE INSTALLATION OF A CURING COMPOUND CONFORMING TO ASTM C309 OR CONSTANTLY WETTED BURLAP. CURING COMPOUNDS SHALL BE COMPATIBLE WITH ANY INTENDED FLOORING OVERLAY. DO NOT INSTALL FINISH FLOORING UNTIL SLAB HAS ADEQUATELY DRIED PER THE FLOORING MANUFACTURER'S SPECIFICATIONS.
- COLD WEATHER CONCRETE PLACEMENT: IF COLD WEATHER CONCRETING CONDITIONS EXIST AS DEFINED BY A PERIOD OF MORE THAN THREE DAYS WHEN THE AVERAGE OUTDOOR TEMPERATURE, (HIGH + LOW)/2, IS LESS THAN 40° F, THE PROCEDURES OUTLINED IN ACI 308.1 STANDARD SPECIFICATION FOR "COLD WEATHER CONCRETING" SHALL BE UTILIZED.
- HOT WEATHER CONCRETE PLACEMENT: MAINTAIN CONCRETE TEMPERATURE BELOW 90° F AT TIME OF PLACEMENT AND COMPLY WITH ACI 301.
- THE FOLLOWING SUBMITTALS ARE TO BE MADE TO AND APPROVED BY THE ENGINEER PRIOR TO COMMENCING ANY WORK:
 A. CONCRETE DESIGN MIX FOR EACH STRENGTH OF CONCRETE REQUIRED ATTENDING THAT THE MIXES CAN ATTAIN THE MINIMUM REQUIRED STRENGTHS IN ACCORDANCE WITH CHAPTER 5, ACI 318.
 B. CERTIFICATES OF COMPLIANCE FOR CEMENT, AGGREGATES, AND ADDITIVES.
 C. SHOP DRAWINGS WITH PLANS, ELEVATIONS, SECTIONS AND BENDING SCHEDULES INDICATING ALL REINFORCING AND ACCESSORIES NEEDED IN ADDITION TO ALL PROPOSED CONSTRUCTION JOINTS LOCATIONS.
 FABRICATION AND/ OR DELIVERY TO THE SITE OF THESE MATERIALS PRIOR TO RECEIPT OF AND APPROVAL OF THESE SUBMITTALS IS AT THE CONTRACTOR'S OWN RISK.
- A DESIGNATED TESTING LABORATORY SHALL CONDUCT STRENGTH TEST IN ACCORDANCE WITH THE FOLLOWING PROCEDURES:
 A. MAKE ONE STRENGTH TEST FOR EACH 500 CUBIC YARDS OR FRACTION THEREOF FROM EACH MIX DESIGN OF CONCRETE PLACED IN ANY ONE DAY, EXCEPT THAT IN NO CASE SHALL A GIVEN MIX DESIGN BE REPRESENTED BY LESS THAN FIVE TESTS.
 B. SECURE COMPOSITE SAMPLES IN ACCORDANCE WITH "METHOD OF SAMPLING FRESH CONCRETE" (ASTM C172). EACH STRENGTH TEST SHALL BE OBTAINED FROM A DIFFERENT BATCH OF CONCRETE ON A REPRESENTATIVE, TRULY RANDOM BASIS. WHEN PUMPING OR PNEUMATIC EQUIPMENT IS USED, SAMPLES SHALL BE TAKEN AT THE DISCHARGE END.
 C. MOLD FOUR SPECIMENS FROM EACH SAMPLE IN ACCORDANCE WITH "METHOD OF MAKING AND CURING CONCRETE COMPRESSION AND FLEXURE SPECIMENS IN THE FIELD" (ASTM C31), AND CURE UNDER STANDARD MOISTURE AND TEMPERATURE CONDITIONS, IN ACCORDANCE WITH SECTION 7(4) AND 7(8) OF THE ABOVE ASTM METHOD.
 D. DETERMINE SLUMP OF THE CONCRETE SAMPLE FOR EACH STRENGTH TEST AND DETERMINE CONSISTENCY OF CONCRETE APPEARS TO VARY USING "METHOD OF TEST OF SLUMP OF PORTLAND CEMENT CONCRETE" (ASTM C43).
 E. DETERMINE AIR CONTENT OF NORMAL WEIGHT CONCRETE SAMPLE FOR EACH STRENGTH TEST IN ACCORDANCE WITH EITHER "METHOD OF TEST FOR AIR CONTENT OF FRESHLY MIXED CONCRETE BY PRESSURE METHOD" (ASTM C231) OR "METHOD OF TEST FOR AIR CONTENT OF FRESHLY MIXED CONCRETE BY THE VOLUMETRIC METHOD" (ASTM C173).
 F. TEST THREE SPECIMENS: ONE AT SEVEN DAYS, AND TWO AT 28 DAYS IN ACCORDANCE WITH "METHOD OF TEST FOR COMPRESSIVE STRENGTH OF MOLDED CONCRETE CYLINDERS" (ASTM C39). THE 28 DAY TEST RESULT SHALL BE THE AVERAGE OF THE TWO SPECIMENS. IF THE AVERAGE OF THE TWO SPECIMENS IS LESS THAN THE REQUIRED STRENGTH, TEST THE FOURTH SPECIMEN AT 45 DAYS. WHEN HIGH EARLY STRENGTH IS REQUIRED, TWO SPECIMENS SHALL BE TESTED AT SEVEN DAYS.

CONNECTIONS TO EXISTING MASONRY OR CAST-IN-PLACE CONCRETE:

- ALL PROPRIETARY ANCHORING SYSTEMS (EXPANSION, ADHESIVE ANCHORING SYSTEMS, ETC.) TO BE INSTALLED INTO EXISTING CONCRETE AND MASONRY ELEMENTS ARE TO BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS FOR DRILLING AND CLEANING OF HOLES, FOR SPACING AND EDGE DISTANCE REQUIREMENTS, AND FOR THE UTILIZATION OF SUPPLEMENTAL COMPONENTS FOR THE ANCHORING SYSTEMS SUCH AS SCREEN TUBES, DOWELING ADHESIVES, ETC.
- UNLESS NOTED ON PLAN, CONNECTIONS TO EXISTING SOLID CAST-IN-PLACE CONCRETE SHALL BE MADE USING SIMPSON "SET-XP" EPOXY ANCHORING SYSTEM, HILTI "HIT-RE 200-SID" ADHESIVE ANCHORING SYSTEM, HILTI "HIT-HY 150 MAX SD" ADHESIVE ANCHORING SYSTEM OR EQUAL AS APPROVED BY THE ENGINEER. SIZE, EMBEDMENT, SPACING, AND EDGE DISTANCES OF ANCHORS AND REINFORCING BARS SHALL BE AS INDICATED ON THE DRAWINGS.
- FOR CONNECTIONS TO EXISTING CONCRETE CONTRACTOR MUST LOCATE THE POSITION OF EXISTING REINFORCING BARS WITH AN R-METER OR PILET HOLES PRIOR TO THE INSTALLATION OF ANCHORS. NOTIFY ENGINEER OF FIELD CONFLICTS PRIOR TO INSTALLATION.

STRUCTURAL STEEL NOTES:

- DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL SHALL CONFORM TO THE "STEEL CONSTRUCTION MANUAL - THIRTEENTH EDITION" AS ADOPTED BY THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION.
- MATERIALS:
 WIDE FLANGE SHAPES ASTM A992, GRADE 50
 AMERICAN STANDARD SHAPES, ANGLES, PLATES AND BARS ASTM A36
 BOLTS ASTM A307
 WELDING ELECTRODE ASTM E70XX, LOW HYDROGEN
- ALL WELDING SHALL CONFORM TO AMERICAN WELDING SOCIETY'S AWS D1.1 "STRUCTURAL WELDING CODE-STEEL" CODE FOR ARC AND GAS WELDING AND BE PERFORMED BY A CERTIFIED WELDER IN ACCORDANCE WITH A.W.S. STANDARDS.
- ALL FIELD WELDING IS TO BE VISUAL INSPECTED, UNLESS OTHERWISE NOTED, BY AN A.W.S. CERTIFIED WELD INSPECTOR. REPORTS ARE TO BE SENT TO THE ARCHITECT, ENGINEER, AND OWNER IN A TIMELY MANNER.
- STEEL SHALL BE ERECTED TO A TOLERANCE OF NOT MORE THAN 1/4" IN 10'-0" OUT-OF-PLUMB, NOR 1/8" FROM THE REQUIRED ELEVATION.
- ALL STEEL MEMBERS AND BOLTS EXPOSED TO WEATHER SHALL BE CLEANED IN ACCORDANCE WITH THE STEEL STRUCTURES PAINTING COATING SPECIFICATION SP-6 FOR COMMERCIAL BLAST CLEANED AND HOT-DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A123 AND ASTM A153. MINIMUM ACCEPTABLE ZINC COATING WEIGHT SHALL BE 2 OZ./SQ. FT.
- EXISTING STEEL SURFACES TO RECEIVE FIELD WELDS SHALL BE THOROUGHLY CLEANED AND FREE FROM PAINT, RUST, GREASE, ETC.
- CERTIFICATES OF COMPLIANCE SHALL BE SUBMITTED TO THE ENGINEER FOR STRUCTURAL STEEL, BOLTS, NUTS, WASHERS, AND WELD FILLER MATERIAL PRIOR TO THE FABRICATION OF ANY STEEL.

GENERAL WOOD NOTES:

- WOOD DESIGN IS BASED ON THE AF&PA NDS-05 "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION WITH THE 2005 SUPPLEMENT."
- STUD BEARING WALLS, SHEARWALLS, AND ROOF/ FLOOR DECKS SHALL BE FRAMED WITH THE MEMBER SIZES AND/ OR TYPES AT THE SPACINGS SHOWN ON PLAN. THE CONTRACTOR SHALL COORDINATE LOCATIONS OF ALL PLUMBING PIPING, HVAC DUCTING AND RECESSED LIGHTING FIXTURES, ETC. PRIOR TO LAYOUT TO MINIMIZE INTERFERENCE THAT MAY REQUIRE THE ALTERING OR STRENGTHENING OF THE INSTALLED FRAMING.
- ALL WOOD FRAMING IS TO BE STORED ON SITE ABOVE THE GROUND ON "STICKERS" INDOORS OR UNDER TARPS WITH ADEQUATE CLEARANCES TO ALLOW AIR CIRCULATION.
- WALLS SHALL BE INSTALLED STRAIGHT AND PLUMB. FLOORS SHALL BE INSTALLED LEVEL AT THE PROPER ELEVATION. ROOFS SHALL BE INSTALLED AT THE PITCHES INDICATED ON THE ARCHITECTURAL DRAWINGS.
- JOISTS AND RAFTERS SHALL BE INSTALLED DIRECTLY OVER BEARING STUDS UNLESS OTHERWISE DETAILED.
- JOISTS AND RAFTERS SHALL BE SUPPORTED LATERALLY AT EACH SUPPORT BY FULL DEPTH SOLID BLOCKING, EXCEPT WHERE JOISTS ARE SUPPORTED BY A FLUSH HEADER OR NAILED TO A DIM JOIST.
- UNLESS NOTED ON PLAN, PROVIDE A MINIMUM OF TWO STUDS AT EACH END OF ALL FLUSH FRAMED HEADERS OR BEAMS. UNLESS NOTED ON PLAN, PROVIDE ONE JACK STUD AND ONE FULL KING STUD AT EACH END OF ALL DROPPED HEADERS OR BEAMS. POSTS SHALL BE SOLIDLY BLOCKED THROUGH ALL INTERVENING FLOOR DECKS DOWN TO SUPPORTING GIRDERS/ BEAMS OR TOP OF FOUNDATION.
- FLUSH FRAMED CONNECTIONS SHALL BE MADE WITH PREFABRICATED GALVANIZED STEEL HANGERS MADE BY SIMPSON STRONG-TIE COMPANY, INC. OR BY UNITED STEEL PRODUCTS COMPANY (USP) OF WIDTH AND DEPTH APPROPRIATE FOR THE SUPPORTED MEMBER. INSTALL WITH THE TYPE AND QUANTITY OF FASTENERS RECOMMENDED BY THE MANUFACTURER. PREFABRICATED STEEL HANGERS USED IN CONTACT WITH PRESERVATIVE TREATED WOOD SHALL BE HOT DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A123 OR STAINLESS STEEL, TYPE 316, OR HAVE A "TRIPLE ZINC" (ASTM G185) COATING. FASTENERS IN CONTACT WITH PRESERVATIVE TREATED WOOD SHALL BE HOT DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A153 OR STAINLESS STEEL, TYPE 316. DO NOT MIX STAINLESS STEEL AND GALVANIZED STEEL.
- CONTRACTOR SHALL CHOOSE METAL CONNECTOR (SIMPSON, USP, OR APPROVED EQUAL) BASED ON MEMBER REACTIONS SHOWN ON THE DRAWINGS, UNLESS OTHERWISE NOTED. CONTRACTOR TO PROVIDE PRODUCT DATA TO THE ENGINEER FOR APPROVAL.
- STRUCTURAL WOOD FRAMING USED IN EXTERIOR APPLICATIONS OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE SOUTHERN YELLOW PINE NO. 2 OR BETTER, A0 (ALKALINE COPPER QUATERNARY) OR CA (COPPER AZOLATE) PRESERVATIVE TREATED WOOD WITH A RETENTION APPROPRIATE FOR END USE.
- BUILT-UP MEMBERS OF THREE PILES OR LESS SHALL HAVE ADJACENT PILES NAILED TOGETHER WITH TWO ROWS OF NAILS AT 12" O.C. (10d COMMON NAILS FOR 1-1/2" PILES, 12d COMMON NAILS FOR 1-3/4" PILES). BUILT-UP MEMBERS OF MORE THAN 3 PILES SHALL BE ASSEMBLED WITH 1/2" x 9 THRU BOLTS AT 16" O.C. STAGGERED UP AND DOWN WITH 2" CLEARANCE AT TOP AND BOTTOM EDGES.
- EXTERIOR END WALLS OF CATHEDRAL CEILING SPACES SHALL BE FRAMED WITH STUDS RUNNING CONTINUOUSLY (NOT SPLICED) FROM FLOOR TO ROOF, ADDITIONAL FRAMING MAY BE NECESSARY, SEE PLANS.

DIMENSIONED WOOD FRAMING NOTES:

- THE STRUCTURAL WOOD STRESS GRADE STAMPED LUMBER SHALL BE GRADED AS FOLLOWS:
 JOISTS, RAFTERS, STUDS: DOUGLAS FIR-LARCH OR DOUGLAS FIR-LARCH (NORTH), NO. 2
 F_b (BASE) = 850 PSI,
 E = 1,600,000 PSI
- THE DESIGN OF THE DIMENSIONAL LUMBER MEMBERS AND THEIR CONNECTIONS IS BASED ON THE LUMBER HAVING A MOISTURE CONTENT AT THE TIME OF INSTALLATION OF 19% OR LESS.
- JOISTS OR RAFTERS ARE TO BE INSTALLED WITH "CROWN" UP (I.E. POSITIVE CAMBER) AND WITHIN 1/2" OF STRAIGHT, END-TO-END ALIGNMENT.
- NEVERLY DISTORTED (TWISTED, BOWED, CUPPED, CHECKED, ETC.) LUMBER SHALL NOT BE USED.
- JOISTS IN THE TOP OR BOTTOM OF DIMENSIONED LUMBER JOISTS OR RAFTERS SHALL NOT EXCEED ONE-SIXTH THE MEMBER DEPTH AND SHALL NOT BE LOCATED IN THE MIDDLE THIRD OF THE SPAN, UNLESS OTHERWISE NOTED ON PLANS. END NOTCHES SHALL NOT EXCEED ONE-FOURTH THE MEMBER DEPTH, UNLESS OTHERWISE NOTED ON PLANS. BORED HOLES SHALL NOT BE WITHIN 2" OF THE TOP AND BOTTOM OF THE MEMBER AND THEIR DIAMETER SHALL NOT EXCEED ONE-THIRD THE MEMBER DEPTH, UNLESS OTHERWISE NOTED ON PLANS.

PARALLEL STRAND LUMBER (PSL) NOTES:

- PARALLEL STRAND LUMBER SHALL BE "PARALLAM" AS MANUFACTURED BY WEYERHAEUSER. LAMINATED STRAND LUMBER SHALL BE "TIMBERSTRAND" AS MANUFACTURED BY WEYERHAEUSER.
- MINIMUM ALLOWABLE STRESS AND STIFFNESS CHARACTERISTICS SHALL BE AS FOLLOWS:

MATERIAL	F _b	F _c (PAR)	F _c (PER)	F _v	E
1.8E LVL	2,600 PSI	2,510 PSI	750 PSI	285 PSI	1,900,000 PSI
1.8E PSL	2,900 PSI	2,900 PSI	750 PSI	290 PSI	2,000,000 PSI
1.3E LSL	1,700 PSI	1,400 PSI	680 PSI	400 PSI	1,300,000 PSI
1.5E LSL	2,250 PSI	1,950 PSI	775 PSI	400 PSI	1,500,000 PSI
1.55E LSL	2,325 PSI	2,050 PSI	800 PSI	310 PSI	1,550,000 PSI
- MEMBER SIZES SHOWN ON PLAN (WIDTH X DEPTH) SPECIFIED AS LVL MAY BE CONSTRUCTED OF MULTIPLE LVL PILES OR PSL OF THE SPECIFIED DEPTH, FASTENED TOGETHER BY NAILING OR BOLTING AS REQUIRED. MEMBER SIZES FOLLOWED ONLY BY PSL MUST BE INSTALLED AS A SOLID MEMBER, NOT BUILT-UP.
- MEMBERS MAY NOT BE BORED OR NOTCHED WITHOUT WRITTEN PERMISSION FROM THE ENGINEER.

WOOD FASTENERS NOTES:

- WOOD COMPONENTS ARE TO BE FASTENED TOGETHER AS INDICATED IN THE FOLLOWING SCHEDULE UNLESS SPECIFICALLY INDICATED OTHERWISE ON THE PLANS.


BUILDING ELEMENT	NAIL SIZE/TYPE	NUMBER AND LOCATION
FLOOR CONSTRUCTION		
BUILT UP ORDER/BEAM (3 PILES OR LESS):	10d FOR 1.50" PILES 16d FOR 1.75" PILES	2 HORIZ. ROWS (TOP & BOT) 12" O.C. DIRECT
FLOOR JOISTS TO SILL OR GIRDER:	10d COMMON	4 TOE-NAIL
RM/BOX JOIST TO JOIST END:	16d COMMON	3 END DIRECT
BRIDGING TO JOISTS:	8d COMMON 10d COMMON	3 TOE-NAIL OR 2 DIRECT
FLOOR TRUSS CHORD TO SILL OR GIRDER:	16d COMMON	3 DIRECT
BAND JOIST TO TRUSS END:	10d COMMON	3 DIRECT
EDGE FLOOR TRUSS (ROOF CHORD TO SILL):	16d COMMON	8" O.C. DIRECT
EDGE FLOOR JOIST/ TRUSS TO SILL:	10d COMMON	8" O.C. TOE-NAIL
FLOOR SHEATHING:	8d COMMONS	6" o.c. EDGES 10" o.c. OTHER
WALL CONSTRUCTION		
STUD TO SOLE PLATE:	8d COMMON 16d COMMON	4 TOE-NAIL OR 2 END DIRECT
TOP PLATE TO STUD:	16d COMMON	2 END DIRECT
DOUBLE STUDS:	10d COMMON	9" O.C. DIRECT
CORNER STUDS:	16d COMMON	16" O.C. DIRECT
SOLE PLATE TO EXISTING CONCRETE AND MASONRY ELEMENTS ARE TO BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS FOR DRILLING AND CLEANING OF HOLES, FOR SPACING AND EDGE DISTANCE REQUIREMENTS, AND FOR THE UTILIZATION OF SUPPLEMENTAL COMPONENTS FOR THE ANCHORING SYSTEMS SUCH AS SCREEN TUBES, DOWELING ADHESIVES, ETC.	16d COMMON	8" O.C. DIRECT
BLOCKING BETWEEN JOISTS TO TOP PLATE:	10d COMMON	2" O.C. TOE-NAIL
RM/BOX JOIST TO TOP PLATE:	16d COMMON	8" O.C. TOE-NAIL
DOUBLE TOP PLATE:	16d COMMON	16" O.C. DIRECT
DOUBLE TOP PLATE LAPS AT END JOISTS (24" MIN. OFFSET):	16d COMMON	8 DIRECT
DOUBLE TOP PLATE LAPS AT CORNERS AND INTERSECTIONS:	16d COMMON	2 DIRECT
HEADER END TO TRIMMER:	8d COMMON 10d COMMON	2" O.C. TOE-NAIL OR 3" O.C. DIRECT
APA RATED SHEATHING:	8d COMMON	4" O.C. AT EDGES 8" O.C. OTHER
GYPSON SHEATHING:	GALV. 11GA X1.75" W/ 7/16" HEAD/ DIAMOND	4" O.C. ALONG ALL BEARING POINTS

ROOF & CEILING CONSTRUCTION

- CEILING JOIST TO TOP PLATE: 16d COMMON 4 TOE-NAIL
- CEILING JOISTS LAPS (OVER PARTITION): 10d COMMON 4 DIRECT
- CEILING JOISTS TO RAFTER: 10d COMMON 5 DIRECT
- COLLAR TIE TO RAFTER: 10d COMMON 5 DIRECT
- ROOF RAFTER TO TOP PLATE: 10d COMMON 4 TOE-NAIL
- ROOF RAFTER TO RIDGE: 16d COMMON 4 TOE-NAIL OR 3 END DIRECT
- VALLEY/HP RAFTER TO RIDGE, HEADER OR TRIMMER: 16d COMMON 2" O.C. TOE-NAIL OR 3" O.C. END DIRECT
- JACK RAFTER TO HP: 10d COMMON 3 TOE-NAIL OR 2 END DIRECT
- BLOCKING BETWEEN RAFTERS TO TOP PLATE: 10d COMMON 2" O.C. TOE-NAIL
- ROOF SHEATHING: 8d COMMON 6" O.C. EDGES 10" O.C. OTHER
- NAILS AND SPIKES SPECIFIED ON PLAN SHALL CONFORM TO THE NOMINAL SIZES SPECIFIED IN FEDERAL SPECIFICATIONS FF-N-105B AND AS NOTED IN THE TABLE BELOW:

TYPE	PENNYWEIGHT					
	8d	10d	12d	16d	20d	
COMMON	SHANK DIAMETER	0.131"	0.148"	0.148"	0.162"	0.192"
	LENGTH	2.50"	3.00"	3.25"	3.50"	4.00"
	HEAD DIAMETER	0.281"	0.312"	0.312"	0.344"	0.406"
- PNEUMATIC OR ELECTRIC POWERED HAMMERS TYPICALLY UTILIZE LIGHTER GAGE FASTENERS AND NORMALLY REQUIRE ADDITIONAL FASTENERS TO BE INSTALLED. FASTENER SPECIFICATIONS MUST BE SUBMITTED TO THE ENGINEER FOR APPROVAL PRIOR TO INSTALLATION IF POWERED HAMMERS ARE TO BE USED.
- BOLTS SHALL CONFORM TO ASTM A307 OR ASTM A36.
- LAG AND WOOD SCREWS SHALL CONFORM TO ANSI/ASME STANDARD B18.6.1-19.8.1.
- ALL FASTENERS USED IN CONTACT WITH PRESERVATIVE TREATED WOOD SHALL BE HOT DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A153 OR STAINLESS STEEL, TYPE 316. DO NOT MIX STAINLESS STEEL AND GALVANIZED FASTENERS AND CONNECTORS.
- BORED LEAD HOLES FOR FASTENERS SHALL BE AS FOLLOWS:
 A. NAIL AND SPIKE LEAD HOLES ARE NOT REQUIRED UNLESS TO PREVENT SPLITTING OF WOOD. IF REQUIRED, LEAD HOLE DIAMETER SHALL NOT EXCEED 75% OF NAIL/SPIKE DIAMETER.
 B. WOOD SCREWS - LEAD HOLE DIAMETER EQUALS 7/8 OF UNTHREADED SHANK DIAMETER IN CONNECTED WOOD PART AND 7/8 OF DIAMETER AT ROOT OF THREAD IN WOOD RECEIVING THREAD.
 C. LAG SCREWS - LEAD HOLE DIAMETER EQUALS SHANK DIAMETER FOR EXTENT OF UNTHREADED SHANK, AND 60% OF SHANK DIAMETER FOR THREADED PORTION OF SHANK.
 D. THRU BOLTS - LEAD HOLE DIAMETER 1/32" TO 1/16" LARGER THAN NOMINAL BOLT DIAMETER.
 7. INSERT THREADED SCREW TYPE FASTENERS BY TURNING WITH SCREWDRIVER OR WRENCH. DO NOT DRIVE BY HAMMERING. FACILITATE INSTALLATION BY PLACING SOAP OR OTHER LUBRICANT ON THREADS.
 8. PROVIDE STANDARD ROUND WASHERS UNDER THE HEADS OF ALL THRU BOLTS AND LAG SCREWS AND UNDER ALL NUTS UNLESS OTHERWISE INDICATED ON THE PLANS. TIGHTEN FASTENERS WITHOUT CRUSHING WOOD FIBERS UNDER WASHERS.

GENERAL LEGEND

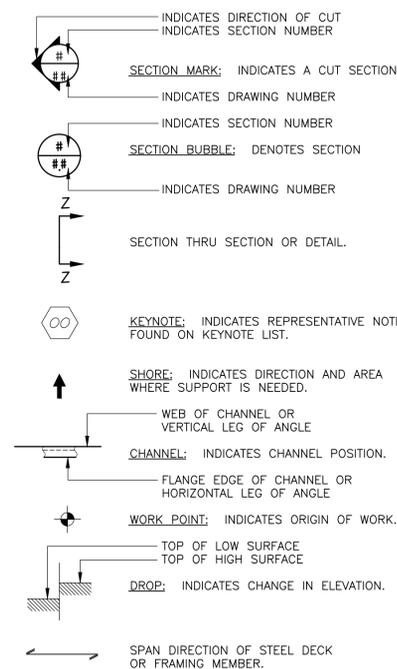

Revisions	Date
△ STAMFORD E.P.B.	3/31

The Di Salvo Engineering Group
 Structural Engineers
 85 Wester-Highland Road, Suite 200
 East Greenwich, Connecticut 06830
 (860) 484-1400 | www.dseng.com


Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD, CT 06902

GENERAL NOTES

JM	Drawn
GCF	Checked
03.15.16	Date
AS NOTED	Scale
13288.00	Job Number
	Sheet

SO

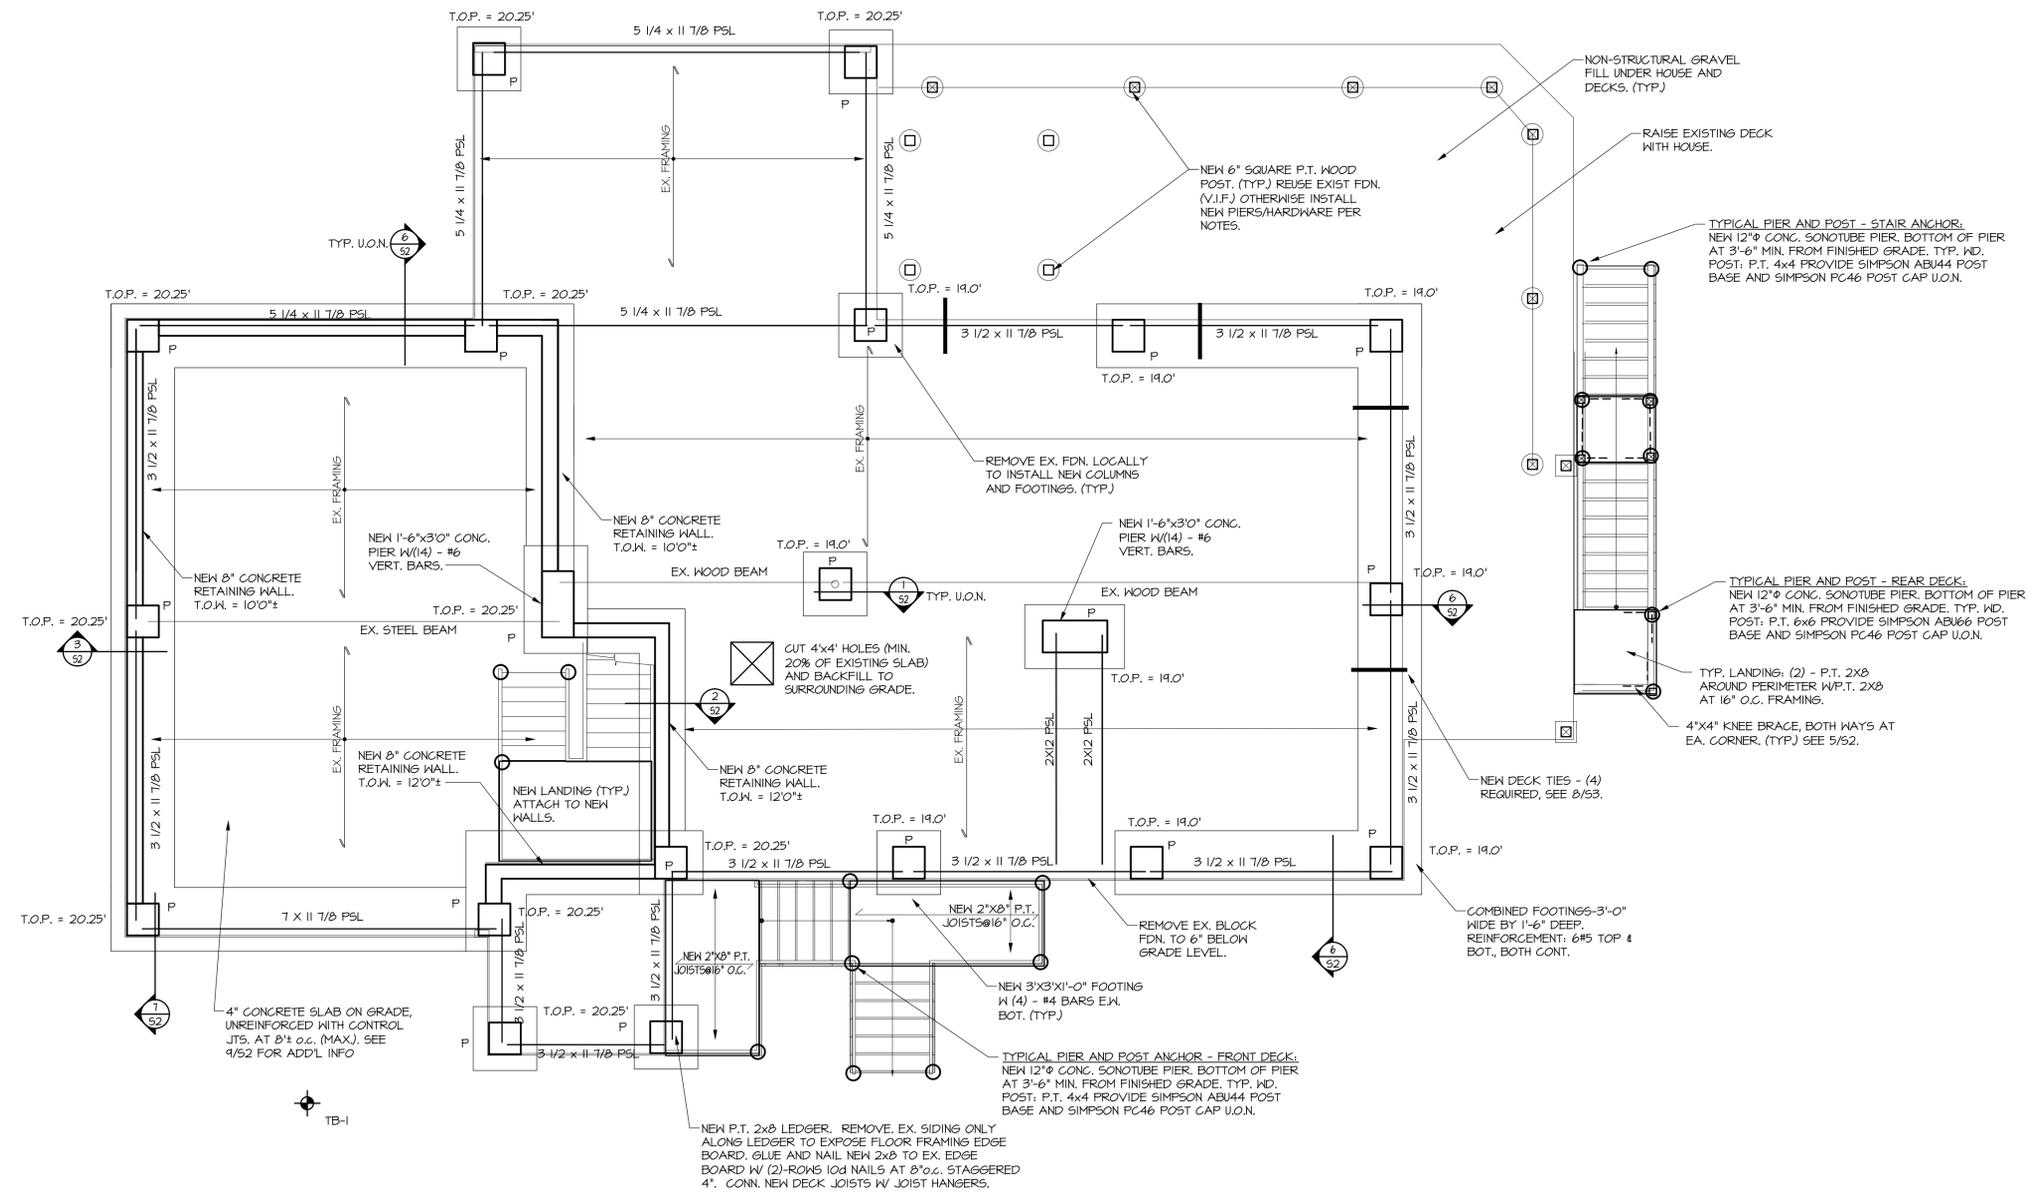

FOUNDATION AND FIRST FLOOR FRAMING PLAN
1/4" = 1'-0"

- DO NOT SCALE THIS DRAWING. SEE ARCHITECTURAL PLANS FOR DIMENSIONS AND ELEVATIONS NOT SHOWN HERE.
- ALL WORK SHOWN IS NEW UNLESS INDICATED AS EXISTING AND/ OR SHOWN WITH LIGHT LINE WORK.
- CONTRACTOR TO EXPOSE EX. FRAMING TO DETERMINE WALL TIE DOWNS TO FLOOR FRAMINGS.
- "P.T." INDICATES PRESURE PRESERVATIVE TREATMENT.
- "P" INDICATES NEW PIERS. "T.O.P." INDICATES TOP OF PIER ELEVATION.
- TB# INDICATES APPROXIMATE LOCATION OF SOIL TEST BORING
- BOTTOM OF FOOTINGS SHALL BE 3'-6" MINIMUM BELOW GRADE BEARING ON EXISTING SOIL.
- ALL PSL BEAMS TO BE PRESURE TREATED.
- STAIR STRINGERS ARE TIED DOWN AND DESIGNED TO STAY IN PLACE WITH WAVE ACTION.
- SEE DRAWING 50 FOR GENERAL NOTES AND MATERIAL SPECIFICATIONS AND DRAWING 52 FOR SECTIONS AND DETAILS.

Revisions	Date
△ STAMFORD E.P.B.	3/31


The DiSalvo Engineering Group
Structural Engineers
83 Woodside Road, Suite 200
Lebanon, Connecticut 06040
Tel: 860-451-1401 | www.dseng.com

Aris Crist Architects
34 East Putnam Avenue
Greenwich, Connecticut 06830
203.661.0661

RESIDENCE No. 2097
3 WEED CIRCLE
STAMFORD, CT 06902
FOUNDATION PLAN

JM	Drawn
GCF	Checked
03.15.16	Date
AS NOTED	Scale
13288.00	Job Number
	Sheet


S1

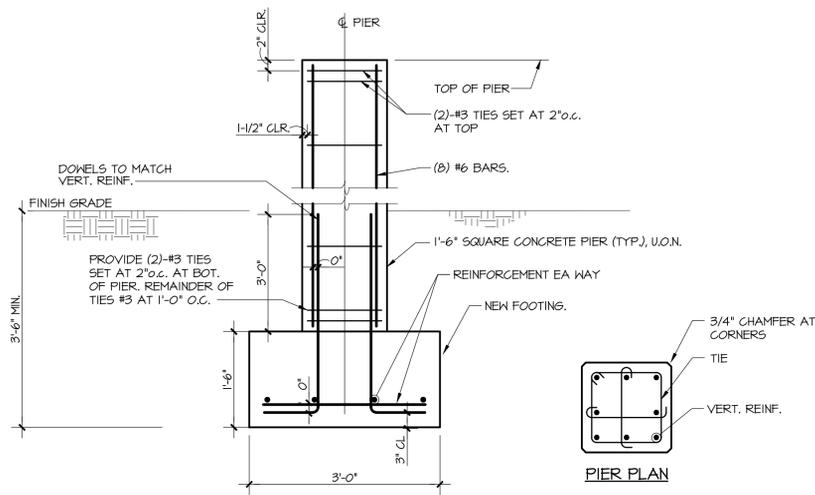

TYPICAL ISOLATED PIER/FOOTING DETAIL

NO SCALE


1
52

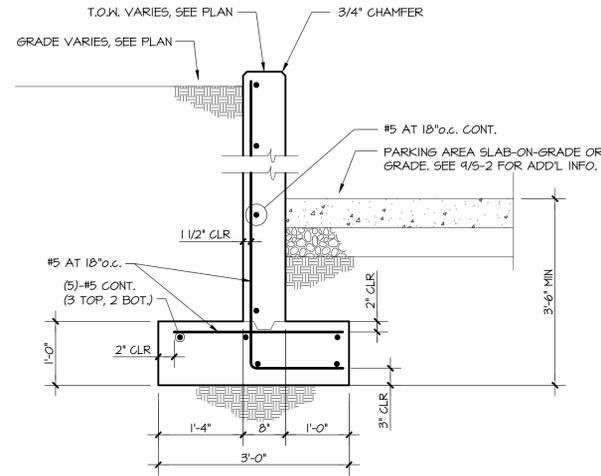

RETAINING WALL SECTION

NO SCALE


2
52

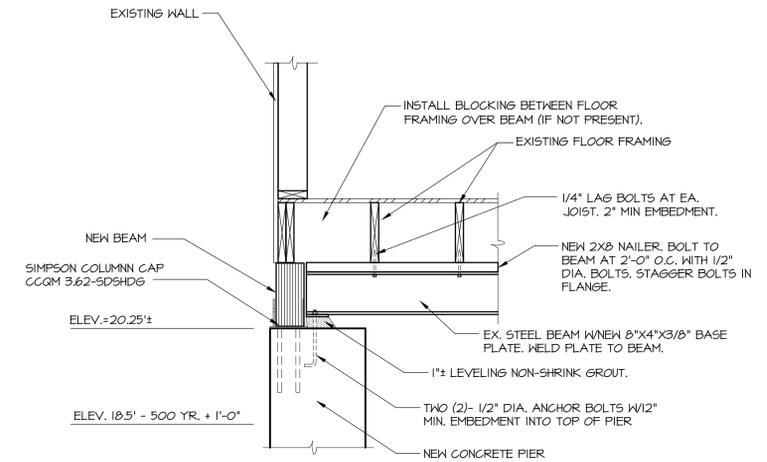

STEEL BEAM BEARING DETAILS

NO SCALE


3
52

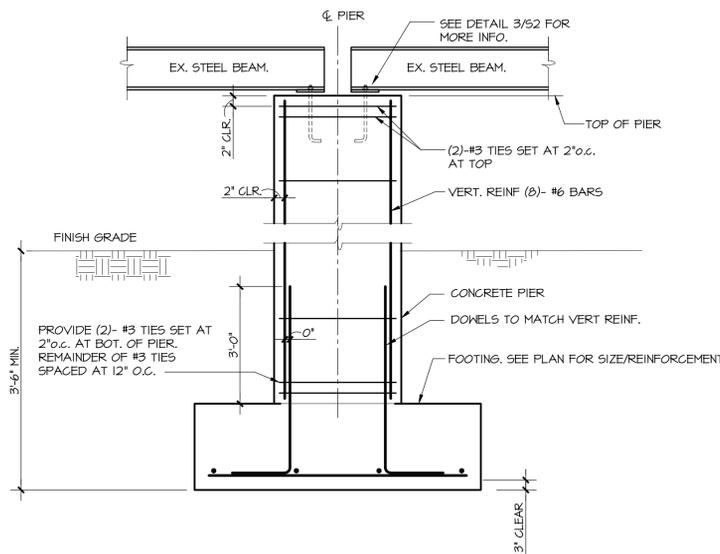

PIER DETAIL

NO SCALE


4
52

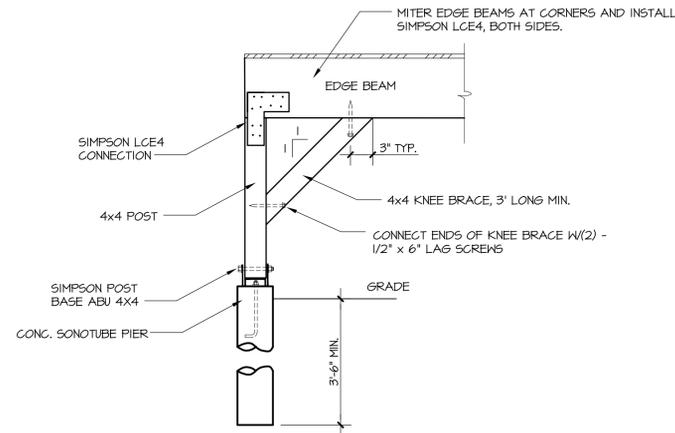

CONCRETE TO BLDG. CONNECTION DETAIL

NO SCALE


6
52

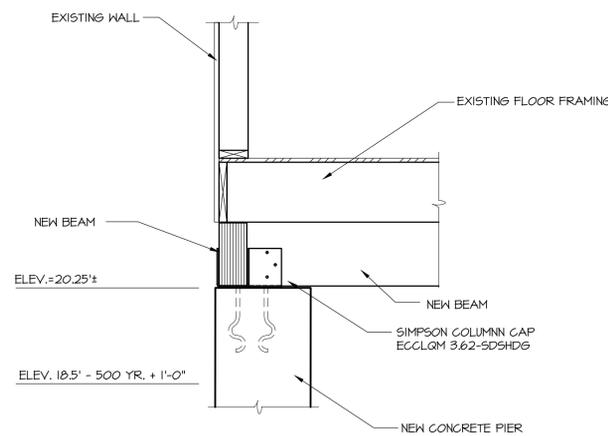

DETAIL

NO SCALE


7
52

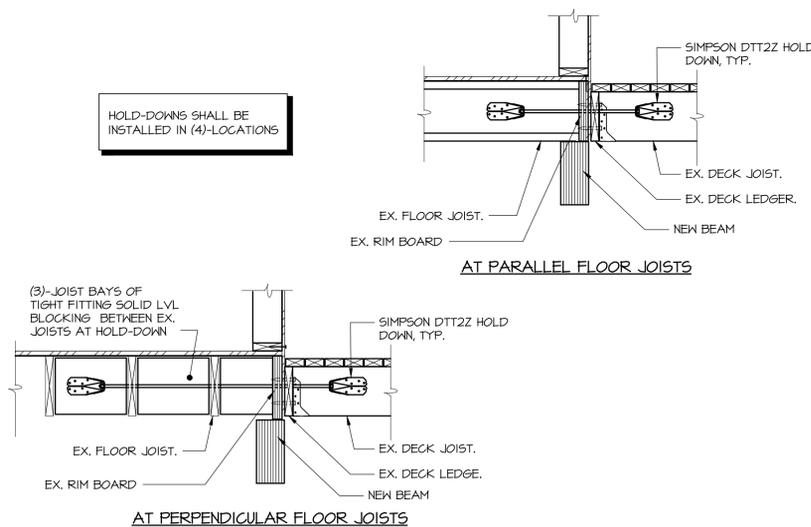


DECK ATTACHMENT DETAILS

NO SCALE

8
52

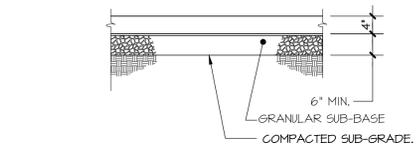

TYPICAL SLAB ON GRADE DETAIL



TYPICAL CONTROL JOINT DETAIL

NOTE: THE SAW CUT IS TO BE PERFORMED UP TO 12 HOURS AFTER THE CONCRETE IS POURED. REFER TO ACI 301

NOTE: THE SLAB ON GRADE IS UNREINFORCED AND DESIGNED TO BREAK AWAY UNDER WAVE ACTION.

SLAB ON GRADE DETAILS

NO SCALE

9
52

Revisions	Date
STANFORD E.P.B.	3/31



Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD, CT 06902

Drawn	Checked	Date	Scale
JM	GCF	03.15.16	AS NOTED
Job Number		Sheet	
13288.00			

S2

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

PLUMBING DEMOLITION NOTES:

1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE, PRIOR TO BIDDING, AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF DEMOLITION WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
2. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES.
3. ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES. TYPICAL.
4. DO NOT DAMAGE EXISTING EQUIPMENT AND/OR SYSTEMS NOT BEING REMOVED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING EQUIPMENT AND/OR SYSTEMS NOT BEING REMOVED.
5. DRAWINGS ARE DIAGRAMMATIC. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS INCLUDED IN AND RELATED TO THE PROJECT SCOPE OF WORK. TYPICAL.

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 267-8728
 Fax: (860) 267-8728


© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 BASEMENT PLUMBING DEMOLITION PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet


DP-1.0

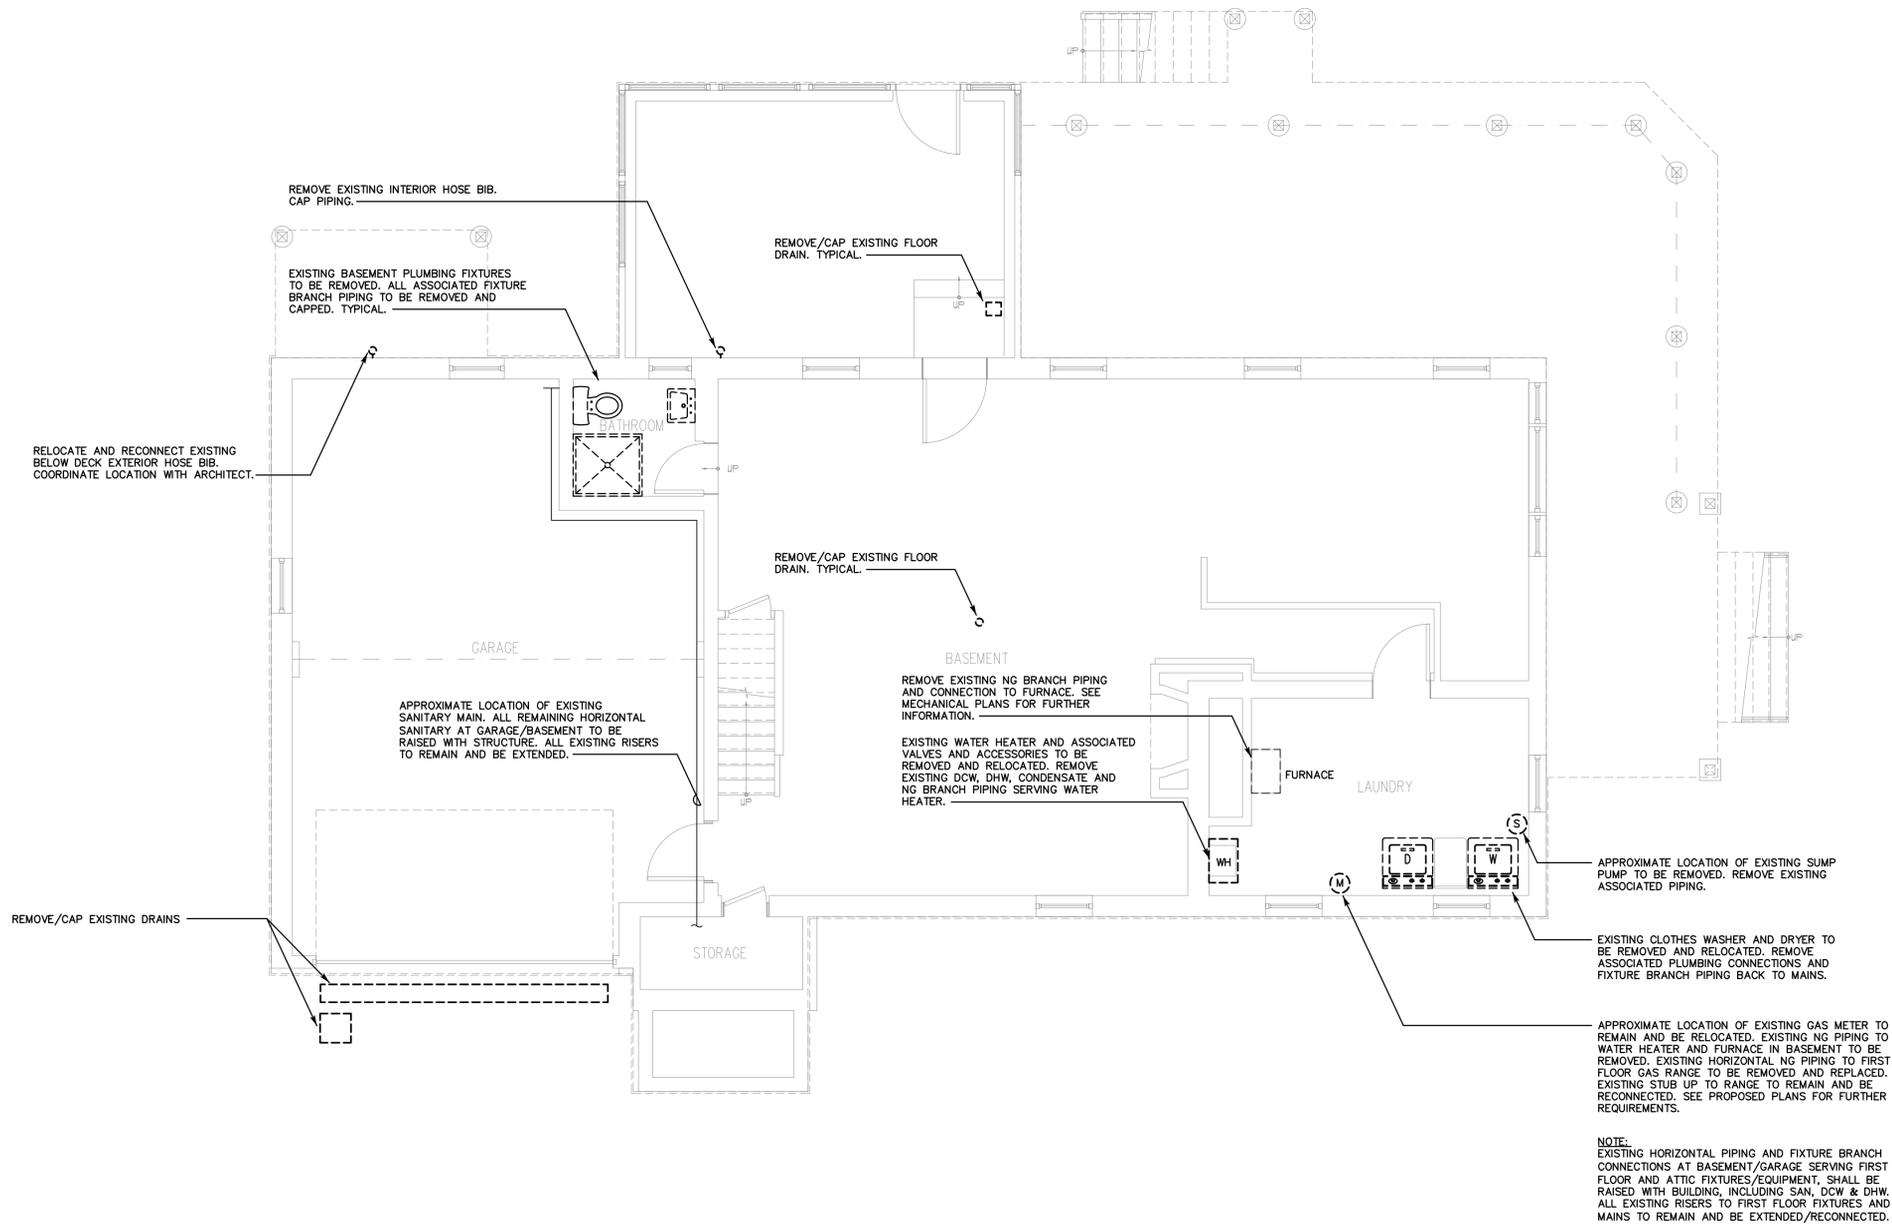

BASEMENT PLUMBING DEMOLITION PLAN
 SCALE: 1/4"=1'-0"

NOTE:
 EXISTING HORIZONTAL PIPING AND FIXTURE BRANCH CONNECTIONS AT BASEMENT/GARAGE SERVING FIRST FLOOR AND ATTIC FIXTURES/EQUIPMENT, SHALL BE RAISED WITH BUILDING, INCLUDING SAN, DCW & DHW. ALL EXISTING RISERS TO FIRST FLOOR FIXTURES AND MAINS TO REMAIN AND BE EXTENDED/RECONNECTED.

NOTE:
 EXISTING WATER METER AND ASSOCIATED VALVES, FITTINGS, APPURTENANCES AND ACCESSORIES TO BE REMOVED AND RELOCATED/RECONNECTED WITH BUILDING ABOVE FLOOR PLAIN LEVEL. EXISTING UNDERGROUND DOMESTIC WATER SUPPLY MAIN TO BE EXTENDED TO PROPOSED LOCATION.

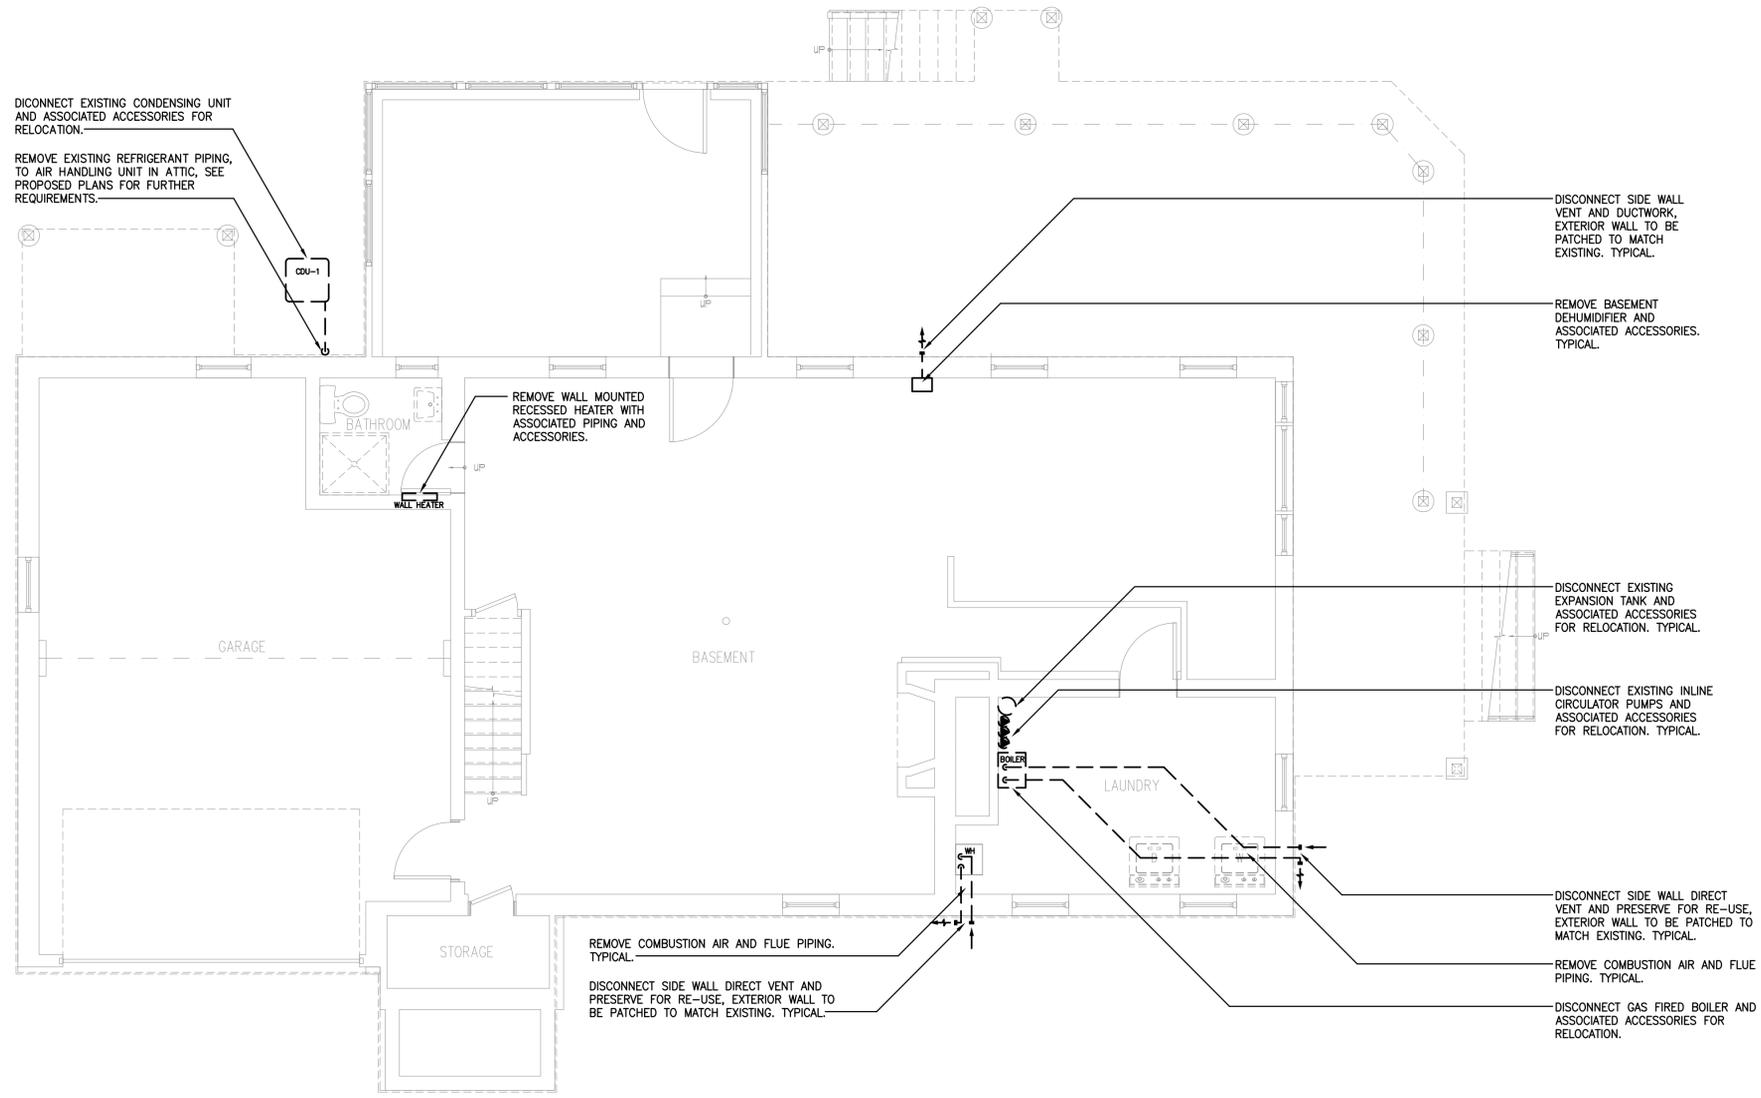

- DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF DEMOLITION WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
 2. REMOVE AND PROPERLY DISPOSE OF EQUIPMENT AND ASSOCIATED COMPONENTS/ACCESSORIES AS INDICATED ON DEMOLITION PLANS. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. TYPICAL.
 3. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING EQUIPMENT, PIPING, OR ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
 4. ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. COORDINATE WORK WITH ALL PROJECT DISCIPLINES AND EXISTING CONDITIONS. TYPICAL.
 5. CONTRACTOR SHALL PROVIDE MINIMUM OF 72 HOURS NOTICE PRIOR TO ANY EQUIPMENT/SERVICE SHUT DOWN.
 6. DRAWINGS ARE DIAGRAMMATIC. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS INCLUDED IN AND RELATED TO THE PROJECT SCOPE OF WORK. TYPICAL.
 7. PROPOSED SYSTEM SHALL BE FULLY INSTALLED AND CONNECTED TO RESPECTIVE PIPING PRIOR TO REMOVAL OF EXISTING EQUIPMENT. TYPICAL.
 8. CONTRACTOR TO DISCONNECT BASEBOARD HEATER PIPING FROM BOILER SYSTEM AND PRESERVE FOR REUSE. TYPICAL. SEE PROPOSED PLANS FOR FURTHER REQUIREMENTS.

BASEMENT MECHANICAL DEMOLITION PLAN
 SCALE: 1/4"=1'-0"

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (800) 287-8728
 Fax: (800) 287-8728

© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661


RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 MECHANICAL BASEMENT DEMOLITION PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet

DM-1.0

EXISTING BASEBOARD HEATERS AND ASSOCIATED PIPING TO REMAIN. SEE PROPOSED PLANS FOR FURTHER REQUIREMENTS. TYPICAL.

REMOVE EXISTING REFRIGERANT PIPING, TO AIR HANDLING UNIT IN ATTIC, SEE PROPOSED PLANS FOR FURTHER REQUIREMENTS.

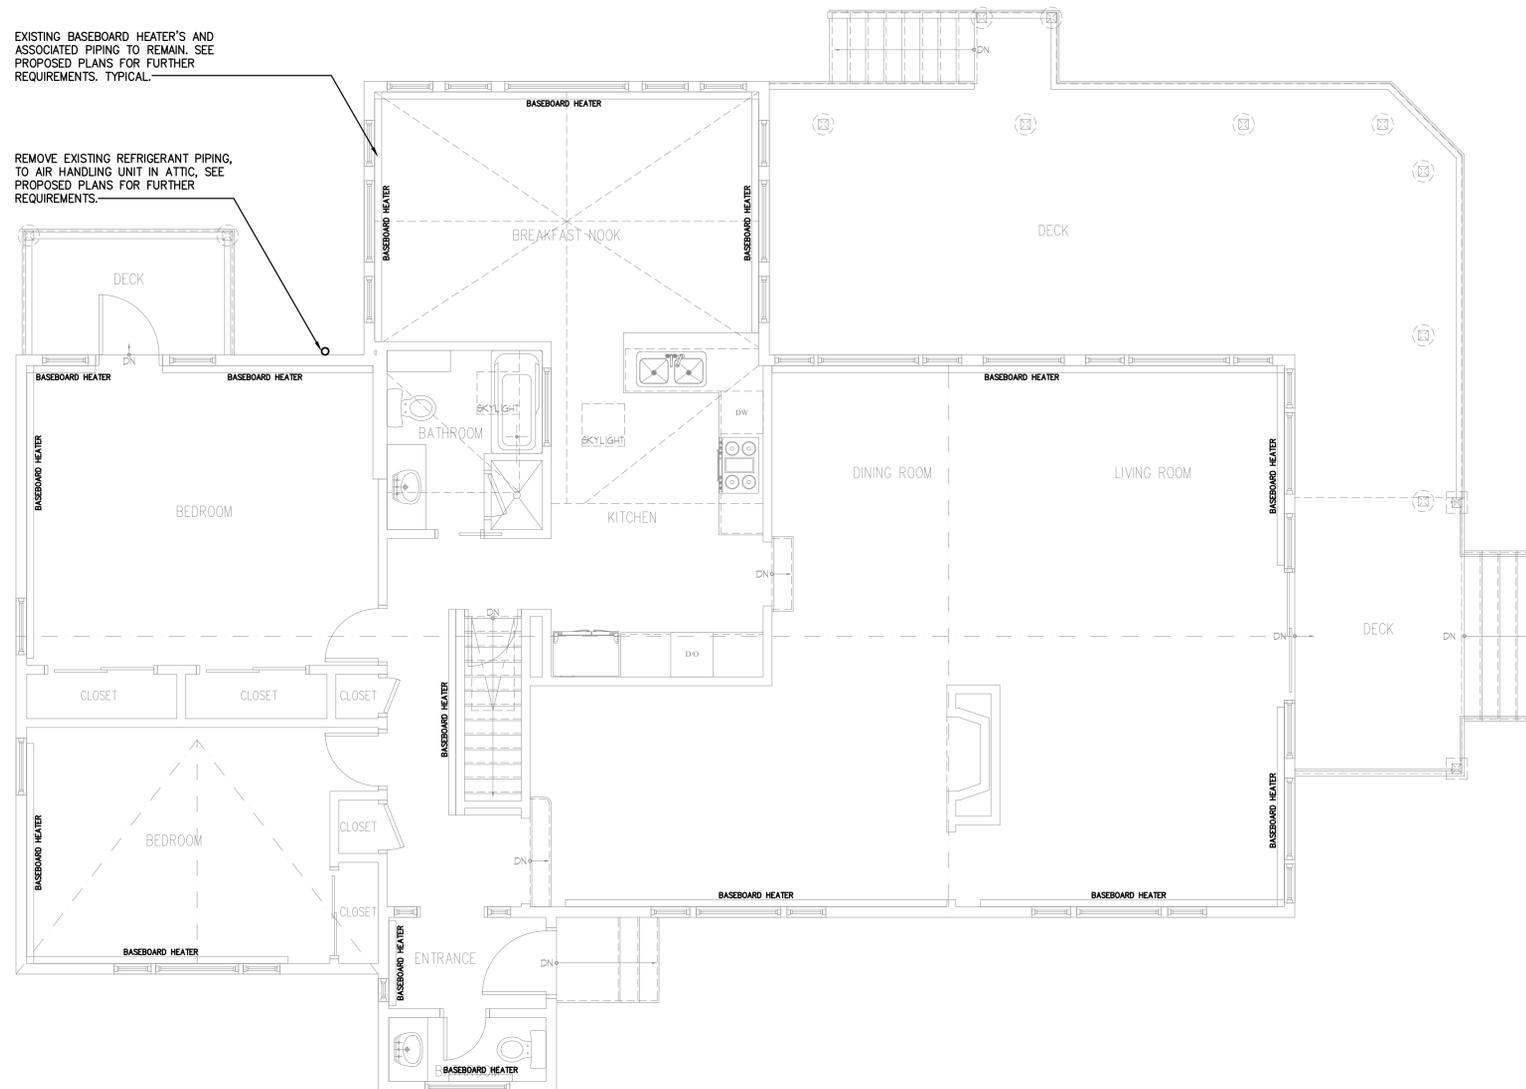

FIRST FLOOR MECHANICAL DEMOLITION PLAN

SCALE: 1/4" = 1'-0"

DEMOLITION NOTES:

1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF DEMOLITION WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
2. REMOVE AND PROPERLY DISPOSE OF EQUIPMENT AND ASSOCIATED COMPONENTS/ACCESSORIES AS INDICATED ON DEMOLITION PLANS. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. TYPICAL.
3. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING EQUIPMENT, PIPING, OR ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
4. ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. COORDINATE WORK WITH ALL PROJECT DISCIPLINES AND EXISTING CONDITIONS. TYPICAL.
5. CONTRACTOR SHALL PROVIDE MINIMUM OF 72 HOURS NOTICE PRIOR TO ANY EQUIPMENT/SERVICE SHUT DOWN.
6. DRAWINGS ARE DIAGRAMMATIC. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS INCLUDED IN AND RELATED TO THE PROJECT SCOPE OF WORK. TYPICAL.
7. PROPOSED SYSTEM SHALL BE FULLY INSTALLED AND CONNECTED TO RESPECTIVE PIPING PRIOR TO REMOVAL OF EXISTING EQUIPMENT. TYPICAL.
8. ALL EXISTING DUCTWORK, REGISTERS, GRILLES, AND ASSOCIATED ACCESSORIES TO REMAIN IN PLACE AND BE REUSED. TYPICAL.
9. ALL EXISTING BASEBOARD HEATERS THROUGHOUT THE FIRST FLOOR, SHOWN OR NOT, TO REMAIN IN PLACE AND BE REUSED. TYPICAL.

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (800) 877-8728

© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA


Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 MECHANICAL FIRST FLOOR DEMOLITION PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet

DM-2.0

- DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF DEMOLITION WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
 2. REMOVE AND PROPERLY DISPOSE OF EQUIPMENT AND ASSOCIATED COMPONENTS/ACCESSORIES AS INDICATED ON DEMOLITION PLANS. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. TYPICAL.
 3. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING EQUIPMENT, PIPING, OR ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
 4. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING ELECTRICAL CONNECTIONS, WIRING AND ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
 5. ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. COORDINATE WORK WITH ALL PROJECT DISCIPLINES AND EXISTING CONDITIONS. TYPICAL.
 6. DRAWINGS ARE DIAGRAMMATIC. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS INCLUDED IN AND RELATED TO THE PROJECT SCOPE OF WORK. TYPICAL.
 7. DO NOT DISTURB ANY SUSPECTED HAZARDOUS MATERIALS. NOTIFY OWNERS REPRESENTATIVE OR ANY SUSPECTED MATERIALS IMPEDING PERFORMANCE OF WORK. TYPICAL.
 8. CONTRACTOR SHALL COORDINATE WITH LOCAL UTILITY COMPANIES. CONTRACTOR RESPONSIBLE FOR ALL FEES ASSOCIATED WITH ANY AND ALL UTILITY COMPANIES TO COMPLETE SCOPE OF WORK.
 9. CONTRACTOR SHALL VERIFY ALL EXISTING EQUIPMENT SIZES AND LOCATIONS INFIELD AND PRIOR TO BIDDING.

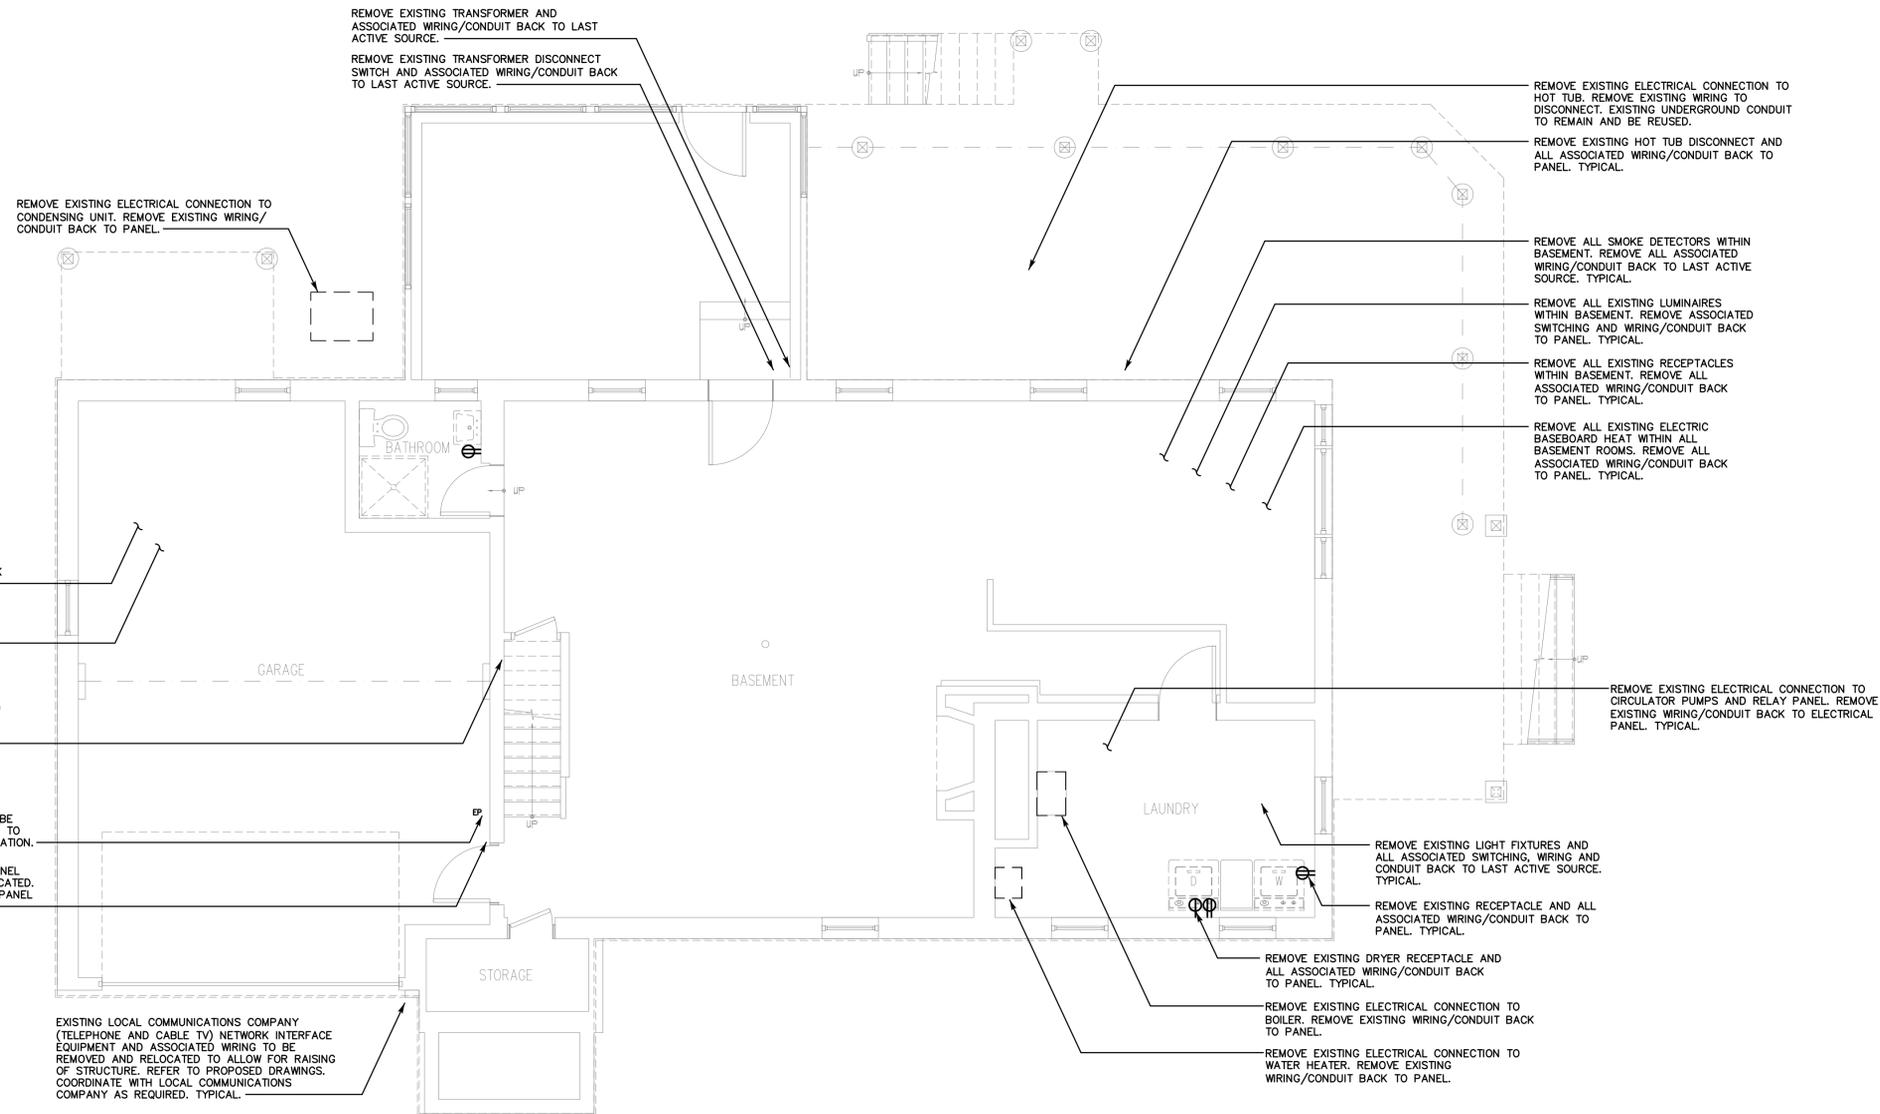

BASEMENT ELECTRICAL DEMOLITION PLAN
 SCALE: 1/4"=1'-0"

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 267-8728
 Fax: (860) 267-8728

© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA


Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 BASEMENT ELECTRICAL DEMOLITION PLAN

Drawn
JDB
Checked
JAS
Date
03.12.15
Scale
AS NOTED
Job Number
Sheet

DE-1.0

- DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF DEMOLITION WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
 2. REMOVE AND PROPERLY DISPOSE OF EQUIPMENT AND ASSOCIATED COMPONENTS/ACCESSORIES AS INDICATED ON DEMOLITION PLANS. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. TYPICAL.
 3. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING EQUIPMENT, PIPING, OR ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
 4. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING ELECTRICAL CONNECTIONS, WIRING AND ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
 5. ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. COORDINATE WORK WITH ALL PROJECT DISCIPLINES AND EXISTING CONDITIONS. TYPICAL.
 6. DRAWINGS ARE DIAGRAMMATIC. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS INCLUDED IN AND RELATED TO THE PROJECT SCOPE OF WORK. TYPICAL.
 7. DO NOT DISTURB ANY SUSPECTED HAZARDOUS MATERIALS. NOTIFY OWNERS REPRESENTATIVE OR ANY SUSPECTED MATERIALS IMPEDING PERFORMANCE OF WORK. TYPICAL.
 8. CONTRACTOR SHALL COORDINATE WITH LOCAL UTILITY COMPANIES. CONTRACTOR RESPONSIBLE FOR ALL FEES ASSOCIATED WITH ANY AND ALL UTILITY COMPANIES TO COMPLETE SCOPE OF WORK.
 9. CONTRACTOR SHALL VERIFY ALL EXISTING EQUIPMENT SIZES AND LOCATIONS INFIELD AND PRIOR TO BIDDING.

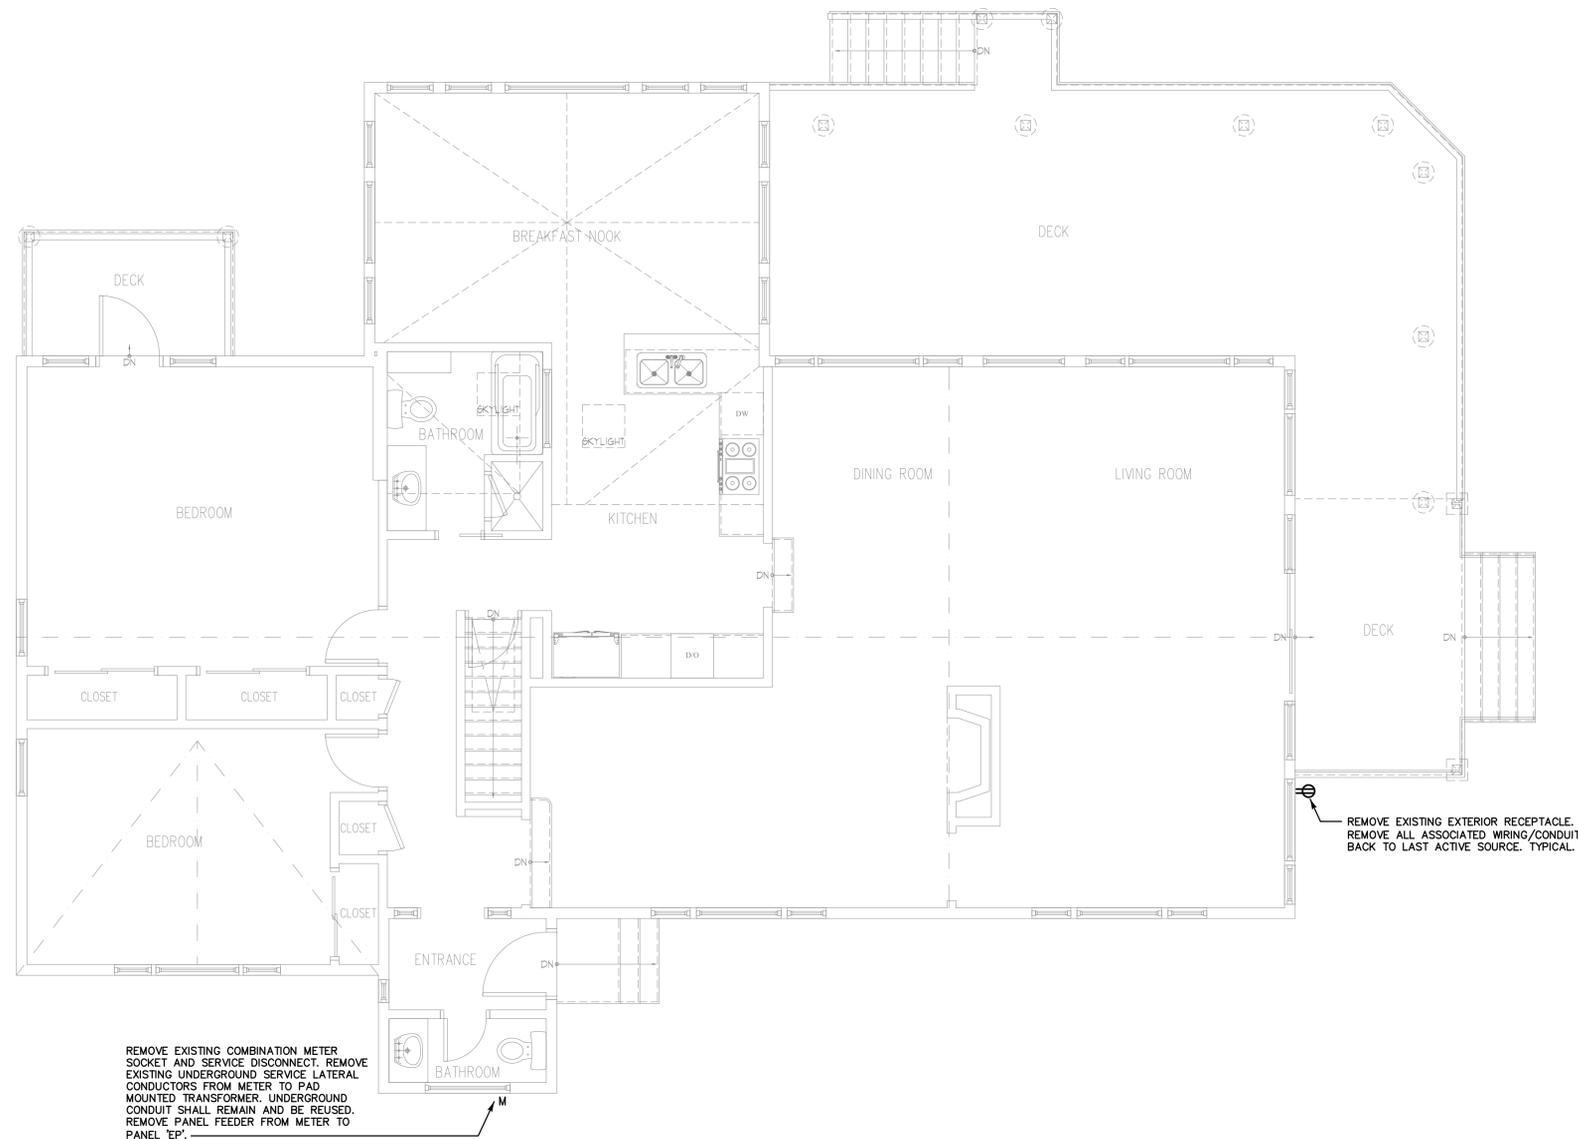

FIRST FLOOR ELECTRICAL DEMOLITION PLAN
 SCALE: 1/4"=1'-0"

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 297-8728
 Fax: (860) 297-8728


© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 FIRST FLOOR ELECTRICAL DEMOLITION PLAN

Drawn	JDB
Checked	JAS
Date	03.12.15
Scale	AS NOTED
Job Number	
Sheet	

DE-2.0

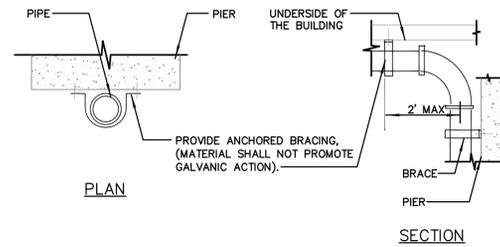

PERPENDICULAR & LATERAL BRACE/HANGER:
REQUIRED PER BRACE/HANGER TABLE AND AT ALL CHANGES
OF DIRECTION. (SEE APPLICABLE INTERNATIONAL PLUMBING
CODE FOR ADDITIONAL INFORMATION) TYPICAL.

PIPE BRACE/HANGER TABLE			
PIPING MATERIAL	MAX. HORIZONTAL SPACING	MAX. VERTICAL SPACING	NOTES
ABS	4'-0"	10'-0"	#1
CAST IRON	5'-0"	15'-0"	#2
COPPER OR COPPER ALLOY 1-1/4" Ø OR SMALLER	6'-0"	10'-0"	
COPPER OR COPPER ALLOY 1-1/2" Ø OR LARGER	10'-0"	10'-0"	
PEX	32"	10'-0"	#1
PEX-AL-PEX	32"	4'-0"	#1
CPVC 1" Ø OR SMALLER	3'-0"	10'-0"	#1
CPVC 1-1/4" Ø OR LARGER	4'-0"	10'-0"	#1
PE-AL-PE	32"	4'-0"	#1
PVC	4'-0"	10'-0"	#1
STAINLESS STEEL	10'-0"	10'-0"	#1

GENERAL NOTES:
1. MIDSTORY GUIDE FOR SIZES 2" AND SMALLER.
2. THE MAXIMUM HORIZONTAL SPACING SHALL BE INCREASED TO 10'-0"
WHERE 10'-0" LENGTHS OF PIPE ARE INSTALLED.

BRACE/HANGER DETAILS FOR PIPES BELOW THE BUILDING

NOT TO SCALE



BASEMENT PLUMBING PLAN

SCALE: 1/4"=1'-0"

WARNING

"CALL BEFORE YOU DIG"
1-800-922-4455

CONTRACTOR SHALL REGISTER HIS INTENTION
TO START EXCAVATIONS AT OR NEAR A
PUBLIC UTILITY AT LEAST TWO FULL
WORKING DAYS PRIOR TO THE ACTIVITY.

- CONTRACTOR SHALL RETURN SITE TO ORIGINAL CONDITION AFTER INSTALLATION OF ANY/ALL PROPOSED UTILITIES, EQUIPMENT, MATERIALS AND STRUCTURES.
- THE LOCATION OF ALL UNDERGROUND UTILITIES IS BASED UPON THE BEST AVAILABLE INFORMATION. CONTRACTOR SHALL CONFIRM LOCATION OF ALL UNDERGROUND UTILITIES, FOUNDATIONS AND STRUCTURES PRIOR TO COMMENCEMENT OF ANY EXCAVATION.
- CONTRACTOR IS RESPONSIBLE FOR REPAIR AND PAYMENT FOR ALL UTILITIES DAMAGED DURING CONSTRUCTION.

PLUMBING GENERAL NOTES:

- THE CONTRACTOR SHALL VISIT THE PROJECT SITE, PRIOR TO BIDDING, AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK INCLUDING TOOLS, MATERIAL, MANPOWER, ETC. REQUIRED FOR COMPLETE AND PROPER INSTALLATION OF PROPOSED MATERIALS, FIXTURES AND/OR EQUIPMENT.
- ALL WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. TYPICAL.
- CONTRACTOR SHALL PROVIDE CLEANOUTS FOR PROPOSED SANITARY PIPING AS REQUIRED PER CURRENT APPLICABLE CODES AND STANDARDS. TYPICAL.
- ROUTING OF ALL PIPING SHALL BE COORDINATED WITH STRUCTURAL FRAMING ELEMENTS AND ALL OTHER PROJECT DISCIPLINES. TYPICAL.
- PROVIDE DOUBLE CHECK VALVE BACKFLOW PREVENTER AND PRESSURE REDUCING VALVE ON DOMESTIC WATER SERVICE AS REQUIRED PER LOCAL WATER AUTHORITY AND CURRENT CODES AND STANDARDS.
- CONTRACTOR SHALL CONFIRM COMPATIBILITY OF SPRAY FOAM INSULATION WITH EXISTING SANITARY PVC/CPVC/ABS PIPING.
- CONTRACTOR SHALL CONFIRM COMPATIBILITY OF SPRAY FOAM INSULATION WITH PEX PIPING WHERE APPLICABLE.
- NO VALVES SHALL BE ENCASED IN SPRAY FOAM INSULATION.
- PROVIDE CONDENSATE DRAINAGE FOR DOMESTIC WATER HEATER AND BOILER. PROVIDE PER MANUFACTURER'S REQUIREMENTS. COORDINATE WITH MECHANICAL. PROVIDE CONDENSATE PUMPS WHERE REQUIRED TO ROUTE TO LAUNDRY SINK. EXISTING AIR HANDLER CONDENSATE SHALL BE EXTENDED. COORDINATE WITH MECHANICAL AND ARCHITECTURAL. TYPICAL.

PLUMBING SYSTEM INSTALLATION NOTES:

- EXISTING SANITARY TO REMAIN TO BE RAISED WITH STRUCTURE. PROVIDE PIPING TO EXTEND TO ALL EXISTING RISERS. PROVIDE EXTENSIONS OF ALL EXISTING CLEANOUTS TO MAINTAIN ABOVE GRADE ACCESS. PROVIDE ADDITIONAL ACCESSIBLE ABOVE GRADE CLEANOUTS AT PROPOSED MAIN BUILDING DRAIN RISER EXTENSIONS. TYPICAL.
- EXISTING DOMESTIC HOT AND COLD WATER DISTRIBUTION PIPING AT BASEMENT THAT IS TO REMAIN SHALL BE RAISED WITH BUILDING. ALL EXISTING RISERS TO FIRST AND SECOND FLOOR FIXTURES AND MAINS TO REMAIN AND BE RECONNECTED. PROVIDE ALL PIPING AND ACCESSORIES AS REQUIRED FOR PROPER INSTALLATION AND RECONNECTION.
- PROVIDE DOMESTIC WATER SERVICE PIPING FROM EXISTING UNDERGROUND SERVICE MAIN TO RELOCATED METER. COORDINATE TRENCHING WITH SITE UTILITIES PLANS/CONTRACTOR AND LOCAL UTILITY CO.
- PROVIDE/CONNECT PROPOSED COLD WATER SERVICE PIPING MAIN FROM RELOCATED WATER METER DN TO EXISTING MAIN AT BASEMENT LEVEL. RECONNECT EXISTING SYSTEM TO REMAIN. PROVIDE ALL PIPING, FITTINGS AND ACCESSORIES AS REQUIRED FOR PROPER INSTALLATION/CONNECTION.
- CONNECT PROPOSED HOT WATER SERVICE PIPING MAIN FROM RELOCATED WATER HEATER TO EXISTING MAIN AT BASEMENT LEVEL. RECONNECT EXISTING SYSTEM TO REMAIN. PROVIDE ALL PIPING, FITTINGS AND ACCESSORIES AS REQUIRED FOR PROPER INSTALLATION/CONNECTION.
- ALL DOMESTIC WATER AND SANITARY PIPING SHALL BE INSULATED/PROTECTED FROM FREEZING AND WEATHER. COORDINATE PROTECTION DEVICE WITH STRUCTURAL DRAWINGS, INSULATION WITH ARCHITECTURAL DRAWINGS, AND HEAT TRACE WITH ELECTRICAL DRAWINGS.
- PROVIDE NG PIPING FROM RELOCATED METER TO FIRST FLOOR GAS RANGE CONNECTION. DO NOT ENCASE NG PIPING IN SPRAY FOAM INSULATION. NG PIPING SHALL BE INSTALLED AND PROTECTED PER NFPA 54 REQUIREMENTS AND RECOMMENDATIONS. TYPICAL.
- ANY/ALL VALVES SHALL BE LOCATED IN ACCESSIBLE LOCATION WITHIN BUILDING. RELOCATE EXISTING VALVES AS REQUIRED. COORDINATE VALVE ACCESS WITH ARCHITECT. TYPICAL.

Revisions	Date
Bid Set	04.10.15
Pipe Brace/Hanger Revision	09.21.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
CONSULTING ENGINEERS
118 North Plain Industrial Road
Wallingford, Connecticut 06495
Phone: (860) 267-8728
Fax: (860) 267-8728

© ARIS CRIST AIA 2015.
THIS TECHNICAL DRAWING AND
THE ARCHITECTURAL WORK
DEPICTED ARE COPYRIGHTED BY
ARIS CRIST AIA

Aris Crist Architects
34 East Putnam Avenue
Greenwich, Connecticut 06830
203 661 0661

RESIDENCE No. 2097

3 WEEED CIRCLE
STAMFORD CT, 06902

BASEMENT PLUMBING PLAN

Drawn
JDB
Checked
JAS
Date
03.12.15
Scale
AS NOTED
Job Number
Sheet

P-1.0

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

WARNING

CALL BEFORE YOU DIG
1-800-922-4455

- CONTRACTOR SHALL REGISTER HIS INTENTION TO START EXCAVATIONS AT OR NEAR A PUBLIC UTILITY AT LEAST TWO FULL WORKING DAYS PRIOR TO THE ACTIVITY.
- CONTRACTOR SHALL RETURN SITE TO ORIGINAL CONDITION AFTER INSTALLATION OF ANY/ALL PROPOSED UTILITIES, EQUIPMENT, MATERIALS AND STRUCTURES.
 - THE LOCATION OF ALL UNDERGROUND UTILITIES IS BASED UPON THE BEST AVAILABLE INFORMATION. CONTRACTOR SHALL CONFIRM LOCATION OF ALL UNDERGROUND UTILITIES, FOUNDATIONS AND STRUCTURES PRIOR TO COMMENCEMENT OF ANY EXCAVATION.
 - CONTRACTOR IS RESPONSIBLE FOR REPAIR AND PAYMENT FOR ALL UTILITIES DAMAGED DURING CONSTRUCTION.


CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
CONSULTING ENGINEERS
118 North Plain Industrial Road
Willingboro, Connecticut 06098
Tel: (860) 287-8728 Fax: (860) 287-8728

© ARIS CRIST AIA 2015.
THIS TECHNICAL DRAWING AND THE ARCHITECTURAL WORK DEPICTED ARE COPYRIGHTED BY ARIS CRIST AIA

Aris Crist Architects
34 East Putnam Avenue
Greenwich, Connecticut 06830
203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
STAMFORD CT, 06902
FIRST FLOOR PLUMBING PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet
P-2.0	

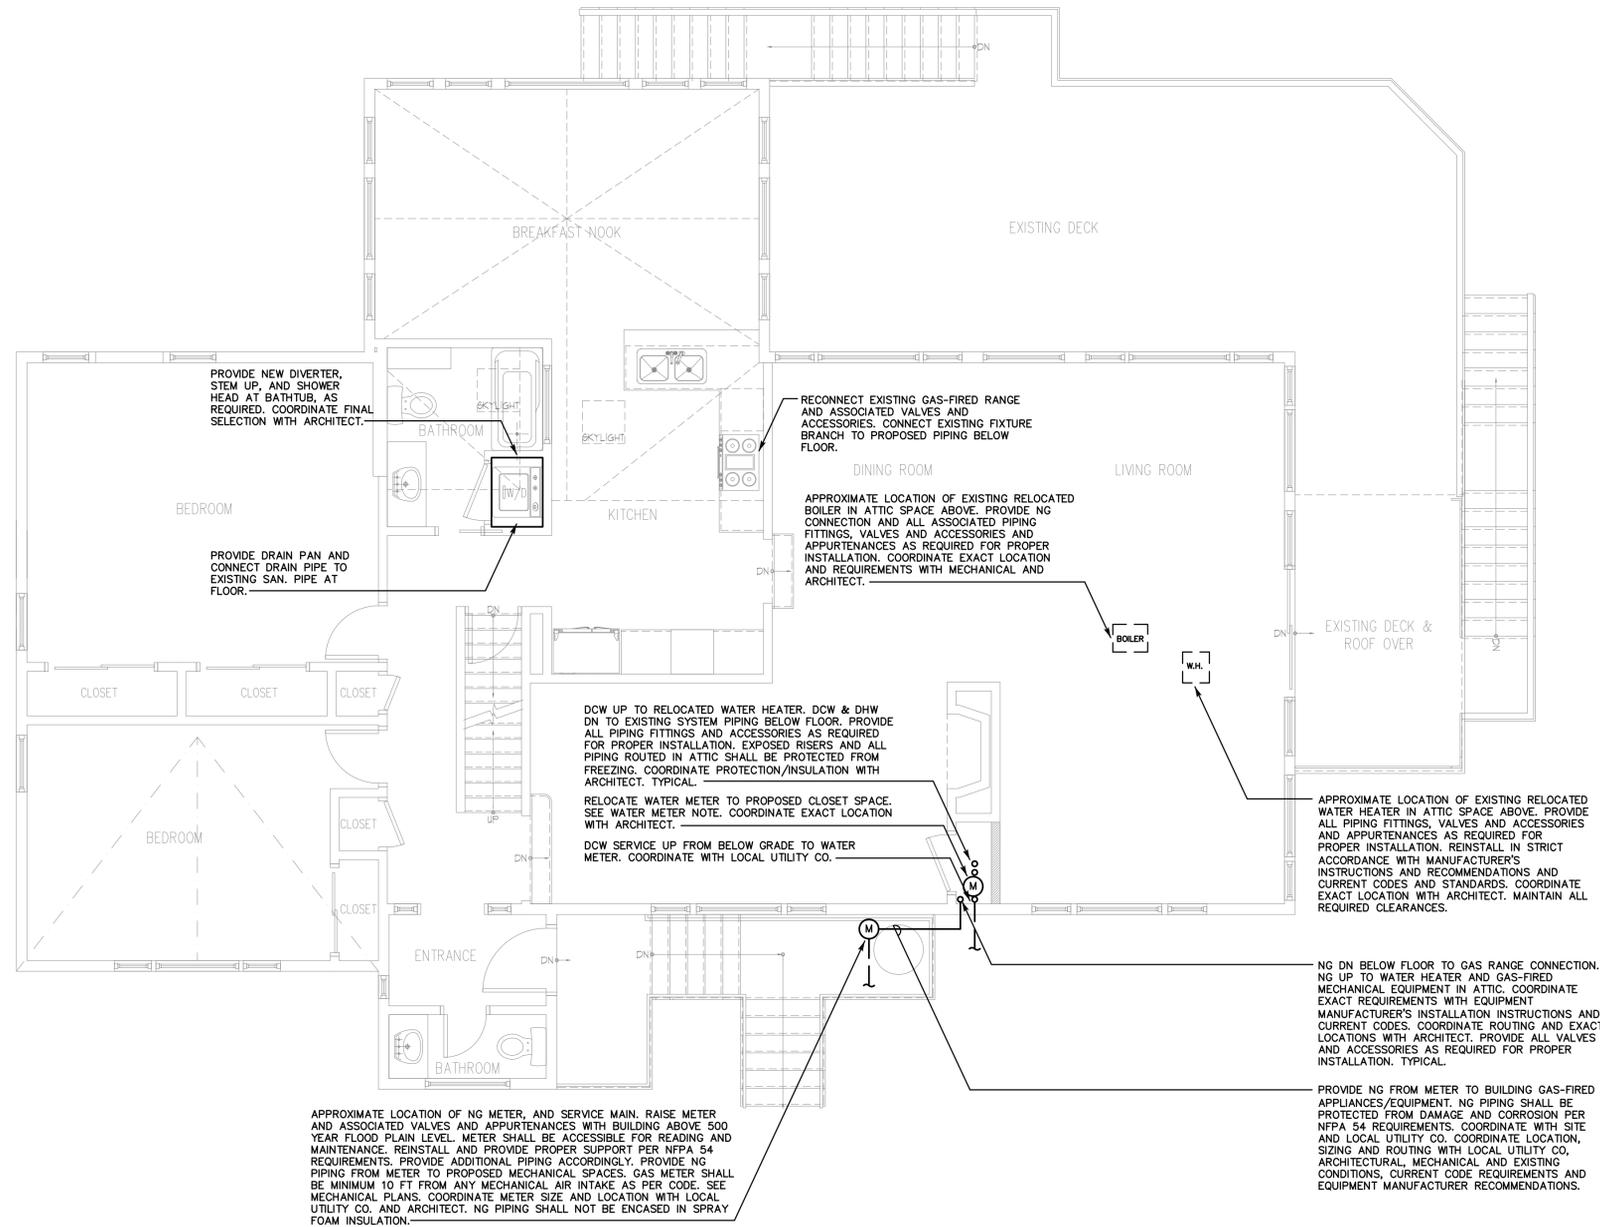

- PLUMBING GENERAL NOTES:**
- THE CONTRACTOR SHALL VISIT THE PROJECT SITE, PRIOR TO BIDDING, AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK INCLUDING TOOLS, MATERIAL, MANPOWER, ETC. REQUIRED FOR COMPLETE AND PROPER INSTALLATION OF PROPOSED MATERIALS, FIXTURES AND/OR EQUIPMENT.
 - ALL WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. TYPICAL.
 - CONTRACTOR SHALL PROVIDE CLEANOUTS FOR PROPOSED SANITARY PIPING AS REQUIRED PER CURRENT APPLICABLE CODES AND STANDARDS. TYPICAL.
 - ROUTING OF ALL PIPING SHALL BE COORDINATED WITH STRUCTURAL FRAMING ELEMENTS AND ALL OTHER PROJECT DISCIPLINES. TYPICAL.
 - PROVIDE DOUBLE CHECK VALVE BACKFLOW PREVENTER AND PRESSURE REDUCING VALVE ON DOMESTIC WATER SERVICE AS REQUIRED PER LOCAL WATER AUTHORITY AND CURRENT CODES AND STANDARDS.
 - CONTRACTOR SHALL CONFIRM COMPATIBILITY OF SPRAY FOAM INSULATION WITH EXISTING SANITARY PVC/CPVC/ABS PIPING.
 - CONTRACTOR SHALL CONFIRM COMPATIBILITY OF SPRAY FOAM INSULATION WITH PEX PIPING WHERE APPLICABLE.
 - NO VALVES SHALL BE ENCASED IN SPRAY FOAM INSULATION.
 - PROVIDE CONDENSATE DRAINAGE FOR DOMESTIC WATER HEATER AND BOILER. PROVIDE PER MANUFACTURER'S REQUIREMENTS. COORDINATE WITH MECHANICAL. PROVIDE CONDENSATE PUMPS WHERE REQUIRED TO ROUTE TO LAUNDRY SINK. EXISTING AIR HANDLER CONDENSATE SHALL BE EXTENDED. COORDINATE WITH MECHANICAL AND ARCHITECTURAL. TYPICAL.

WATER METER NOTE:
EXISTING WATER METER AND ASSOCIATED VALVES AND ACCESSORIES TO BE RELOCATED. COORDINATE LOCATION WITH ARCHITECT. EXISTING UNDERGROUND DOMESTIC WATER SUPPLY MAIN TO BE EXTENDED TO PROPOSED LOCATION. PROVIDE DOMESTIC COLD WATER SUPPLY MAIN IN BUILDING TO CONNECT TO EXISTING DCW SUPPLIES AND PROPOSED LOCATION OF EXISTING HOT WATER HEATER. PROVIDE ALL PIPING, FITTINGS, VALVES AND CONNECTIONS AS REQUIRED FOR PROPER SYSTEM INSTALLATION/REINSTALLATION. INSULATE PIPING. EXPOSED RISERS SHALL BE PROTECTED FROM FREEZING. COORDINATE PROTECTION/INSULATION WITH ARCHITECT. COORDINATE METER WITH ARCHITECT AND LOCAL UTILITY CO.

CLOTHES WASHER/LAUNDRY NOTE:
REINSTALL APPLIANCES PER MANUFACTURER'S INSTRUCTIONS AND CURRENT CODES. PROVIDE LAUNDRY OUTLET BOX AT WALL. PROVIDE DOMESTIC WATER, WASTE AND VENT CONNECTIONS AND ASSOCIATED VALVES AND ACCESSORIES TO AND FROM RELOCATED LAUNDRY APPLIANCES AND LAUNDRY SINK. PROVIDE CONNECTION TO NEAREST EXISTING PIPING OF EQUAL OR GREATER SIZE BELOW FIRST FLOOR. PROVIDE ALL PIPING AS REQUIRED FOR CONNECTION TO EXISTING. PROVIDE PAN AND STANDPIPE PER CURRENT CODES AND STANDARDS. PROVIDE VENT CONNECTION. MAINTAIN REQUIRED DISTANCES FROM MECHANICAL EQUIPMENT INTAKES. COORDINATE FIXTURE/APPLIANCE LOCATION WITH ARCHITECT. RECONNECT ACCORDINGLY. TYPICAL.

NOTES:
INSULATE PROPOSED DOMESTIC WATER SYSTEM PIPING WITHIN BUILDING INTERIOR WITH MIN. R-4.


COORDINATE ALL PIPING ROUTING WITH ARCHITECTURAL AND ALL OTHER PROJECT DISCIPLINES. PIPING SHALL BE INSTALLED PER CURRENT CODES AND STANDARDS. TYPICAL.

ALL DOMESTIC WATER & SANITARY PIPING EXTERIOR RISERS SHALL BE PROTECTED FROM IMPACTS, FREEZING, AND WEATHER. COORDINATE PROTECTION WITH STRUCTURAL DRAWINGS. INSULATION WITH ARCHITECTURAL DRAWINGS, AND HEAT TRACE WITH ELECTRICAL DRAWINGS.

ALL NG PIPING EXTERIOR RISERS SHALL BE PROTECTED FROM IMPACTS AND WEATHER. COORDINATE PROTECTION WITH STRUCTURAL DRAWINGS.

FIRST FLOOR PLUMBING PLAN

SCALE: 1/4"=1'-0"

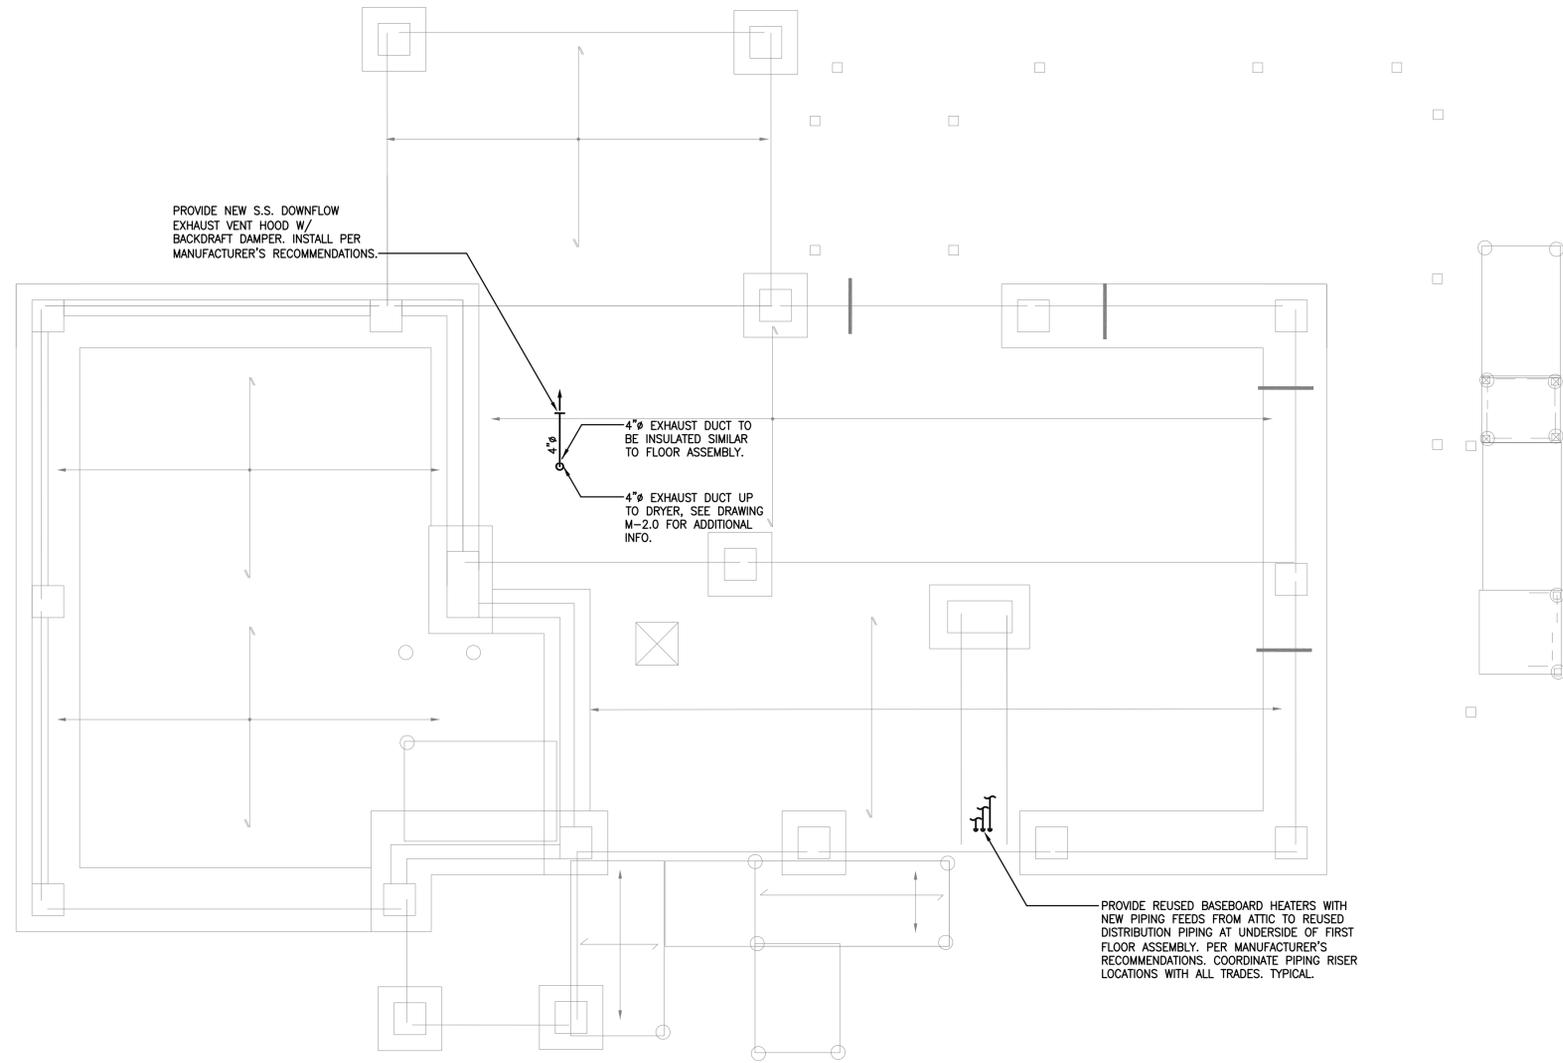

BASEMENT MECHANICAL PLAN

SCALE: 1/4"=1'-0"

- MECHANICAL GENERAL NOTES:**
1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE, PRIOR TO BIDDING, AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
 2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK INCLUDING TOOLS, MATERIAL, MANPOWER, ETC. REQUIRED FOR COMPLETE AND PROPER INSTALLATION OF PROPOSED MATERIALS, FIXTURES AND/OR EQUIPMENT.
 3. ALL WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. TYPICAL.
 4. CONTRACTOR SHALL PROVIDE NEW PIPING TO CONNECT TO RELOCATED BOILER IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND AS REQUIRED PER CURRENT APPLICABLE CODES AND STANDARDS. TYPICAL.
 5. ROUTING OF ALL PIPING SHALL BE COORDINATED WITH STRUCTURAL FRAMING ELEMENTS AND ALL OTHER PROJECT DISCIPLINES. TYPICAL.
 6. CONTRACTOR TO MAINTAIN ALL MECHANICAL EQUIPMENT AND ACCESSORIES BE INSTALLED AT MIN. 1'-0" ABOVE THE 100 YEAR BASE FLOOD ELEVATION, PER LOCAL CODE REQUIREMENTS.
 7. ALL BASEBOARD HEATER PIPING IN JOIST BAYS OF THE FIRST FLOOR ASSEMBLY TO BE INSULATED SIMILAR TO FLOOR ASSEMBLY. TYPICAL.
 8. CONTRACTOR SHALL CONFIRM COMPATIBILITY OF SPRAY FOAM INSULATION WITH PEX PIPING WHERE APPLICABLE.
 9. NO VALVES SHALL BE ENCASED IN SPRAY FOAM INSULATION.

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 287-8728
 Fax: (860) 287-8728

© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 PROPOSED BASEMENT MECHANICAL PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet
M-1.0	

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 267-8728
 Fax: (860) 267-8728


© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 PROPOSED FIRST FLOOR MECHANICAL PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet
M-2.0	

- MECHANICAL GENERAL NOTES:**
1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE, PRIOR TO BIDDING, AND BECOME INFORMED AS TO THE NATURE AND SCOPE OF WORK REQUIRED, NOTING AND ACCOUNTING FOR EXISTING CONDITIONS. TYPICAL.
 2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK INCLUDING TOOLS, MATERIAL, MANPOWER, ETC. REQUIRED FOR COMPLETE AND PROPER INSTALLATION OF PROPOSED MATERIALS, FIXTURES AND/OR EQUIPMENT.
 3. ALL WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. TYPICAL.
 4. CONTRACTOR SHALL PROVIDE NEW PIPING TO CONNECT TO RELOCATED BOILER IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND AS REQUIRED PER CURRENT APPLICABLE CODES AND STANDARDS. TYPICAL.
 5. ROUTING OF ALL PIPING SHALL BE COORDINATED WITH STRUCTURAL FRAMING ELEMENTS AND ALL OTHER PROJECT DISCIPLINES. TYPICAL.
 6. CONTRACTOR TO MAINTAIN ALL MECHANICAL EQUIPMENT AND ACCESSORIES BE INSTALLED AT MIN. 1'-0" ABOVE THE 100 YEAR BASE FLOOD ELEVATION, PER LOCAL CODE REQUIREMENTS.
 7. ALL BASEBOARD HEATER PIPING IN JOIST BAYS OF THE FIRST FLOOR ASSEMBLY TO BE INSULATED SIMILAR TO FLOOR ASSEMBLY. TYPICAL.
 8. CONTRACTOR SHALL CONFIRM COMPATIBILITY OF SPRAY FOAM INSULATION WITH PEX PIPING WHERE APPLICABLE.
 9. NO VALVES SHALL BE ENCASED IN SPRAY FOAM INSULATION.
 10. CONTRACTOR TO PROVIDE A MOUNTING PLATFORM FOR THE CONDENSING UNIT IN COORDINATION WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AND DETAILS. PLATFORM SHALL MEET OR EXCEED MANUFACTURER'S RECOMMENDATIONS, APPLICABLE CODES, AND STANDARDS. TYPICAL.

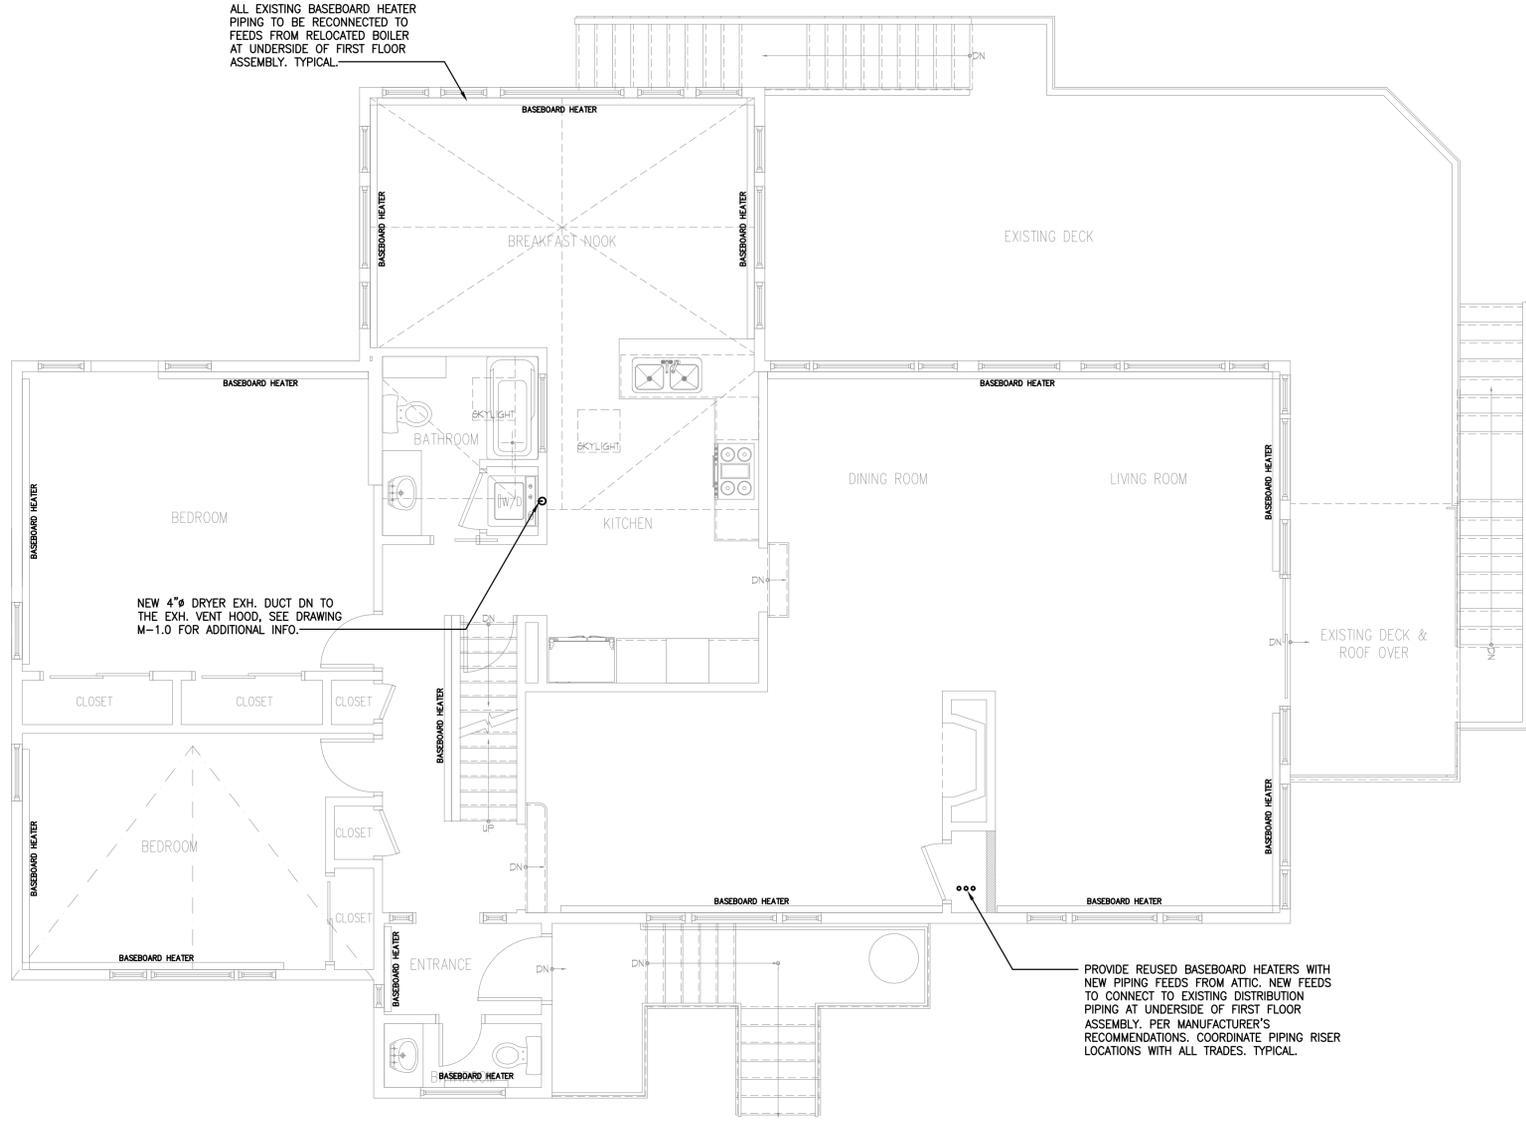

FIRST FLOOR MECHANICAL PLAN
 SCALE: 1/4" = 1'-0"

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 267-8728
 Fax: (860) 267-8728


© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEEED CIRCLE
 STAMFORD CT, 06902
 ATTIC FLOOR PROPOSED MECHANICAL PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet
M-3.0	

- GENERAL PROPOSED MECHANICAL NOTES:**
- CONTRACTOR TO PROVIDE FIRE DAMPERS IF REQUIRED, COORDINATE WITH ARCHITECTURAL CODE SHEET.
 - CONTRACTOR TO SEAL ALL PENETRATIONS OF THE AIR DISTRIBUTION SYSTEM TO REDUCE LEAKAGE PER HUD CPD GREEN BUILDING RETROFIT CHECKLIST.
 - CONTRACTOR TO PROVIDE ALL NEW REPLACEMENT REGISTERS AND GRILLES THROUGHOUT THE FIRST AND SECOND FLOORS. NEW REGISTERS AND GRILLES TO HAVE ADJUSTABLE VOLUME DAMPERS, AS WELL AS EQUIVALENT FREE NET AREA TO THOSE REPLACED.
 - CONTRACTOR TO MAINTAIN A MINIMUM 10'-0" DISTANCE BETWEEN ANY AIR INTAKE AND THE GAS METER.
 - CONTRACTOR TO MAINTAIN MANUFACTURER'S RECOMMENDED DISTANCE BETWEEN DIRECT VENTS.
 - CONTRACTOR TO MAINTAIN A MINIMUM 10'-0" DISTANCE BETWEEN ANY AIR INTAKE AND BATHROOM EXHAUST.
 - ALL DUCTWORK IN JOIST BAYS OF THE FIRST FLOOR ASSEMBLY TO BE INSULATED SIMILAR TO FLOOR ASSEMBLY.
 - ALL DUCTWORK BELOW JOISTS OF FIRST FLOOR ASSEMBLY TO BE ENCLOSED WITH 2" OF INSULATION WRAP WITH WATERPROOF BARRIER, INSTALLED PER LOCAL CODE REQUIREMENTS AND MANUFACTURER'S RECOMMENDATIONS.
 - CONTRACTOR TO PROVIDE A MIN. OF 1" INSULATION WRAP ON THE FIRST 10'-0" OF SUPPLY AND RETURN DUCTWORK FROM THE UNIT.
 - CONTRACTOR TO MAINTAIN THAT ALL DUCTWORK AND DUCTWORK ACCESSORIES BE INSTALLED AT MIN. 1'-0" ABOVE THE 100 YEAR BASE FLOOD ELEVATION, PER LOCAL CODE REQUIREMENTS.

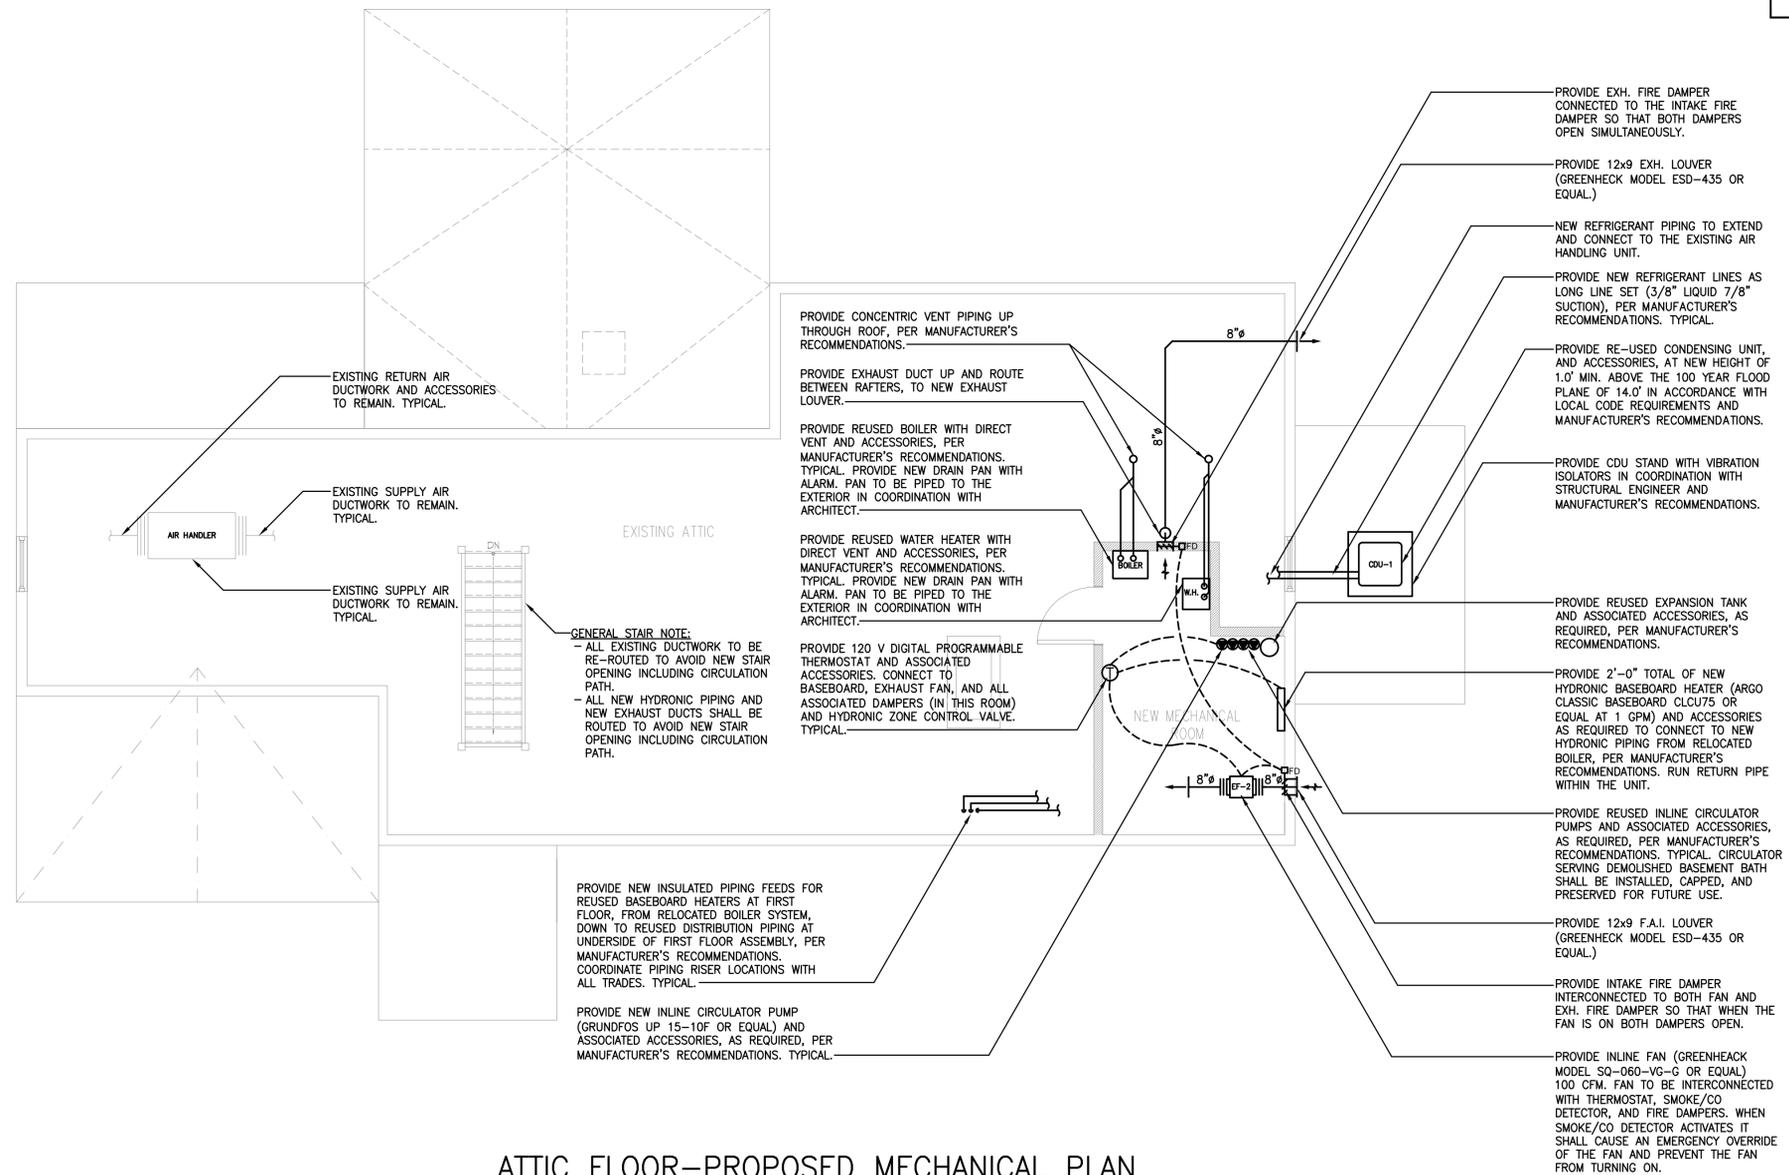

ATTIC FLOOR-PROPOSED MECHANICAL PLAN
 SCALE: 1/4"=1'-0"

ELECTRICAL GENERAL NOTES

- UNLESS OTHERWISE INDICATED, PROVIDE A COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM INCLUDING ALL NECESSARY MATERIAL, LABOR AND EQUIPMENT.
- ELECTRICAL PLANS AND DETAILS AND ONE LINE DIAGRAMS SHOW THE GENERAL LOCATION AND ARRANGEMENT OF THE ELECTRICAL SYSTEM. THEY ARE DIAGRAMMATIC AND DO NOT SHOW ALL CONDUIT BODIES, CONNECTORS, BENDS, FITTINGS, HANGERS AND ADDITIONAL PULL AND JUNCTION BOXES REQUIRED FOR INSTALLATION.
- ALL EQUIPMENT AND MATERIAL SHALL BE LABELED, LISTED AND INSTALLED IN ACCORDANCE WITH THEIR LISTING.
- THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS AND ARRANGE FOR ALL REQUIRED INSPECTIONS IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.
- ALL WORK SHALL BE DONE WITH LICENSED WORKMEN IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES.
- ALL WORK SHALL BE DONE IN ACCORDANCE WITH 2011 NATIONAL ELECTRIC CODE (NEC) ANSI/NFPA 70, NFPA 72, NFPA 101.
- THE TERM "INDICATED" SHALL MEAN "AS SHOWN ON CONTRACT DOCUMENTS (SPECIFICATIONS, DRAWINGS AND RELATED ATTACHMENTS)".
- THE TERM "PROVIDE" SHALL MEAN "TO FURNISH, INSTALL AND CONNECT COMPLETELY".
- THE TERM "SIZE" SHALL MEAN ONE OR MORE OF THE FOLLOWING: LENGTH, CURRENT AND VOLTAGE RATING, NUMBER OF POLES, NEMA SIZE AND OTHER SIMILAR ELECTRICAL CHARACTERISTICS.
- ELECTRICAL PLANS AND DETAILS DO NOT SHOW ALL INTERFERENCES AND CONDITIONS, VISIBLE AND/OR HIDDEN, THAT MAY EXIST; THUS REQUIRING THE CONTRACTOR TO INSPECT AND SURVEY THE SPACE BEFORE PERFORMING THE WORK.
- BEFORE SELECTING MATERIAL AND EQUIPMENT, AND PROCEEDING WITH WORK, INSPECT AREAS WHERE MATERIAL AND EQUIPMENT ARE TO BE INSTALLED TO INSURE SUITABILITY, AND CHECK NEEDED SPACE FOR PLACEMENT, CLEARANCES AND INTERCONNECTIONS.
- BEFORE CUTTING OR DRILLING INTO BUILDING ELEMENTS, INSPECT AND LAUNCH WORK TO AVOID DAMAGING STRUCTURAL ELEMENTS AND BUILDING UTILITIES.
- CONTRACTOR SHALL OBTAIN AND PAY FOR ALL LOCAL UTILITY COMPANIES CHARGES FOR DISCONNECTION AND RECONNECTION OF SERVICES.

WASHER / DRYER NOTES:

- CONTRACTOR SHALL PROVIDE 30A, 4W RECEPTACLE FOR DRYER. PROVIDE #10/3 WITH GND FOR CONNECTION TO 30A/2P CIRCUIT BREAKER IN LOAD CENTER.
- CONTRACTOR SHALL PROVIDE DUPLEX RECEPTACLE FOR WASHER. PROVIDE #12/2 WITH GND FOR CONNECTION TO 20A/1P CIRCUIT BREAKER IN LOAD CENTER.

ELECTRICAL NOTES:

- THE CONTRACTOR(S) SHALL VISIT THE PROJECT SITE PRIOR TO BIDDING, NOTING EXISTING CONDITIONS AND EQUIPMENT. IF SAID IS NOT BEING REMOVED AS PART OF PROJECT OR IS NOTED AS EXISTING TO REMAIN AND IMPEDS PROVIDING PROPOSED EQUIPMENT AND/OR PROVIDING PROPOSED SCOPE OF WORK, EQUIPMENT SHALL BE TEMPORARILY RELOCATED AND COMPLETELY REINSTALLED AFTER PROPOSED SCOPE OF WORK IS COMPLETED. THIS SHALL BE PART OF BASE BID AND CONTRACTOR'S SHALL BID ACCORDINGLY, NO ADDITIONAL COMPENSATION WILL BE CONSIDERED FOR RELATED WORK OF COORDINATION WITH EXISTING CONDITIONS.
- REMOVE AND PROPERLY DISPOSE OF EQUIPMENT AND ASSOCIATED COMPONENTS/ACCESSORIES AS INDICATED ON DEMOLITION PLANS. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. TYPICAL.
- CONTRACTOR SHALL NOT DAMAGE ANY EXISTING EQUIPMENT, PIPING, OR ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK INCLUDING TOOLS, MATERIAL, MANPOWER, ETC. REQUIRED FOR COMPLETE AND PROPER INSTALLATION OF PROPOSED MATERIALS, FIXTURES AND/OR EQUIPMENT.
- DO NOT DISTURB ANY SUSPECTED HAZARDOUS MATERIALS. NOTIFY OWNERS REPRESENTATIVE OF ANY SUSPECTED MATERIALS IMPEDING PERFORMANCE OF WORK. TYPICAL.
- ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. COORDINATE WORK WITH ALL PROJECT DISCIPLINES AND EXISTING CONDITIONS. TYPICAL.

WIRING DEVICE NOTES:

- CONTRACTOR SHALL COORDINATE RECEPTACLE AND SWITCH COLORS WITH ARCHITECT PRIOR TO ORDERING AND INSTALLATION. PROVIDE MATCHING COVER PLATE. TYPICAL.
- CONTRACTOR SHALL PROVIDE RED EMERGENCY SWITCH COVER PLATE WITH ON /OFF DIRECTION FOR FURNACE AND HOT WATER HEATER CIRCUITS.

EXISTING CIRCUITS NOTES:

- CONTRACTOR SHALL EXTEND EXISTING BRANCH CIRCUITS TO PROPOSED PANEL EP RELOCATION POSITION PER NEC.
- UNDERSIDE OF FIRST FLOOR SHALL BE SPRAYED WITH FOAM INSULATION. ALL JUNCTION BOXES SHALL BE INSTALLED SUCH THAT THEY ARE ACCESSIBLE ONCE SPRAY FOAM INSULATION IS INSTALLED.
- WHERE JUNCTION BOXES WILL NOT BE ACCESSIBLE ONCE SPRAY FOAM INSULATION IS INSTALLED, CONTRACTOR SHALL REMOVE WIRING/CONDUIT TO NEXT ACCESSIBLE POINT/BOX AND PROVIDE AN ENTIRE SECTION OF WIRING/CONDUIT WITHOUT JUNCTION/SPLICE BOXES FROM ACCESSIBLE POINT/BOX BACK TO PANEL EP.
- ALL JUNCTION/SPLICE BOXES IN CRAWLSPACE SHALL BE WEATHERPROOF.
- ALL NON-METALLIC SHEATHED CABLE LOCATED IN CRAWL SPACE SHALL BE ROUTED WITHIN CONDUIT PER NEC REQUIREMENTS.
- ALL SERVICE ENTRANCE CABLE SHALL BE INSTALLED WITHIN CONDUIT PER NEC REQUIREMENTS.

WIRING NOTES:

- ALL WIRING SHALL BE COPPER THHN/THWN WITH EXCEPTION OF SERVICE ENTRANCE CONDUCTORS.
- CONTRACTOR MAY UTILIZE ALUMINUM WIRING FOR SERVICE ENTRANCE CONDUCTORS ONLY.
- ALL WIRING SHALL BE CONCEALED BEHIND WALL/CEILING SURFACES IN ALL FINISHED AREAS.

HEAT TRACE NOTES:

- CONTRACTOR SHALL PROVIDE 3 WATTS PER FOOT, LOW TEMP., SELF REGULATING HEAT TRACE (THERMOSTATICALLY CONTROLLED) FOR EXPOSED EXTERIOR COPPER DOMESTIC WATER SERVICE PIPING. COORDINATE LENGTH REQUIRED WITH PLUMBING CONTRACTOR. EMERSON FREEZE FREE WITH EH38 THERMOSTAT CONTROL.
- CONTRACTOR SHALL PROVIDE 5 WATTS PER FOOT, IN-LINE HEAT TRACE WITH THERMOSTAT FOR EXPOSED EXTERIOR PE TYPE DOMESTIC WATER SERVICE PIPING WITH PIPE SIZES OF 1" AND 1-1/4". ALL OTHER SIZES PROVIDE HEAT TRACE PER NOTES #1 ABOVE. COORDINATE LENGTH REQUIRED WITH PLUMBING CONTRACTOR. EMERSON EASY HEAT WITH SL22 CONTROL.
- PROVIDE ELECTRICAL CONNECTION AND INSTALL PER NEC AND MANUFACTURERS REQUIREMENTS. CONNECT TO PANEL CIRCUIT #22. PROVIDE 15A/1P CIRCUIT BREAKER FOR PANEL. PROVIDE 3-#14 AWG WITHIN CONDUIT.

ELECTRICAL PANEL NOTES:

- CONTRACTOR SHALL PROVIDE AFCI CIRCUIT BREAKERS FOR LOAD CENTER EP SERVING BEDROOM CIRCUITS (INCLUSIVE OF RECEPTACLE LIGHTING AND FIRE ALARM DEVICES). FIELD VERIFY QUANTITIES AND RATINGS REQUIRED.

ELECTRICAL SYMBOL LIST

	DUPLEX RECEPTACLE GFCI - GROUND FAULT CIRCUIT INTERRUPTER WP - WEATHERPROOF
	DRYER RECEPTACLE
	SWITCH (NONE) - SINGLE POLE 3 - THREE WAY 4 - FOUR WAY E - EMERGENCY TOL - THERMAL OVERLOAD PROTECTION DEVICE
	SPECIAL PURPOSE CONNECTION
	AC SMOKE DETECTOR WITH BATTERY BACKUP
	AC COMBINATION SMOKE AND CARBON MONOXIDE DETECTOR WITH BATTERY BACKUP
	LUMINAIRE - INTERIOR LETTER 'L' DENOTES FIXTURE TYPE
	DISCONNECT SWITCH


PROVIDE HARDWIRED AC COMBINATION SMOKE AND CARBON MONOXIDE DETECTOR WITH BATTERY BACK-UP. BRK SC5120B' OR EQUAL. ALL DETECTORS SHALL BE WIRED IN TANDEM. ACTIVATION OF ONE DETECTOR SHALL CAUSE ALL DETECTORS TO ACTIVATE. CONNECT TO PROPOSED SPARE 15A/1P CIRCUIT BREAKER IN PANEL EP. PROVIDE #14/3 AWG. TYPICAL.

PROVIDE 200A, 120/240V, 1PH, 3W, 42P, NEMA 1, MLO, FLUSH MOUNTED LOAD CENTER. PROVIDE #4/0 /3 WITH GND FROM LOAD CENTER EP TO SERVICE ENTRANCE MAIN DISCONNECT CIRCUIT BREAKER. PROVIDE LOAD CENTER WITH FOURTEEN (14) 15A/1P, FIFTEEN (15) 20A/1P, TWO (2) 60A/2P, TWO (2) 30A/2P AND ONE (1) 20A/2P CIRCUIT BREAKERS.

PROVIDE HARDWIRED SMOKE DETECTOR WITH BATTERY BACK-UP. BRK '9120B' OR EQUAL. ALL DETECTORS SHALL BE WIRED IN TANDEM. ACTIVATION OF ONE DETECTOR SHALL CAUSE ALL DETECTORS TO ACTIVATE. CONNECT TO PROPOSED SPARE 15A/1P CIRCUIT BREAKER IN PANE EP. PROVIDE #14/3 AWG. TYPICAL.

REINSTALL EXISTING LOCAL COMMUNICATIONS COMPANY (TELEPHONE AND CABLE TV) NETWORK INTERFACE EQUIPMENT AND ASSOCIATED WIRING. EXTEND/REPLACE EXISTING WIRING AS REQUIRED FOR RECONNECTIONS. COORDINATE WITH LOCAL COMMUNICATIONS COMPANY AS REQUIRED. TYPICAL.

PROVIDE MILBANK #U4721-0-BL METER SOCKET. MOUNT TOP OF METER AT SIX (6) FEET ABOVE FINISHED GRADE. PROVIDE SLIP JOINT AND EXTEND EXISTING UNDERGROUND CONDUIT AS REQUIRED FOR CONNECTION. PROVIDE 3-#2/0 AWG COPPER CONDUCTORS FROM METER SOCKET TO PAD MOUNTED TRANSFORMER. COORDINATE CONNECTION WITH LOCAL UTILITY COMPANY.

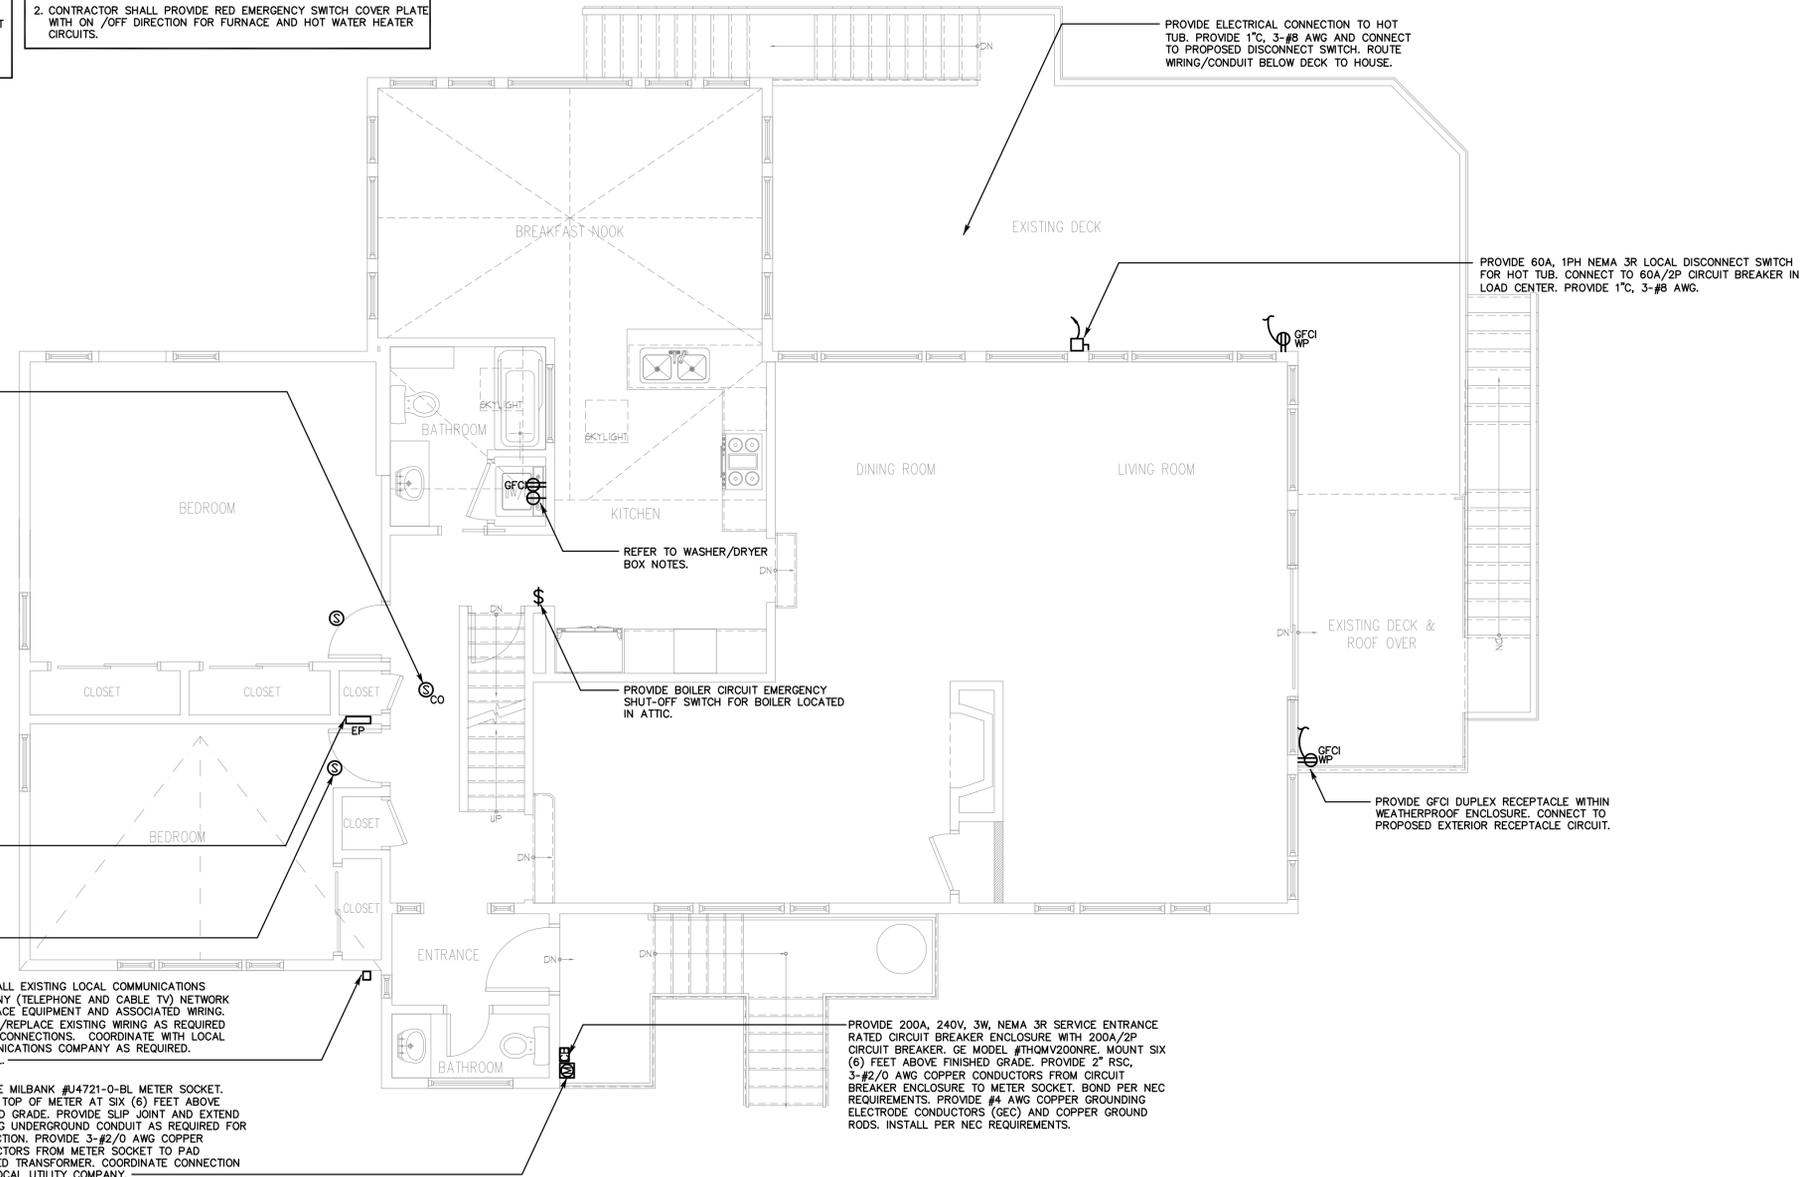

FIRST FLOOR ELECTRICAL PLAN

SCALE: 1/4"=1'-0"

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
CONSULTING ENGINEERS
118 North Plain Industrial Road
Wallingford, Connecticut 06495
Tel: (860) 267-8728
Fax: (860) 267-8728

© ARIS CRIST AIA 2015.
THIS TECHNICAL DRAWING AND
THE ARCHITECTURAL WORK
DEPICTED ARE COPYRIGHTED BY
ARIS CRIST AIA

Aris Crist Architects
34 East Putnam Avenue
Greenwich, Connecticut 06830
203 661 0661

RESIDENCE No. 2097
3 WEEED CIRCLE
STAMFORD CT, 06902
FIRST FLOOR ELECTRICAL PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet

E-1.0

- ELECTRICAL NOTES:**
1. THE CONTRACTOR(S) SHALL VISIT THE PROJECT SITE PRIOR TO BIDDING, NOTING EXISTING CONDITIONS AND EQUIPMENT. IF SAID IS NOT BEING REMOVED AS PART OF PROJECT OR IS NOTED AS EXISTING TO REMAIN AND IMPEDS PROVIDING PROPOSED EQUIPMENT AND/OR PROVIDING PROPOSED SCOPE OF WORK, EQUIPMENT SHALL BE TEMPORARILY RELOCATED AND COMPLETELY REINSTALLED AFTER PROPOSED SCOPE OF WORK IS COMPLETED. THIS SHALL BE PART OF BASE BID AND CONTRACTOR'S SHALL BID ACCORDINGLY, NO ADDITIONAL COMPENSATION WILL BE CONSIDERED FOR RELATED WORK OF COORDINATION WITH EXISTING CONDITIONS.
 2. REMOVE AND PROPERLY DISPOSE OF EQUIPMENT AND ASSOCIATED COMPONENTS/ACCESSORIES AS INDICATED ON DEMOLITION PLANS. PROPERLY DISPOSE OF ALL DEMOLITION DEBRIS AS REQUIRED BY FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. TYPICAL.
 3. CONTRACTOR SHALL NOT DAMAGE ANY EXISTING EQUIPMENT, PIPING, OR ASSOCIATED ACCESSORIES WHICH ARE TO REMAIN. ANY SUCH ITEMS DAMAGED SHALL BE REPLACED AT CONTRACTOR'S EXPENSE. TYPICAL.
 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK INCLUDING TOOLS, MATERIAL, MANPOWER, ETC. REQUIRED FOR COMPLETE AND PROPER INSTALLATION OF PROPOSED MATERIALS, FIXTURES AND/OR EQUIPMENT.
 5. DO NOT DISTURB ANY SUSPECTED HAZARDOUS MATERIALS. NOTIFY OWNERS REPRESENTATIVE OF ANY SUSPECTED MATERIALS IMPEDING PERFORMANCE OF WORK. TYPICAL.
 6. ALL DEMOLITION WORK SHALL BE PERFORMED IN A SAFE AND ORDERLY MANNER WITH QUALIFIED AND LICENSED PERSONNEL IN ACCORDANCE WITH STATE AND LOCAL GOVERNING AUTHORITIES AND ALL APPLICABLE CODES AND STANDARDS. COORDINATE WORK WITH ALL PROJECT DISCIPLINES AND EXISTING CONDITIONS. TYPICAL.

- EXISTING CIRCUITS NOTES:**
1. CONTRACTOR SHALL EXTEND EXISTING BRANCH CIRCUITS TO PROPOSED PANEL EP RELOCATION POSITION PER NEC.
 2. UNDERSIDE OF FIRST FLOOR SHALL BE SPRAYED WITH FOAM INSULATION. ALL JUNCTION BOXES SHALL BE INSTALLED SUCH THAT THEY ARE ACCESSIBLE ONCE SPRAY FOAM INSULATION IS INSTALLED.
 3. WHERE JUNCTION BOXES WILL NO BE ACCESSIBLE ONCE SPRAY FOAM INSULATION IS INSTALLED, CONTRACTOR SHALL REMOVE WIRING/CONDUIT TO NEXT ACCESSIBLE POINT/BOX AND PROVIDE AN ENTIRE SECTION OF WIRING/CONDUIT WITHOUT JUNCTION/SPLICE BOXES FROM ACCESSIBLE POINT/BOX BACK TO PANEL EP.
 4. ALL JUNCTION/SPLICE BOXES IN CRAWLSPACE SHALL BE WEATHERPROOF.
 5. ALL NON-METALLIC SHEATHED CABLE LOCATED IN CRAWL SPACE SHALL BE ROUTED WITHIN CONDUIT PER NEC REQUIREMENTS.
 6. ALL SERVICE ENTRANCE CABLE SHALL BE INSTALLED WITHIN CONDUIT PER NEC REQUIREMENTS.

- WIRING NOTES:**
1. ALL WIRING SHALL BE COPPER THHN/THWN WITH EXCEPTION OF SERVICE ENTRANCE CONDUCTORS.
 2. CONTRACTOR MAY UTILIZE ALUMINUM WIRING FOR SERVICE ENTRANCE CONDUCTORS ONLY.
 3. ALL WIRING SHALL BE CONCEALED BEHIND WALL/CEILING SURFACES IN ALL FINISHED AREAS.

- ELECTRICAL PANEL NOTES:**
1. CONTRACTOR SHALL PROVIDE AFCI CIRCUIT BREAKERS FOR LOAD CENTER EP SERVING BEDROOM CIRCUITS (INCLUSIVE OF RECEPTACLE, LIGHTING AND FIRE ALARM DEVICES). FIELD VERIFY QUANTITIES AND RATINGS REQUIRED.

- WIRING DEVICE NOTES:**
1. CONTRACTOR SHALL COORDINATE RECEPTACLE AND SWITCH COLORS WITH ARCHITECT PRIOR TO ORDERING AND INSTALLATION. PROVIDE MATCHING COVER PLATE. TYPICAL.
 2. CONTRACTOR SHALL PROVIDE RED EMERGENCY SWITCH COVER PLATE WITH ON /OFF DIRECTION FOR FURNACE AND HOT WATER HEATER CIRCUITS.

LIGHT FIXTURE SCHEDULE					
LTG. CODE	DESCRIPTIONS	VOLTS	CATALOG NO./ MANUFACTURER	MOUNTING	LAMP (G.E. OR EQUAL)
'A'	13W COMPACT FLUORESCENT KEYLESS LAMPHOLDER, IMPACT RESISTANT CONSTRUCTION WITH POLYCARBONATE GUARD. 900 LUMEN OUTPUT, ENERGY STAR QUALIFIED, WHITE FINISH. UL LISTED.	120	006-9860-LHG LEVITON OR EQUAL	SURFACE/ CEILING	(1) GU24 CFL
'B'	THREE LIGHT VANITY FIXTURE WITH BELL SHAPED MARBLEIZED GLASS SHADES, BRUSHED NICKEL FINISH. PROVIDE WITH 14W A19 SHAPED SELF BALLASTED COMPACT FLUORESCENT LAMPS. UL LISTED.	120	705075 HAMPTON BAY OR EQUAL	SURFACE/ WALL	(3) A19 STYLE CFL

Revisions	Date
Bid Set	04.10.15
Updated Bid Set	05.06.16

CONSULTANT:
SALAMONE & ASSOCIATES, P.C.
 CONSULTING ENGINEERS
 118 North Plain Industrial Road
 Wallingford, Connecticut 06495
 Phone: (860) 267-8728
 Fax: (860) 267-8728


© ARIS CRIST AIA 2015.
 THIS TECHNICAL DRAWING AND
 THE ARCHITECTURAL WORK
 DEPICTED ARE COPYRIGHTED BY
 ARIS CRIST AIA

Aris Crist Architects
 34 East Putnam Avenue
 Greenwich, Connecticut 06830
 203 661 0661

RESIDENCE No. 2097
3 WEED CIRCLE
 STAMFORD CT, 06902
 ATTIC FLOOR PROPOSED ELECTRICAL PLAN

JDB	Drawn
JAS	Checked
03.12.15	Date
AS NOTED	Scale
	Job Number
	Sheet

E-2.0

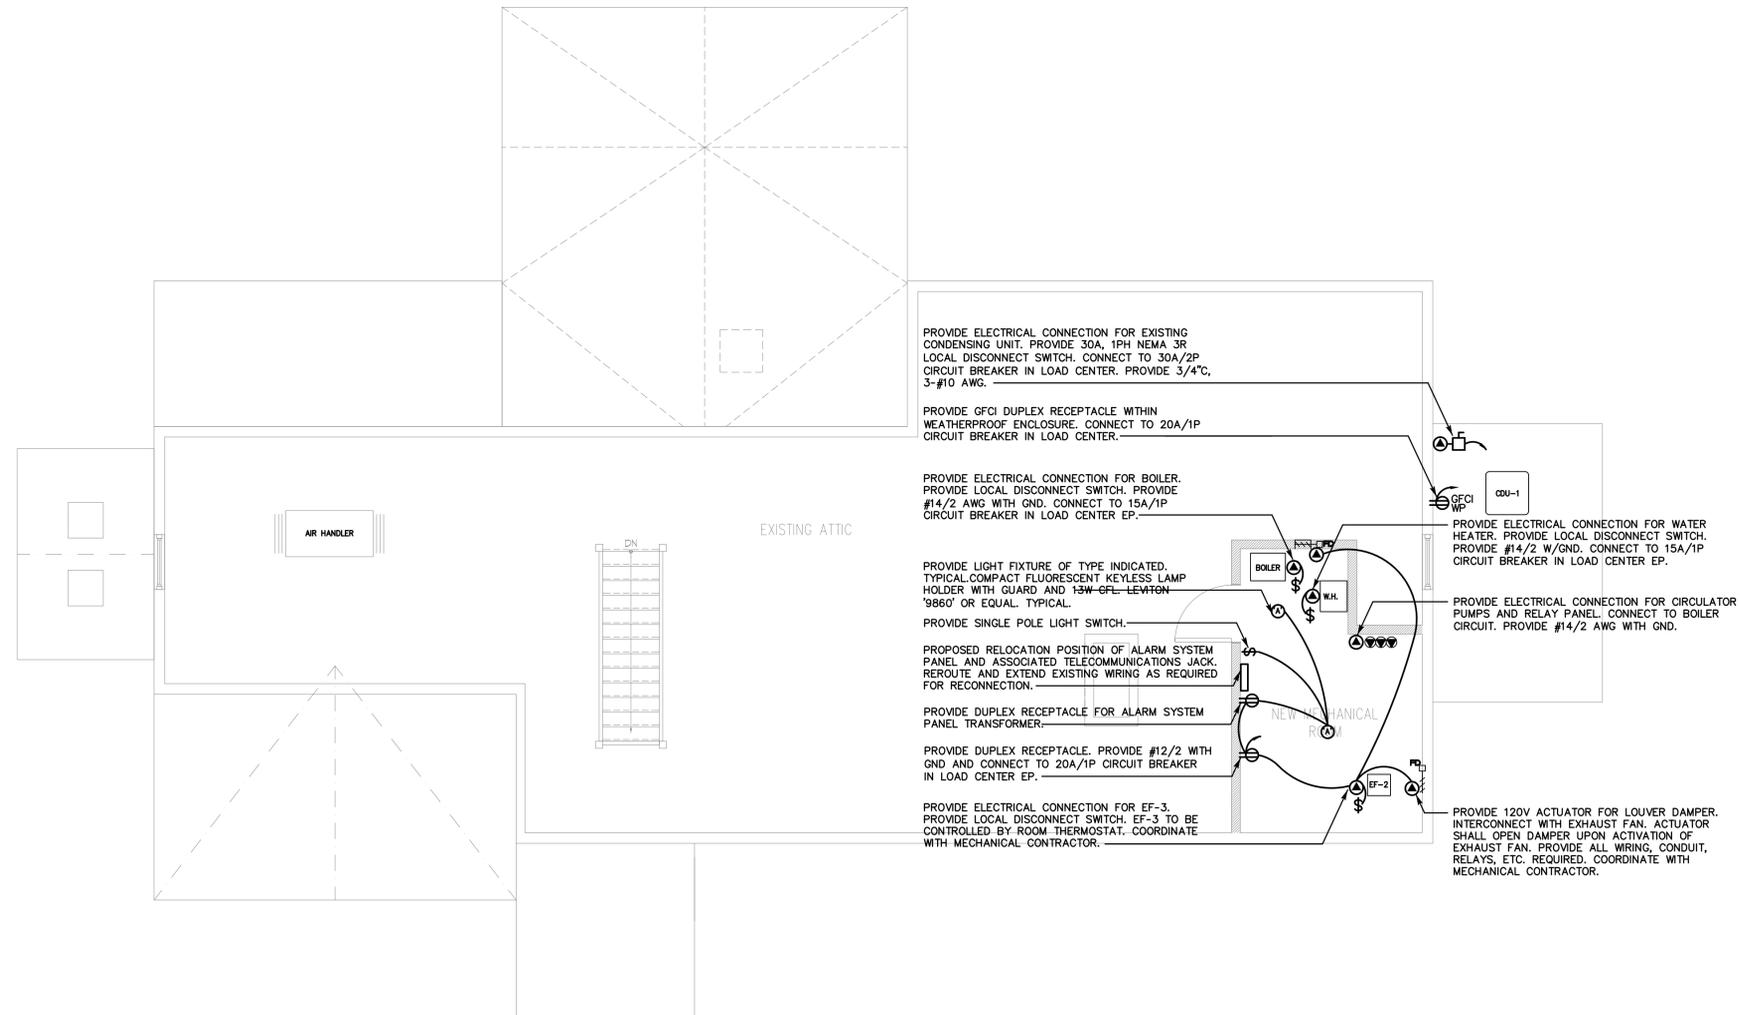

ATTIC FLOOR-PROPOSED ELECTRICAL PLAN

SCALE: 1/4"=1'-0"