





CONNECT TO EXISTING 6" WATER MAIN WITH 45° BEND

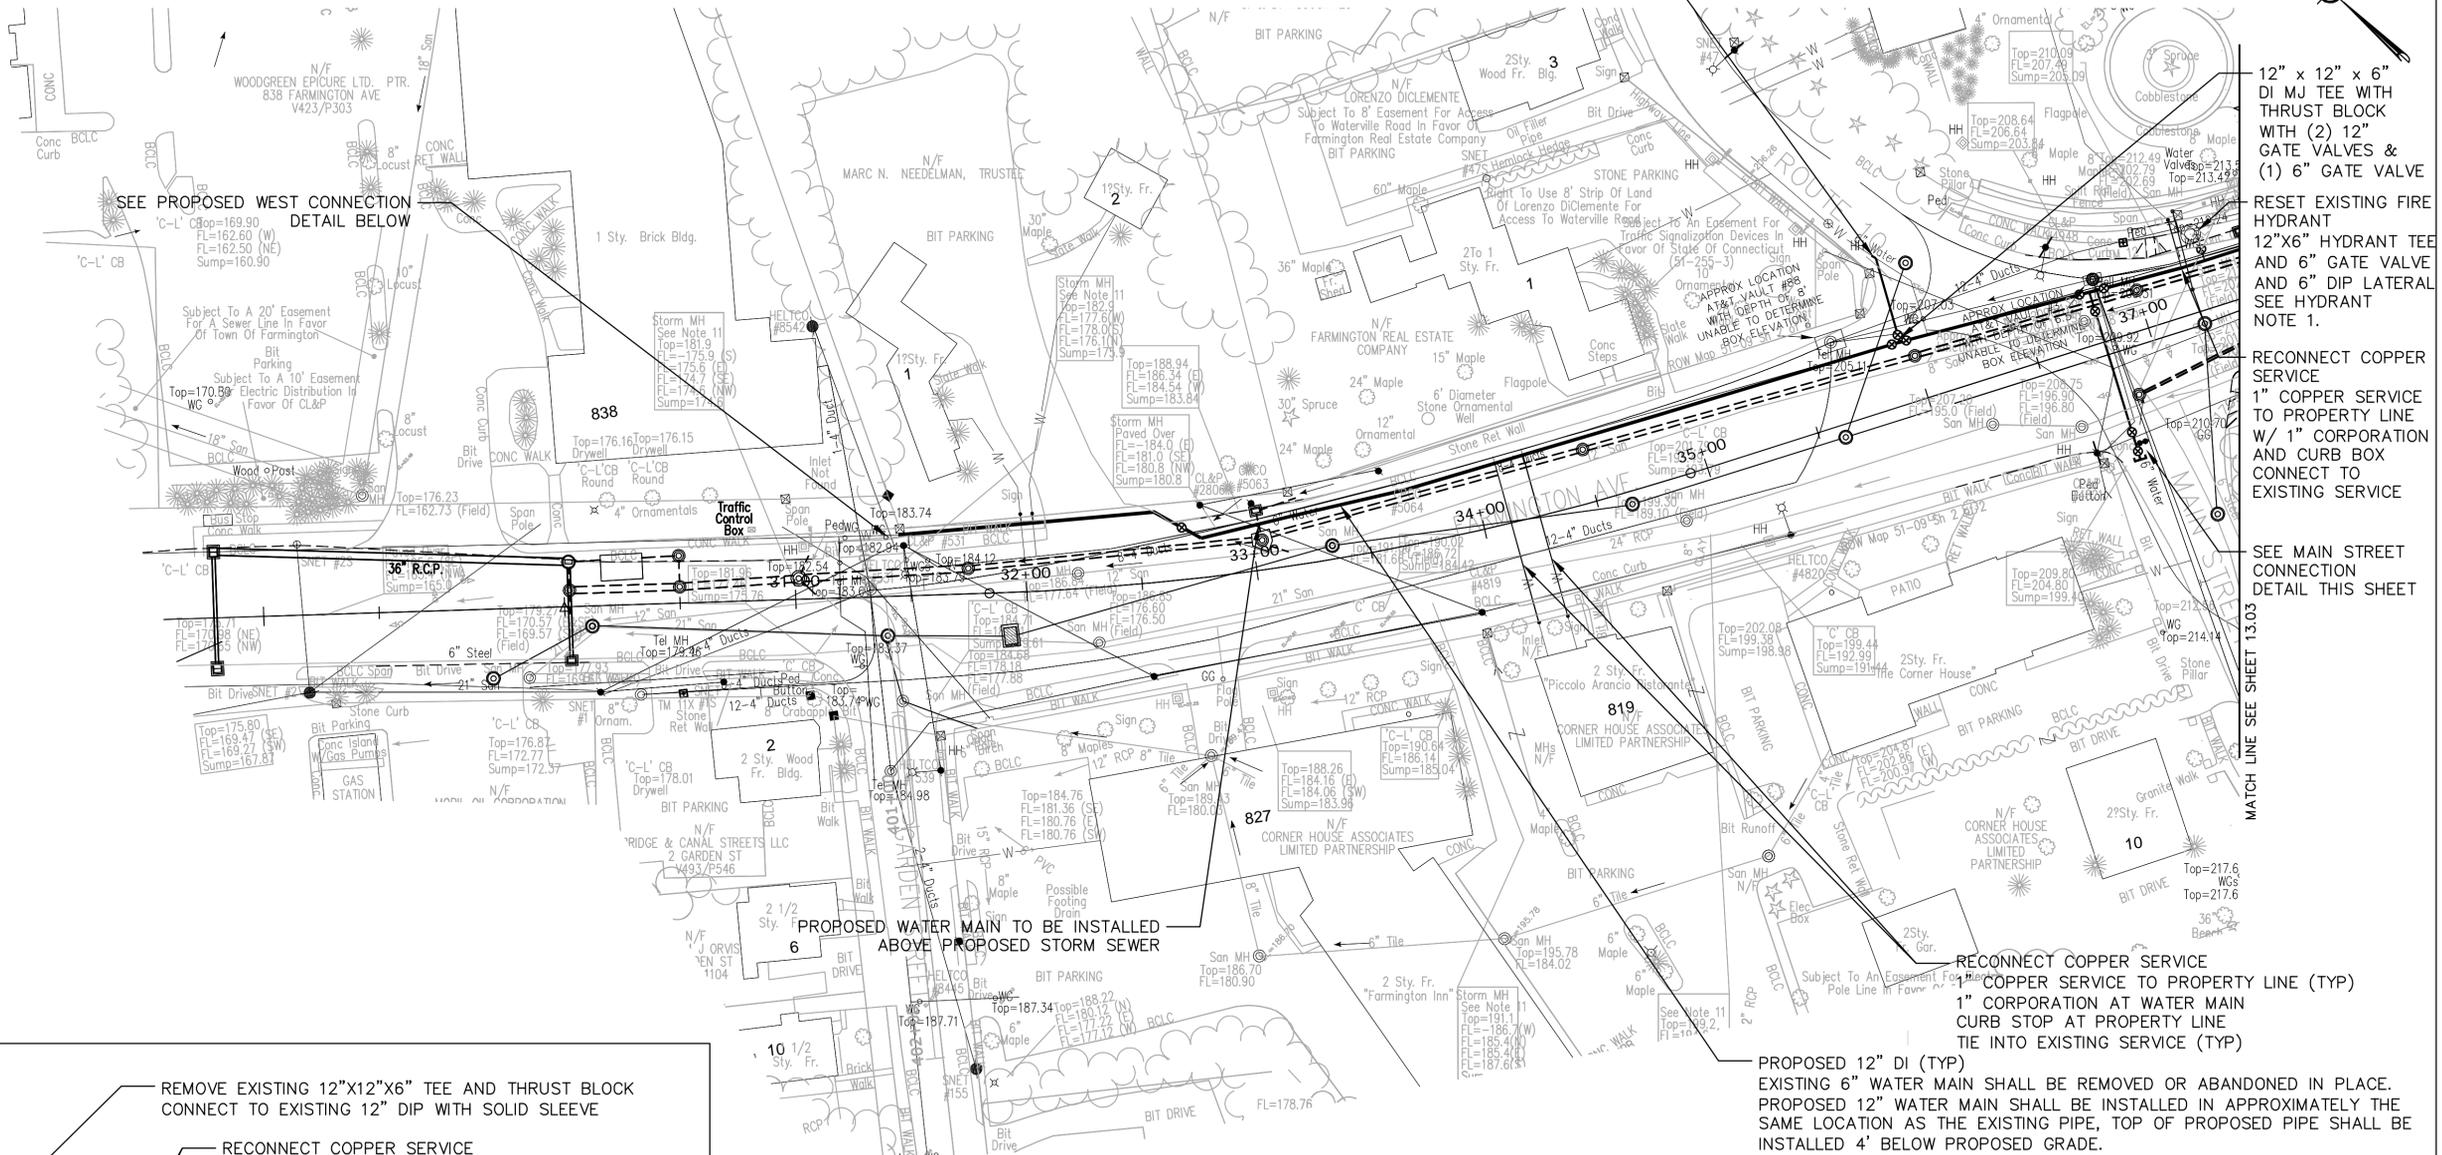

12" x 12" x 6" DI MJ TEE WITH THRUST BLOCK WITH (2) 12" GATE VALVES & (1) 6" GATE VALVE  
 RESET EXISTING FIRE HYDRANT 12"x6" HYDRANT TEE AND 6" GATE VALVE AND 6" DIP LATERAL SEE HYDRANT NOTE 1.  
 RECONNECT COPPER SERVICE 1" COPPER SERVICE TO PROPERTY LINE W/ 1" CORPORATION AND CURB BOX CONNECT TO EXISTING SERVICE  
 SEE MAIN STREET CONNECTION DETAIL THIS SHEET


MATCH LINE SEE SHEET 13.03

**NOTE:**  
 1. PIPING FROM CONNECTION AT STATION ±31+45 TO GATE VALVE AT STATION ±32+70 INCLUDING SERVICES, TO BE INSTALLED PRIOR TO ABANDONING OF EXISTING 6" WATER MAIN.

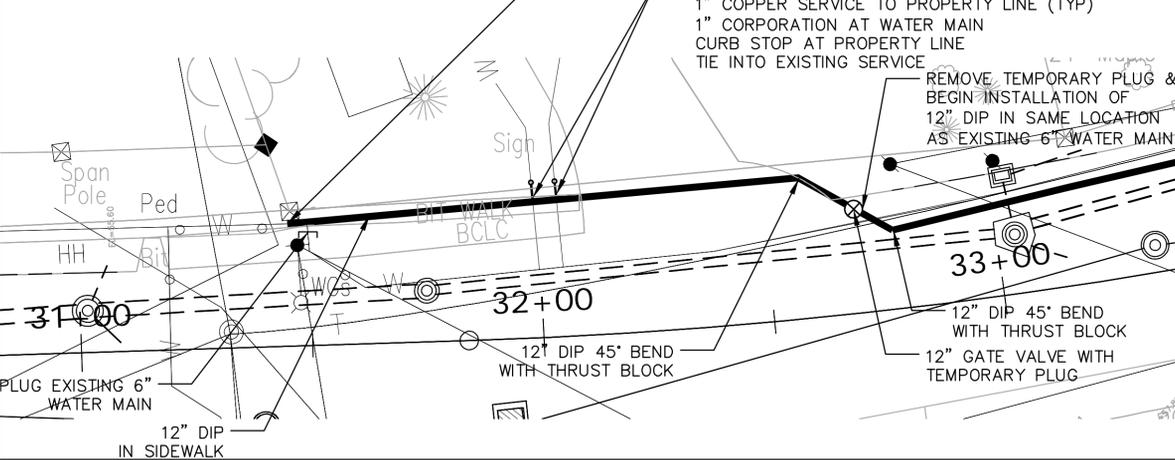

**PROPOSED WEST CONNECTION**  
 SCALE: 1"=20'

RECONNECT COPPER SERVICE 1" COPPER SERVICE TO PROPERTY LINE (TYP) 1" CORPORATION AT WATER MAIN CURB STOP AT PROPERTY LINE TIE INTO EXISTING SERVICE (TYP)  
 PROPOSED 12" DI (TYP) EXISTING 6" WATER MAIN SHALL BE REMOVED OR ABANDONED IN PLACE. PROPOSED 12" WATER MAIN SHALL BE INSTALLED IN APPROXIMATELY THE SAME LOCATION AS THE EXISTING PIPE, TOP OF PROPOSED PIPE SHALL BE INSTALLED 4' BELOW PROPOSED GRADE.

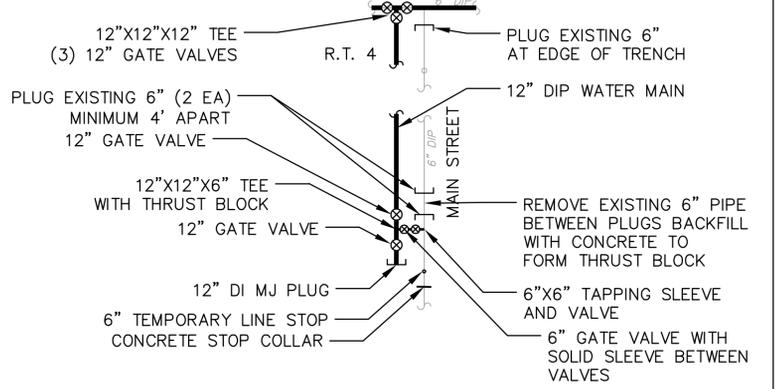

**MAIN STREET CONNECTION**  
 NTS

**HYDRANT NOTE:**

1. RESET EXISTING FIRE HYDRANT AT STATION AT 37+00± BEHIND CURB DURING STAGE 2. COORDINATE WITH INSTALLATION OF PROPOSED SIDEWALK AND CURBING.

REV.	DATE	REVISION DESCRIPTION	SHEET NO.

DESIGNER/DRAFTER:  
 CHECKED BY:  
 SCALE IN FEET  
 0 40 80  
 SCALE 1" = 40'

DESIGNED BY:  
**AECOM**  
 500 ENTERPRISE DRIVE  
 ROCKY HILL, CT 06067  
 1-(860)-529-8882




**ConnecticutWater**  
 93 WEST MAIN STREET  
 CLINTON, CT 06413  
 www.ctwater.com

PROJECT TITLE:  
**WATER MAIN REPLACEMENT  
 ON ROUTE 4 (FARMINGTON AVE) FROM  
 GARDEN ST. TO HIGH ST.**

TOWN:  
**FARMINGTON**  
 DRAWING TITLE:  
**WATER MAIN PLAN SHEET  
 STATION 31+00 TO 37+40**

PROJECT NO.  
**51-260**  
 DRAWING NO.  
**WTR-02**  
 SHEET NO.  
**13.02**

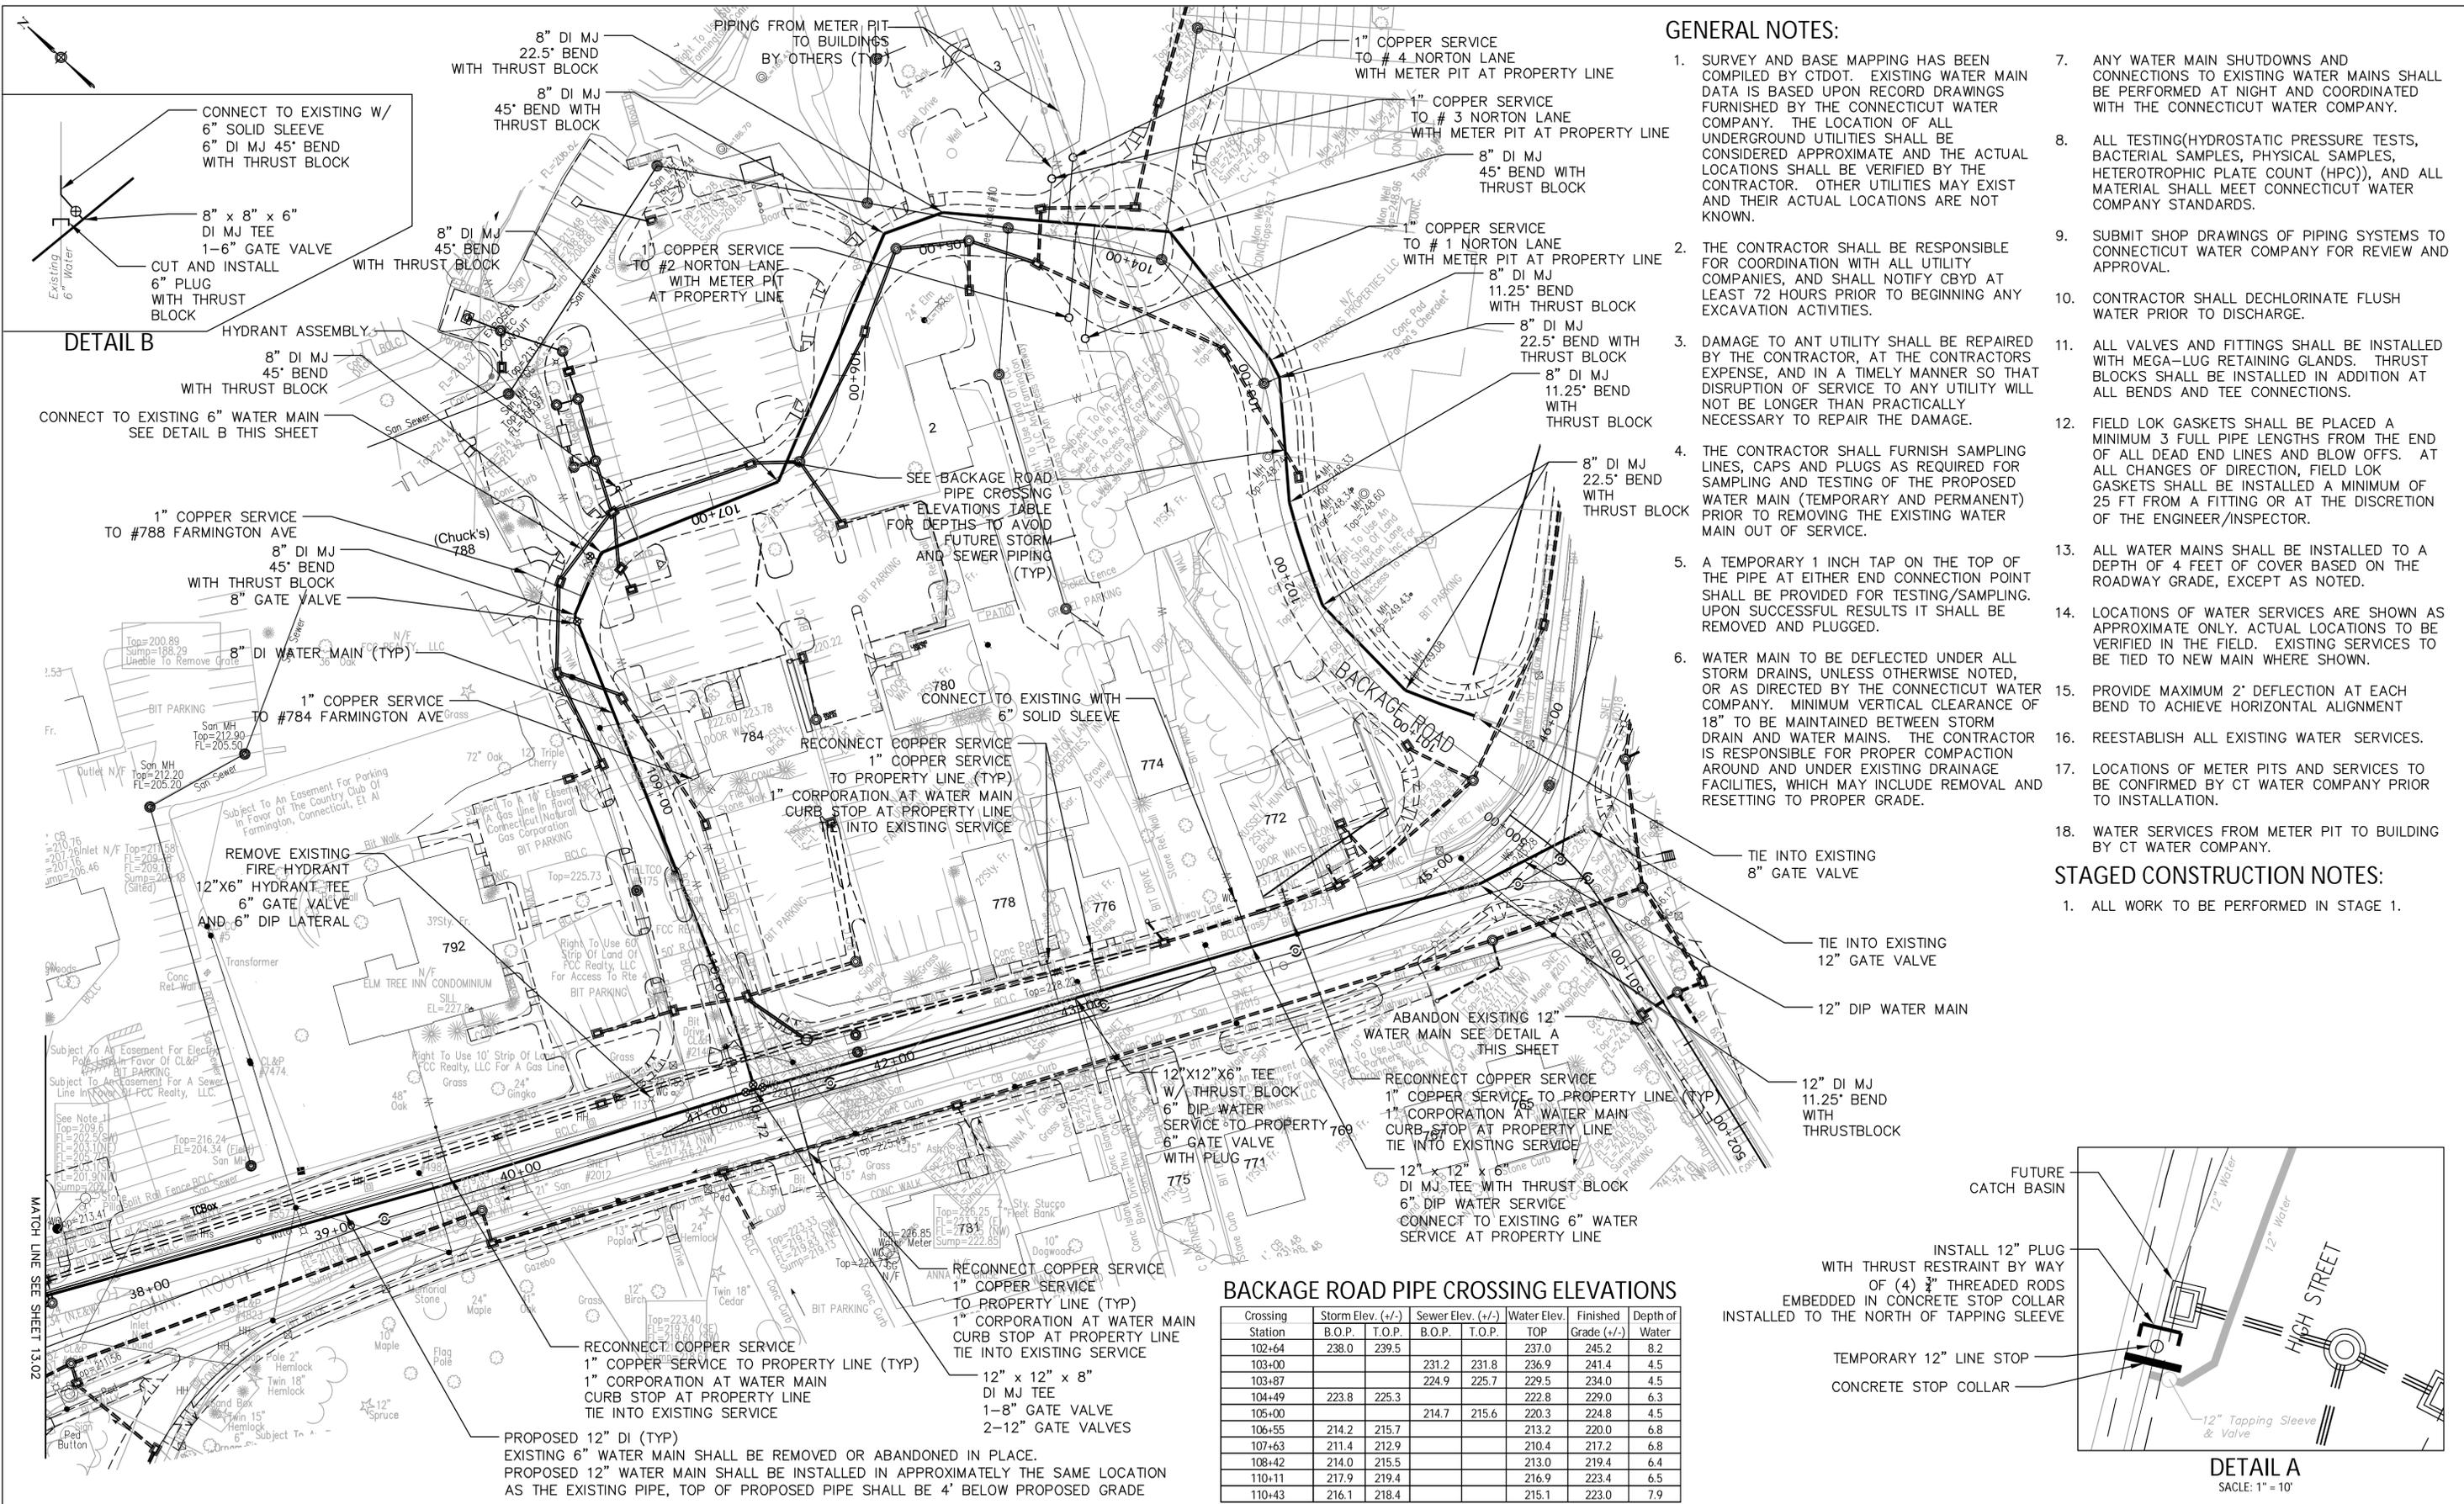



**GENERAL NOTES:**

1. SURVEY AND BASE MAPPING HAS BEEN COMPILED BY CTDOT. EXISTING WATER MAIN DATA IS BASED UPON RECORD DRAWINGS FURNISHED BY THE CONNECTICUT WATER COMPANY. THE LOCATION OF ALL UNDERGROUND UTILITIES SHALL BE CONSIDERED APPROXIMATE AND THE ACTUAL LOCATIONS SHALL BE VERIFIED BY THE CONTRACTOR. OTHER UTILITIES MAY EXIST AND THEIR ACTUAL LOCATIONS ARE NOT KNOWN.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION WITH ALL UTILITY COMPANIES, AND SHALL NOTIFY CBYD AT LEAST 72 HOURS PRIOR TO BEGINNING ANY EXCAVATION ACTIVITIES.
3. DAMAGE TO ANY UTILITY SHALL BE REPAIRED BY THE CONTRACTOR, AT THE CONTRACTORS EXPENSE, AND IN A TIMELY MANNER SO THAT DISRUPTION OF SERVICE TO ANY UTILITY WILL NOT BE LONGER THAN PRACTICALLY NECESSARY TO REPAIR THE DAMAGE.
4. THE CONTRACTOR SHALL FURNISH SAMPLING LINES, CAPS AND PLUGS AS REQUIRED FOR SAMPLING AND TESTING OF THE PROPOSED WATER MAIN (TEMPORARY AND PERMANENT) PRIOR TO REMOVING THE EXISTING WATER MAIN OUT OF SERVICE.
5. A TEMPORARY 1 INCH TAP ON THE TOP OF THE PIPE AT EITHER END CONNECTION POINT SHALL BE PROVIDED FOR TESTING/SAMPLING. UPON SUCCESSFUL RESULTS IT SHALL BE REMOVED AND PLUGGED.
6. WATER MAIN TO BE DEFLECTED UNDER ALL STORM DRAINS, UNLESS OTHERWISE NOTED, OR AS DIRECTED BY THE CONNECTICUT WATER COMPANY. MINIMUM VERTICAL CLEARANCE OF 18" TO BE MAINTAINED BETWEEN STORM DRAIN AND WATER MAINS. THE CONTRACTOR IS RESPONSIBLE FOR PROPER COMPACTION AROUND AND UNDER EXISTING DRAINAGE FACILITIES, WHICH MAY INCLUDE REMOVAL AND RESETTING TO PROPER GRADE.
7. ANY WATER MAIN SHUTDOWNS AND CONNECTIONS TO EXISTING WATER MAINS SHALL BE PERFORMED AT NIGHT AND COORDINATED WITH THE CONNECTICUT WATER COMPANY.
8. ALL TESTING (HYDROSTATIC PRESSURE TESTS, BACTERIAL SAMPLES, PHYSICAL SAMPLES, HETEROTROPHIC PLATE COUNT (HPC)), AND ALL MATERIAL SHALL MEET CONNECTICUT WATER COMPANY STANDARDS.
9. SUBMIT SHOP DRAWINGS OF PIPING SYSTEMS TO CONNECTICUT WATER COMPANY FOR REVIEW AND APPROVAL.
10. CONTRACTOR SHALL DECHLORINATE FLUSH WATER PRIOR TO DISCHARGE.
11. ALL VALVES AND FITTINGS SHALL BE INSTALLED WITH MEGA-LUG RETAINING GLANDS. THRUST BLOCKS SHALL BE INSTALLED IN ADDITION AT ALL BENDS AND TEE CONNECTIONS.
12. FIELD LOK GASKETS SHALL BE PLACED A MINIMUM 3 FULL PIPE LENGTHS FROM THE END OF ALL DEAD END LINES AND BLOW OFFS. AT ALL CHANGES OF DIRECTION, FIELD LOK GASKETS SHALL BE INSTALLED A MINIMUM OF 25 FT FROM A FITTING OR AT THE DISCRETION OF THE ENGINEER/INSPECTOR.
13. ALL WATER MAINS SHALL BE INSTALLED TO A DEPTH OF 4 FEET OF COVER BASED ON THE ROADWAY GRADE, EXCEPT AS NOTED.
14. LOCATIONS OF WATER SERVICES ARE SHOWN AS APPROXIMATE ONLY. ACTUAL LOCATIONS TO BE VERIFIED IN THE FIELD. EXISTING SERVICES TO BE TIED TO NEW MAIN WHERE SHOWN.
15. PROVIDE MAXIMUM 2" DEFLECTION AT EACH BEND TO ACHIEVE HORIZONTAL ALIGNMENT
16. REESTABLISH ALL EXISTING WATER SERVICES.
17. LOCATIONS OF METER PITS AND SERVICES TO BE CONFIRMED BY CT WATER COMPANY PRIOR TO INSTALLATION.
18. WATER SERVICES FROM METER PIT TO BUILDING BY CT WATER COMPANY.

**STAGED CONSTRUCTION NOTES:**

1. ALL WORK TO BE PERFORMED IN STAGE 1.

**DETAIL B**


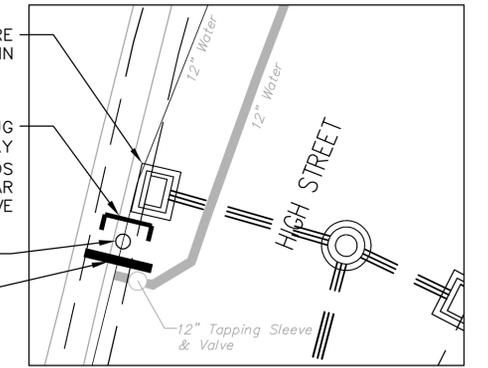
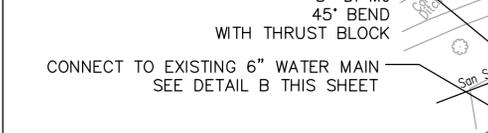


**BACKAGE ROAD PIPE CROSSING ELEVATIONS**

Crossing Station	Storm Elev. (+/-)		Sewer Elev. (+/-)		Water Elev. TOP	Finished Grade (+/-)	Depth of Water
	B.O.P.	T.O.P.	B.O.P.	T.O.P.			
102+64	238.0	239.5			237.0	245.2	8.2
103+00			231.2	231.8	236.9	241.4	4.5
103+87			224.9	225.7	229.5	234.0	4.5
104+49	223.8	225.3			222.8	229.0	6.3
105+00			214.7	215.6	220.3	224.8	4.5
106+55	214.2	215.7			213.2	220.0	6.8
107+63	211.4	212.9			210.4	217.2	6.8
108+42	214.0	215.5			213.0	219.4	6.4
110+11	217.9	219.4			216.9	223.4	6.5
110+43	216.1	218.4			215.1	223.0	7.9



<p>THE INFORMATION, INCLUDING ESTIMATED QUANTITIES OF WORK, SHOWN ON THESE SHEETS IS BASED ON LIMITED INVESTIGATIONS BY THE STATE AND IS IN NO WAY WARRANTED TO INDICATE THE CONDITIONS OF ACTUAL QUANTITIES OF WORK WHICH WILL BE REQUIRED.</p>	<p>DESIGNER/DRAFTER: CHECKED BY:</p>	<p>DESIGNED BY: <b>AECOM</b> 500 ENTERPRISE DRIVE ROCKY HILL, CT 06067 1-(860)-529-8882</p>		<p><b>Connecticut Water</b></p> <p>93 WEST MAIN STREET CLINTON, CT 06413 www.ctwater.com</p>	<p>PROJECT TITLE: <b>WATER MAIN REPLACEMENT ON ROUTE 4 (FARMINGTON AVE) FROM GARDEN ST. TO HIGH ST.</b></p>	<p>TOWN: <b>FARMINGTON</b></p> <p>DRAWING TITLE: <b>WATER MAIN PLAN SHEET STATION 37+40 TO 46+00</b></p>	<p>PROJECT NO. <b>51-260</b></p> <p>DRAWING NO. <b>WTR-03</b></p> <p>SHEET NO. <b>13.03</b></p>
<p>REV. DATE REVISION DESCRIPTION SHEET NO. Plotted Date: 05-07-2015</p>	<p>SCALE IN FEET 0 40 80 SCALE 1" = 40'</p>						

LEGEND	
x	EXISTING HYDRANT
WG	EXISTING GATE VALVE
x	TEMPORARY HYDRANT
—	TEMPORARY 4" BYPASS PIPE
- - - -	TEMPORARY PIPING DROP FOR STREET CROSSING

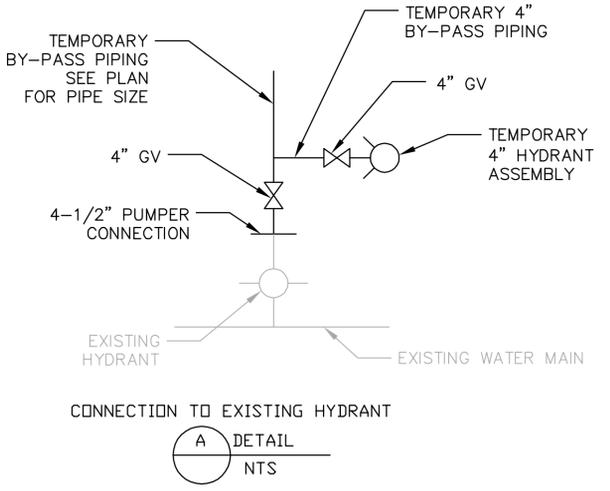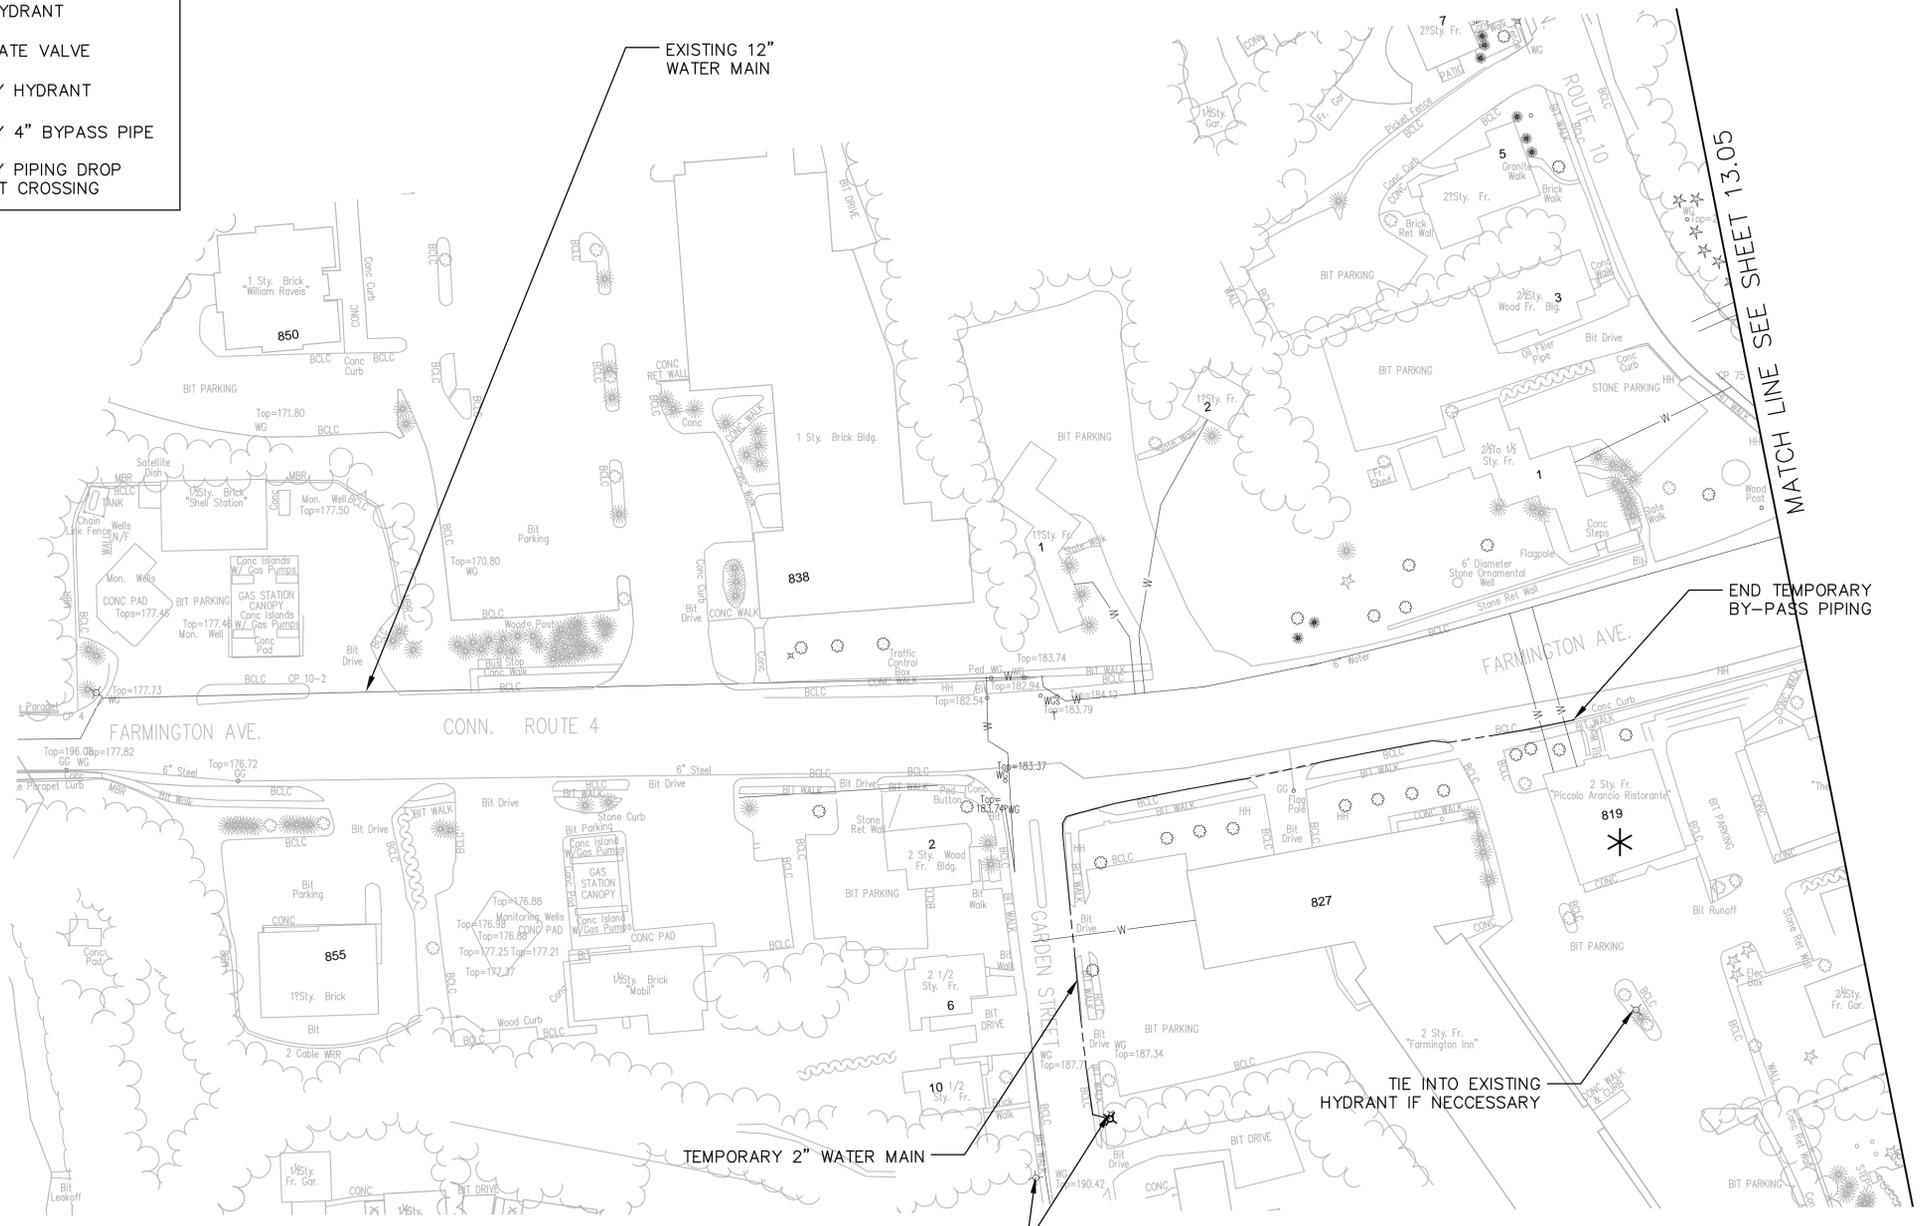

**CONSTRUCTION NOTES:**

1. REFER TO SECTION TECHNICAL SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS
2. INSTALL TEMPORARY WATER SERVICE IN ROADWAY GUTTER. SEE DETAIL B
3. THE CONTRACTOR SHALL PROVIDE TEMPORARY WATER SERVICE TO ALL BUILDINGS CURRENTLY CONNECTED TO MAINS TO BE SHUT OFF, IN ORDER TO FACILITATE THE WORK, MATCH EXISTING PIPE SIZE, BY MEANS OF TEMPORARY HOSE CONNECTIONS. THESE TEMPORARY SERVICE CONNECTIONS SHALL BE MADE TO SILL COCKS OUTSIDE THE BUILDINGS OR TO TEMPORARY CONNECTIONS AT THE METER INSIDE THE BUILDINGS, AS MAY BE REQUIRED OR DIRECTED. THE TEMPORARY HOSES SHALL GENERALLY BE LAID UP THE SIDE OF DRIVEWAYS, AND SHALL BE AS INCONSPICUOUS AS POSSIBLE FOR THE ENTIRE LENGTH.
4. TEMPORARY BYPASS PIPING WILL NOT BE ALLOWED BETWEEN NOVEMBER 1ST AND APRIL 1ST.
5. INSTALL ALL TEMPORARY BYPASS PIPING AND APPURTENANCES DURING STAGE 1.
6. REMOVE ALL TEMPORARY SERVICES UPON ACCEPTANCE OF WORK.

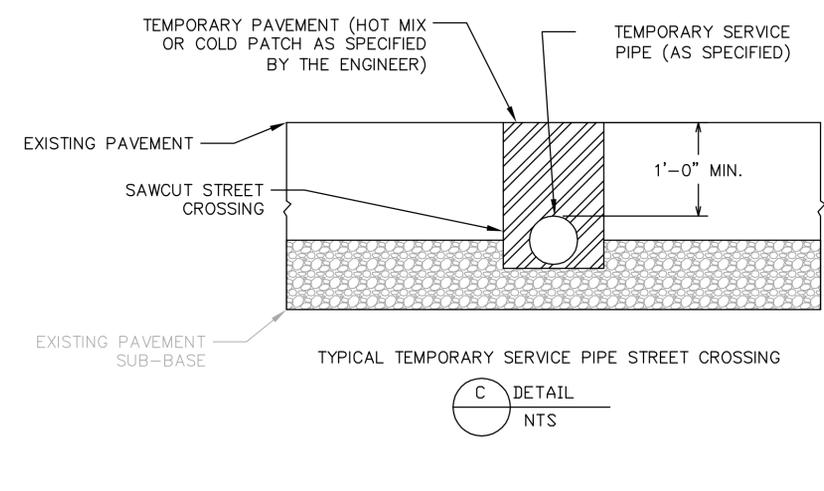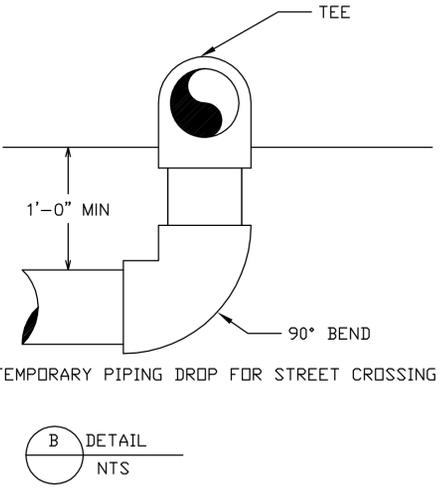

REV.	DATE	REVISION DESCRIPTION	SHEET NO.

DESIGNER/DRAFTER:	DESIGNED BY:
CHECKED BY:	
SCALE IN FEET	
0      40      80	
SCALE 1" = 40'	

**AECOM**  
 500 ENTERPRISE DRIVE  
 ROCKY HILL, CT 06067  
 1-(860)-529-8882





**ConnecticutWater**  
 93 WEST MAIN STREET  
 CLINTON, CT 06413  
 www.ctwater.com

PROJECT TITLE:  
**WATER MAIN REPLACEMENT  
 ON ROUTE 4 (FARMINGTON AVE) FROM  
 GARDEN ST. TO HIGH ST.**

TOWN:  
**FARMINGTON**  
 DRAWING TITLE:  
**TEMPORARY BYPASS PIPING  
 PLAN SHEET**

PROJECT NO.  
**51-260**  
 DRAWING NO.  
**WTR-04**  
 SHEET NO.  
**13.04**

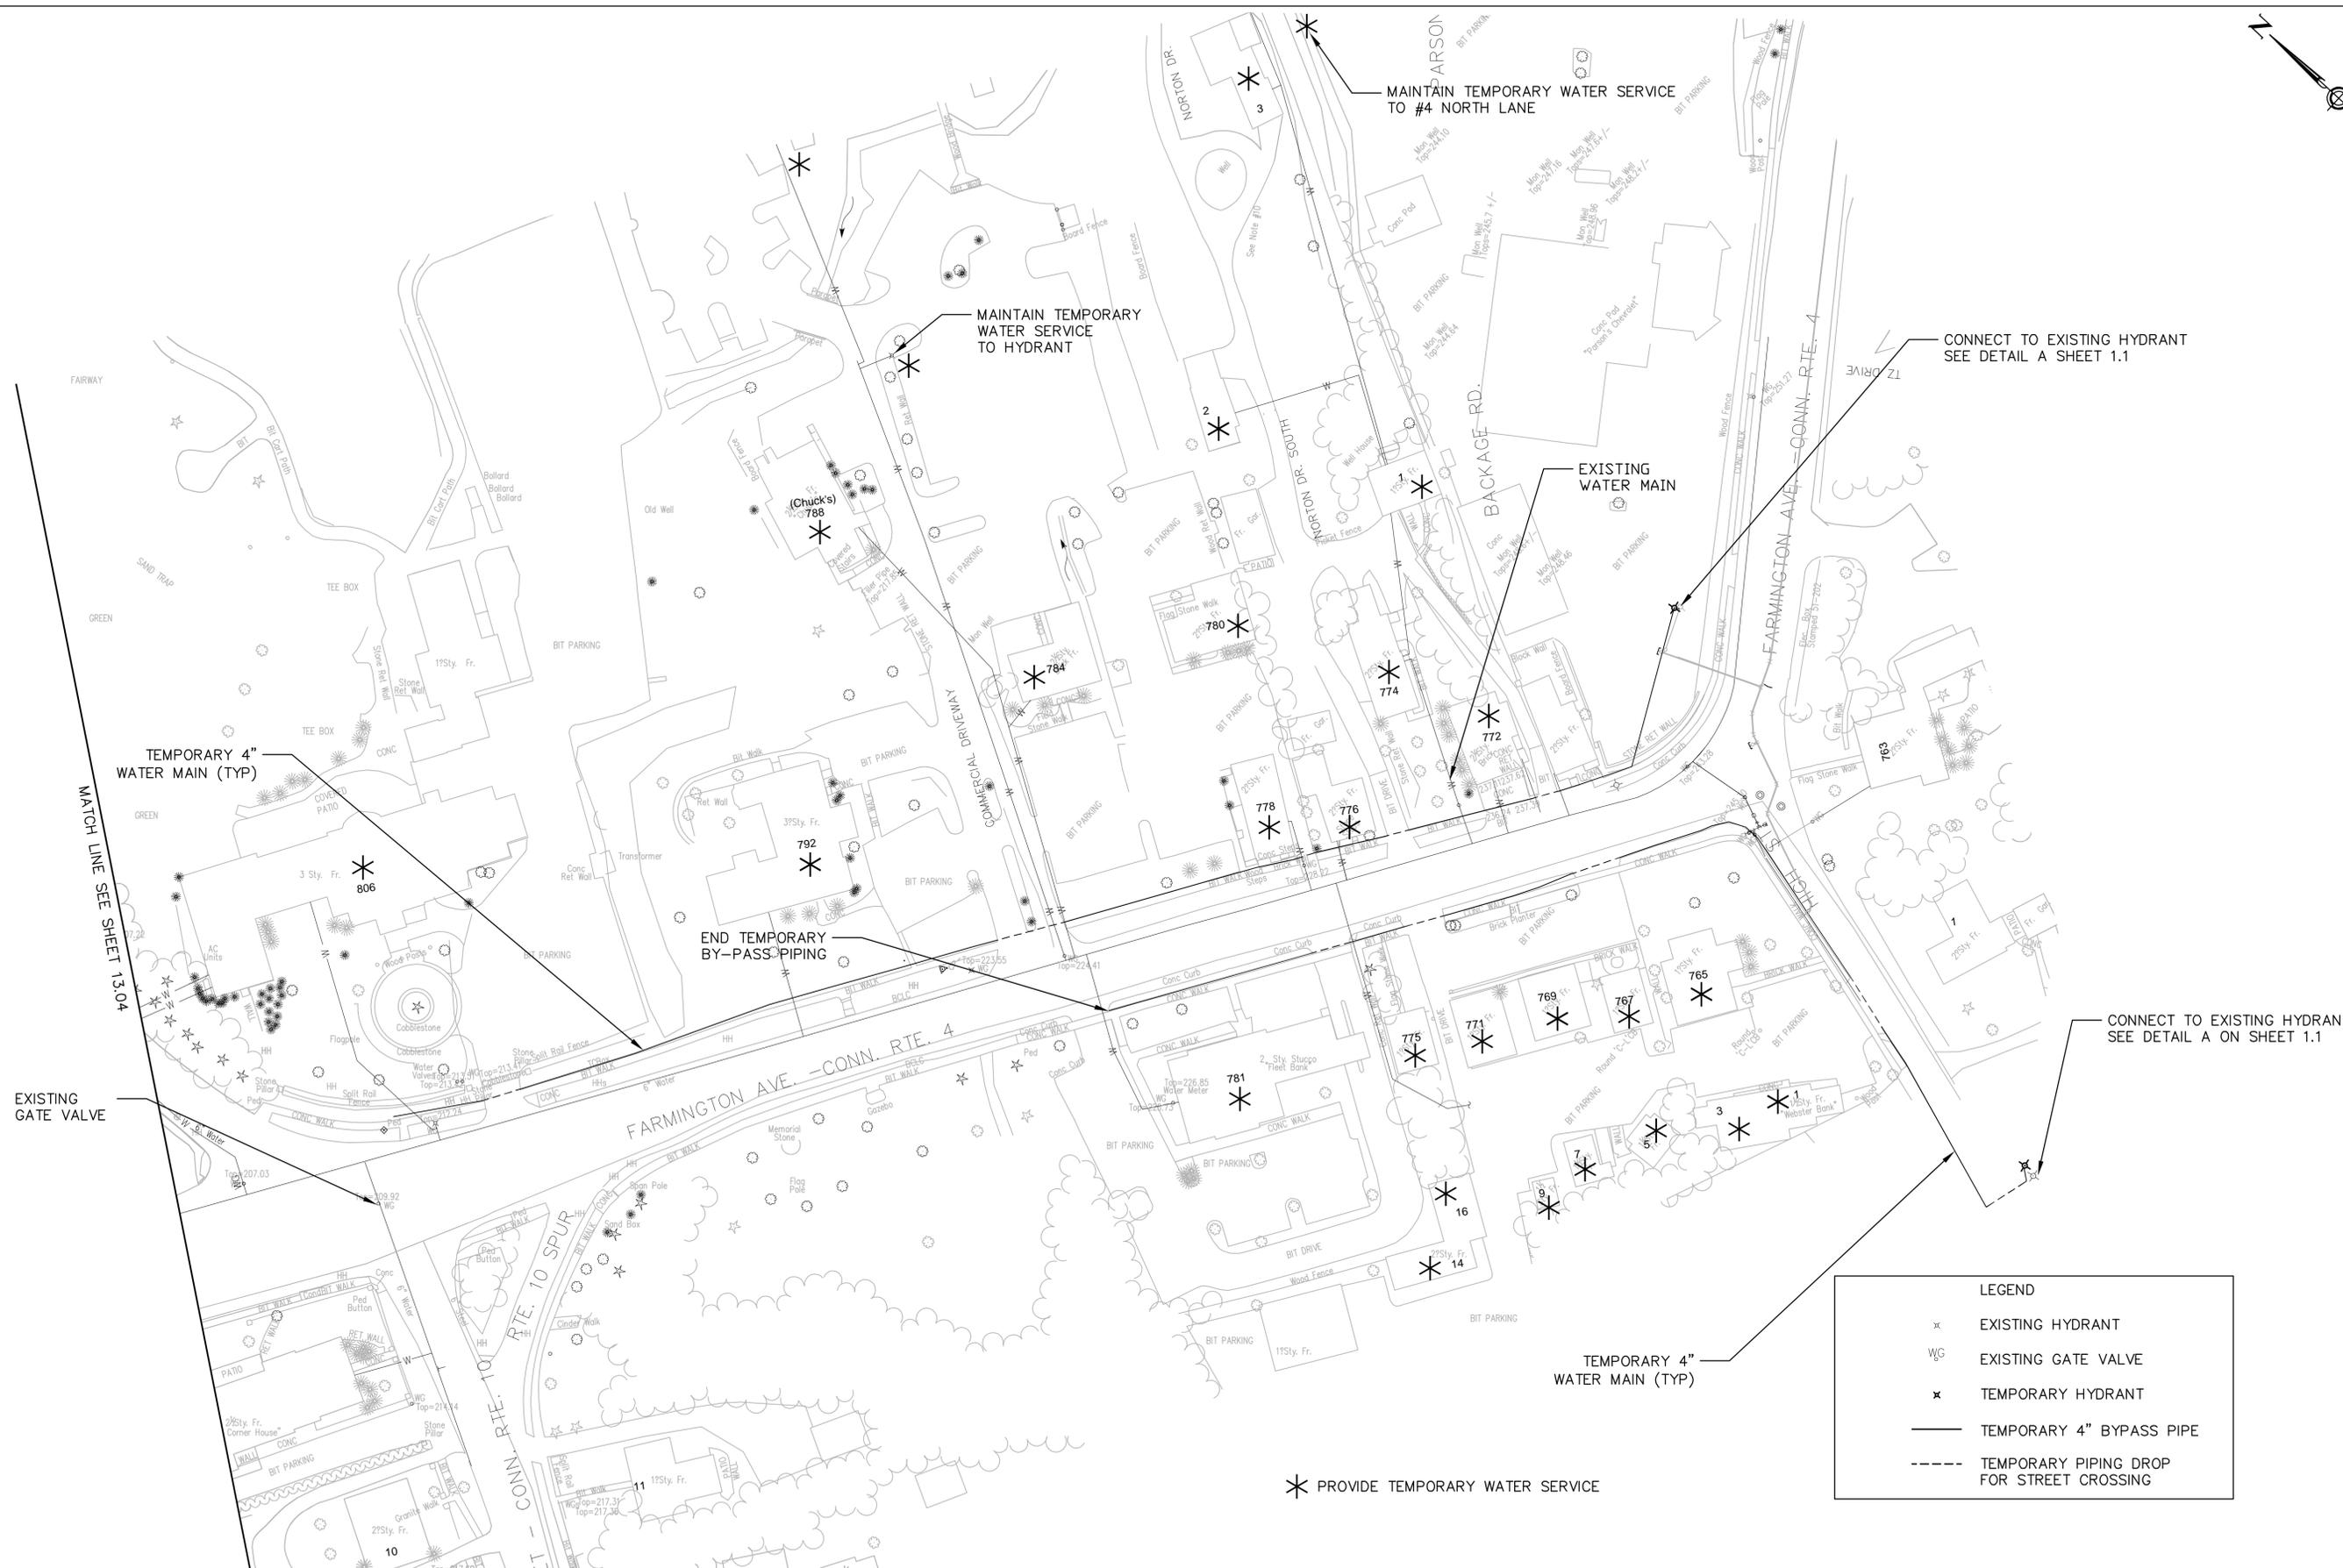

EXISTING GATE VALVE

END TEMPORARY BY-PASS PIPING

MAINTAIN TEMPORARY WATER SERVICE TO #4 NORTH LANE

MAINTAIN TEMPORARY WATER SERVICE TO HYDRANT

CONNECT TO EXISTING HYDRANT SEE DETAIL A SHEET 1.1

EXISTING WATER MAIN

CONNECT TO EXISTING HYDRANT SEE DETAIL A ON SHEET 1.1

TEMPORARY 4" WATER MAIN (TYP)

\* PROVIDE TEMPORARY WATER SERVICE

LEGEND	
x	EXISTING HYDRANT
WG	EXISTING GATE VALVE
x	TEMPORARY HYDRANT
—	TEMPORARY 4" BYPASS PIPE
- - -	TEMPORARY PIPING DROP FOR STREET CROSSING

REV.	DATE	REVISION DESCRIPTION	SHEET NO.

Plotted Date: 05-07-2015

DESIGNER/DRAFTER:  
CHECKED BY:  
SCALE IN FEET  
0 40 80  
SCALE 1" = 40'

DESIGNED BY:  
**AECOM**  
500 ENTERPRISE DRIVE  
ROCKY HILL, CT 06067  
1-(860)-529-8882




**ConnecticutWater**  
93 WEST MAIN STREET  
CLINTON, CT 06413  
www.ctwater.com

PROJECT TITLE:  
**WATER MAIN REPLACEMENT  
ON ROUTE 4 (FARMINGTON AVE) FROM  
GARDEN ST. TO HIGH ST.**

TOWN:  
**FARMINGTON**  
DRAWING TITLE:  
**TEMPORARY BYPASS PIPING  
PLAN SHEET**


PROJECT NO.  
**51-260**  
DRAWING NO.  
**WTR-05**  
SHEET NO.  
**13.05**

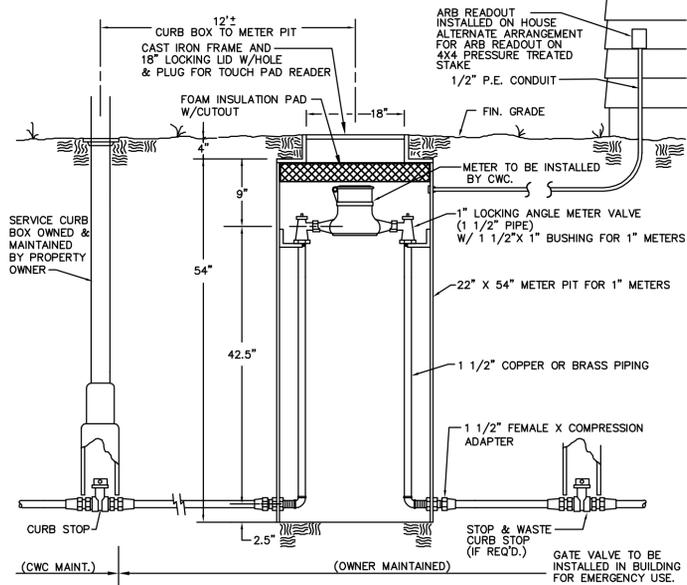

NOTE:  
METER PITS TO BE INSTALLED ON SERVICE LINES LONGER THAN 150' OR IN SPECIAL INSTALLATIONS.


NOTE:  
THIS DRAWING REPLACES AMD-66

**STANDARD METER PIT INSTALLATION FOR 1" METER**

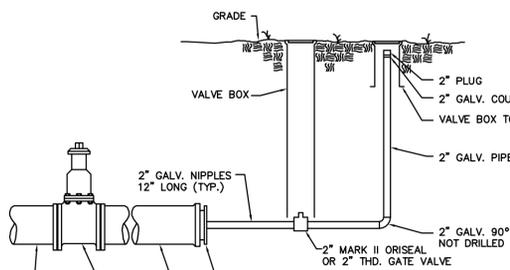


NOTES:  
1) IF BLOW-OFF IS NOT REQUIRED, STANDARD PUSH IN PLUG OR CAP CAN BE INSTALLED WITH A THRUST BLOCK.  
2) VALVE BOX AT BLOW-OFF VALVE CAN BE REPLACED WITH A CURB BOX AT THE INSPECTORS OPTION.  
3) NO SERVICE CONNECTIONS BETWEEN LINE VALVE AND BLOW-OFF ASSEMBLY.


**4" - 12" WATER MAIN DEAD END BLOW-OFF DETAIL**

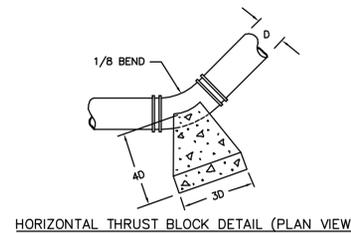

HORIZONTAL THRUST BLOCK DETAIL (PLAN VIEW)

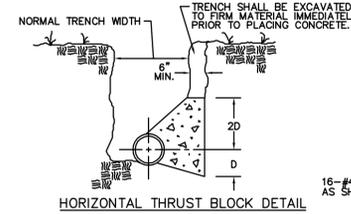


HORIZONTAL THRUST BLOCK DETAIL




VERTICAL THRUST BLOCK DETAIL

NOTES:  
1) 3000 PSI CONCRETE TO BE USED FOR THRUST BLOCKS.  
2) D-DIAMETER OF WATER MAIN.

**THRUST BLOCK DETAILS**




TOWN ROADS ASPHALT

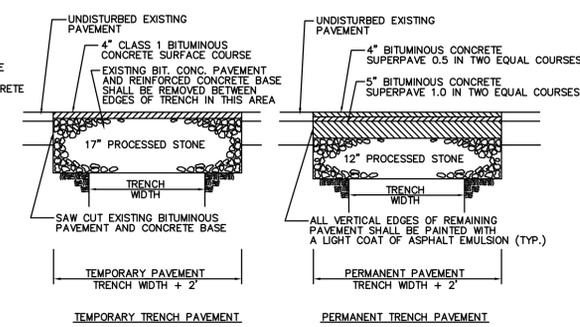


STATE ROADS ASPHALT

NOTES:  
1) DETAIL VARIES DUE TO INDIVIDUAL TOWN SPECIFICATIONS. DIMENSIONS MAY BE ALTERED DUE TO SPECIFIC REQUIREMENTS OF TOWN IN WHICH PROJECT IS LOCATED.  
2) PROCESSED STONE TO BE PER D.O.T. SPECIFICATIONS 3.04.03 & M.05.01.  
3) BITUMINOUS CONCRETE PAVEMENT TO BE PER D.O.T. SPECIFICATIONS 4.06 & M.04.  
4) SPECIFICATION SECTIONS REFER TO D.O.T. STANDARD SPECIFICATION FORM 816.

**PAVEMENT DETAILS STATE AND TOWN ROADS**

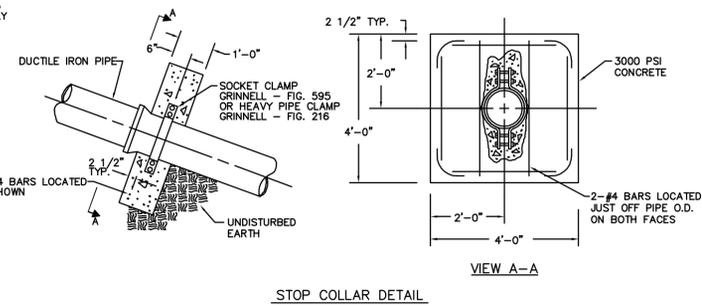


STOP COLLAR DETAIL

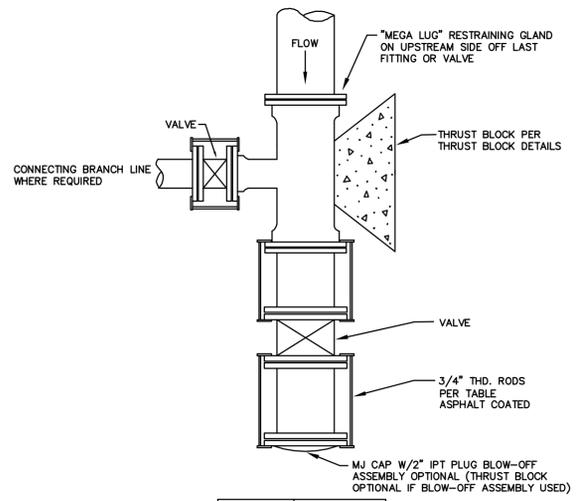


DEAD END AND VALVE RESTRAINED CONNECTIONS DETAIL

PIPE SIZE	No. TIE RODS FOR 125 PSI
6"	2
8"	2
12"	4
16"	6
20"	8
24"	12

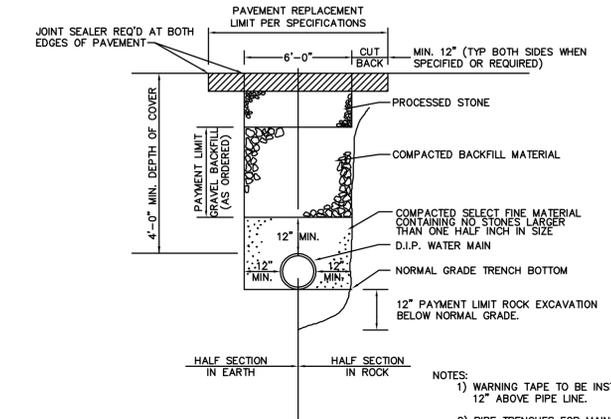


WATER MAIN INSTALLATION DETAIL & PAYMENT LIMITS

NOTES:  
1) WARNING TAPE TO BE INSTALLED A MIN. OF 12" ABOVE PIPE LINE.  
2) PIPE TRENCHES FOR MAINS ABOVE 12" DIA. WILL EXCEED 5 FT. TOTAL DEPTH. ADDITIONAL DEPTH TO MAINTAIN COVER WILL BE PAID FOR PER THE SPECIFICATIONS.

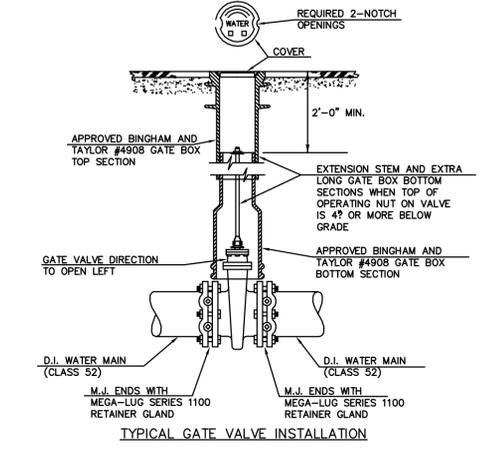

TYPICAL GATE VALVE INSTALLATION 12" & SMALLER SCALE: NTS

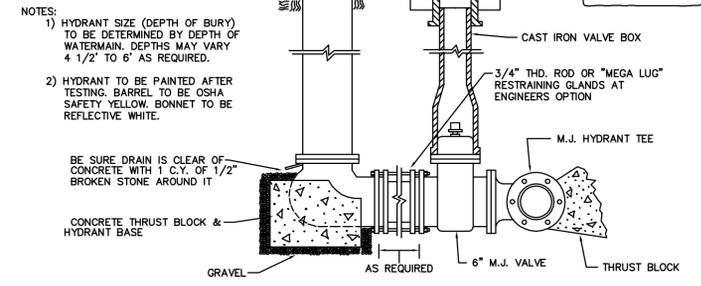

HYDRANT INSTALLATION DETAIL

NOTES:  
1) HYDRANT SIZE (DEPTH OF BURY) TO BE DETERMINED BY DEPTH OF WATERMAIN. DEPTHS MAY VARY 4 1/2' TO 6' AS REQUIRED.  
2) HYDRANT TO BE PAINTED AFTER TESTING. BARREL TO BE OSHA SAFETY YELLOW. BONNET TO BE REFLECTIVE WHITE.

REV.	DATE	REVISION DESCRIPTION	SHEET NO.

DESIGNER/DRAFTER:  
CHECKED BY:


DESIGNED BY:  
**AECOM**  
500 ENTERPRISE DRIVE  
ROCKY HILL, CT 06067  
1-(860)-529-8882



PROJECT TITLE:  
**WATER MAIN REPLACEMENT ON ROUTE 4 (FARMINGTON AVE) FROM GARDEN ST. TO HIGH ST.**

TOWN:  
**FARMINGTON**  
DRAWING TITLE:  
**WATER MAIN DETAILS SHEET**

PROJECT NO.  
**51-260**  
DRAWING NO.  
**WTR-06**  
SHEET NO.  
**13.06**

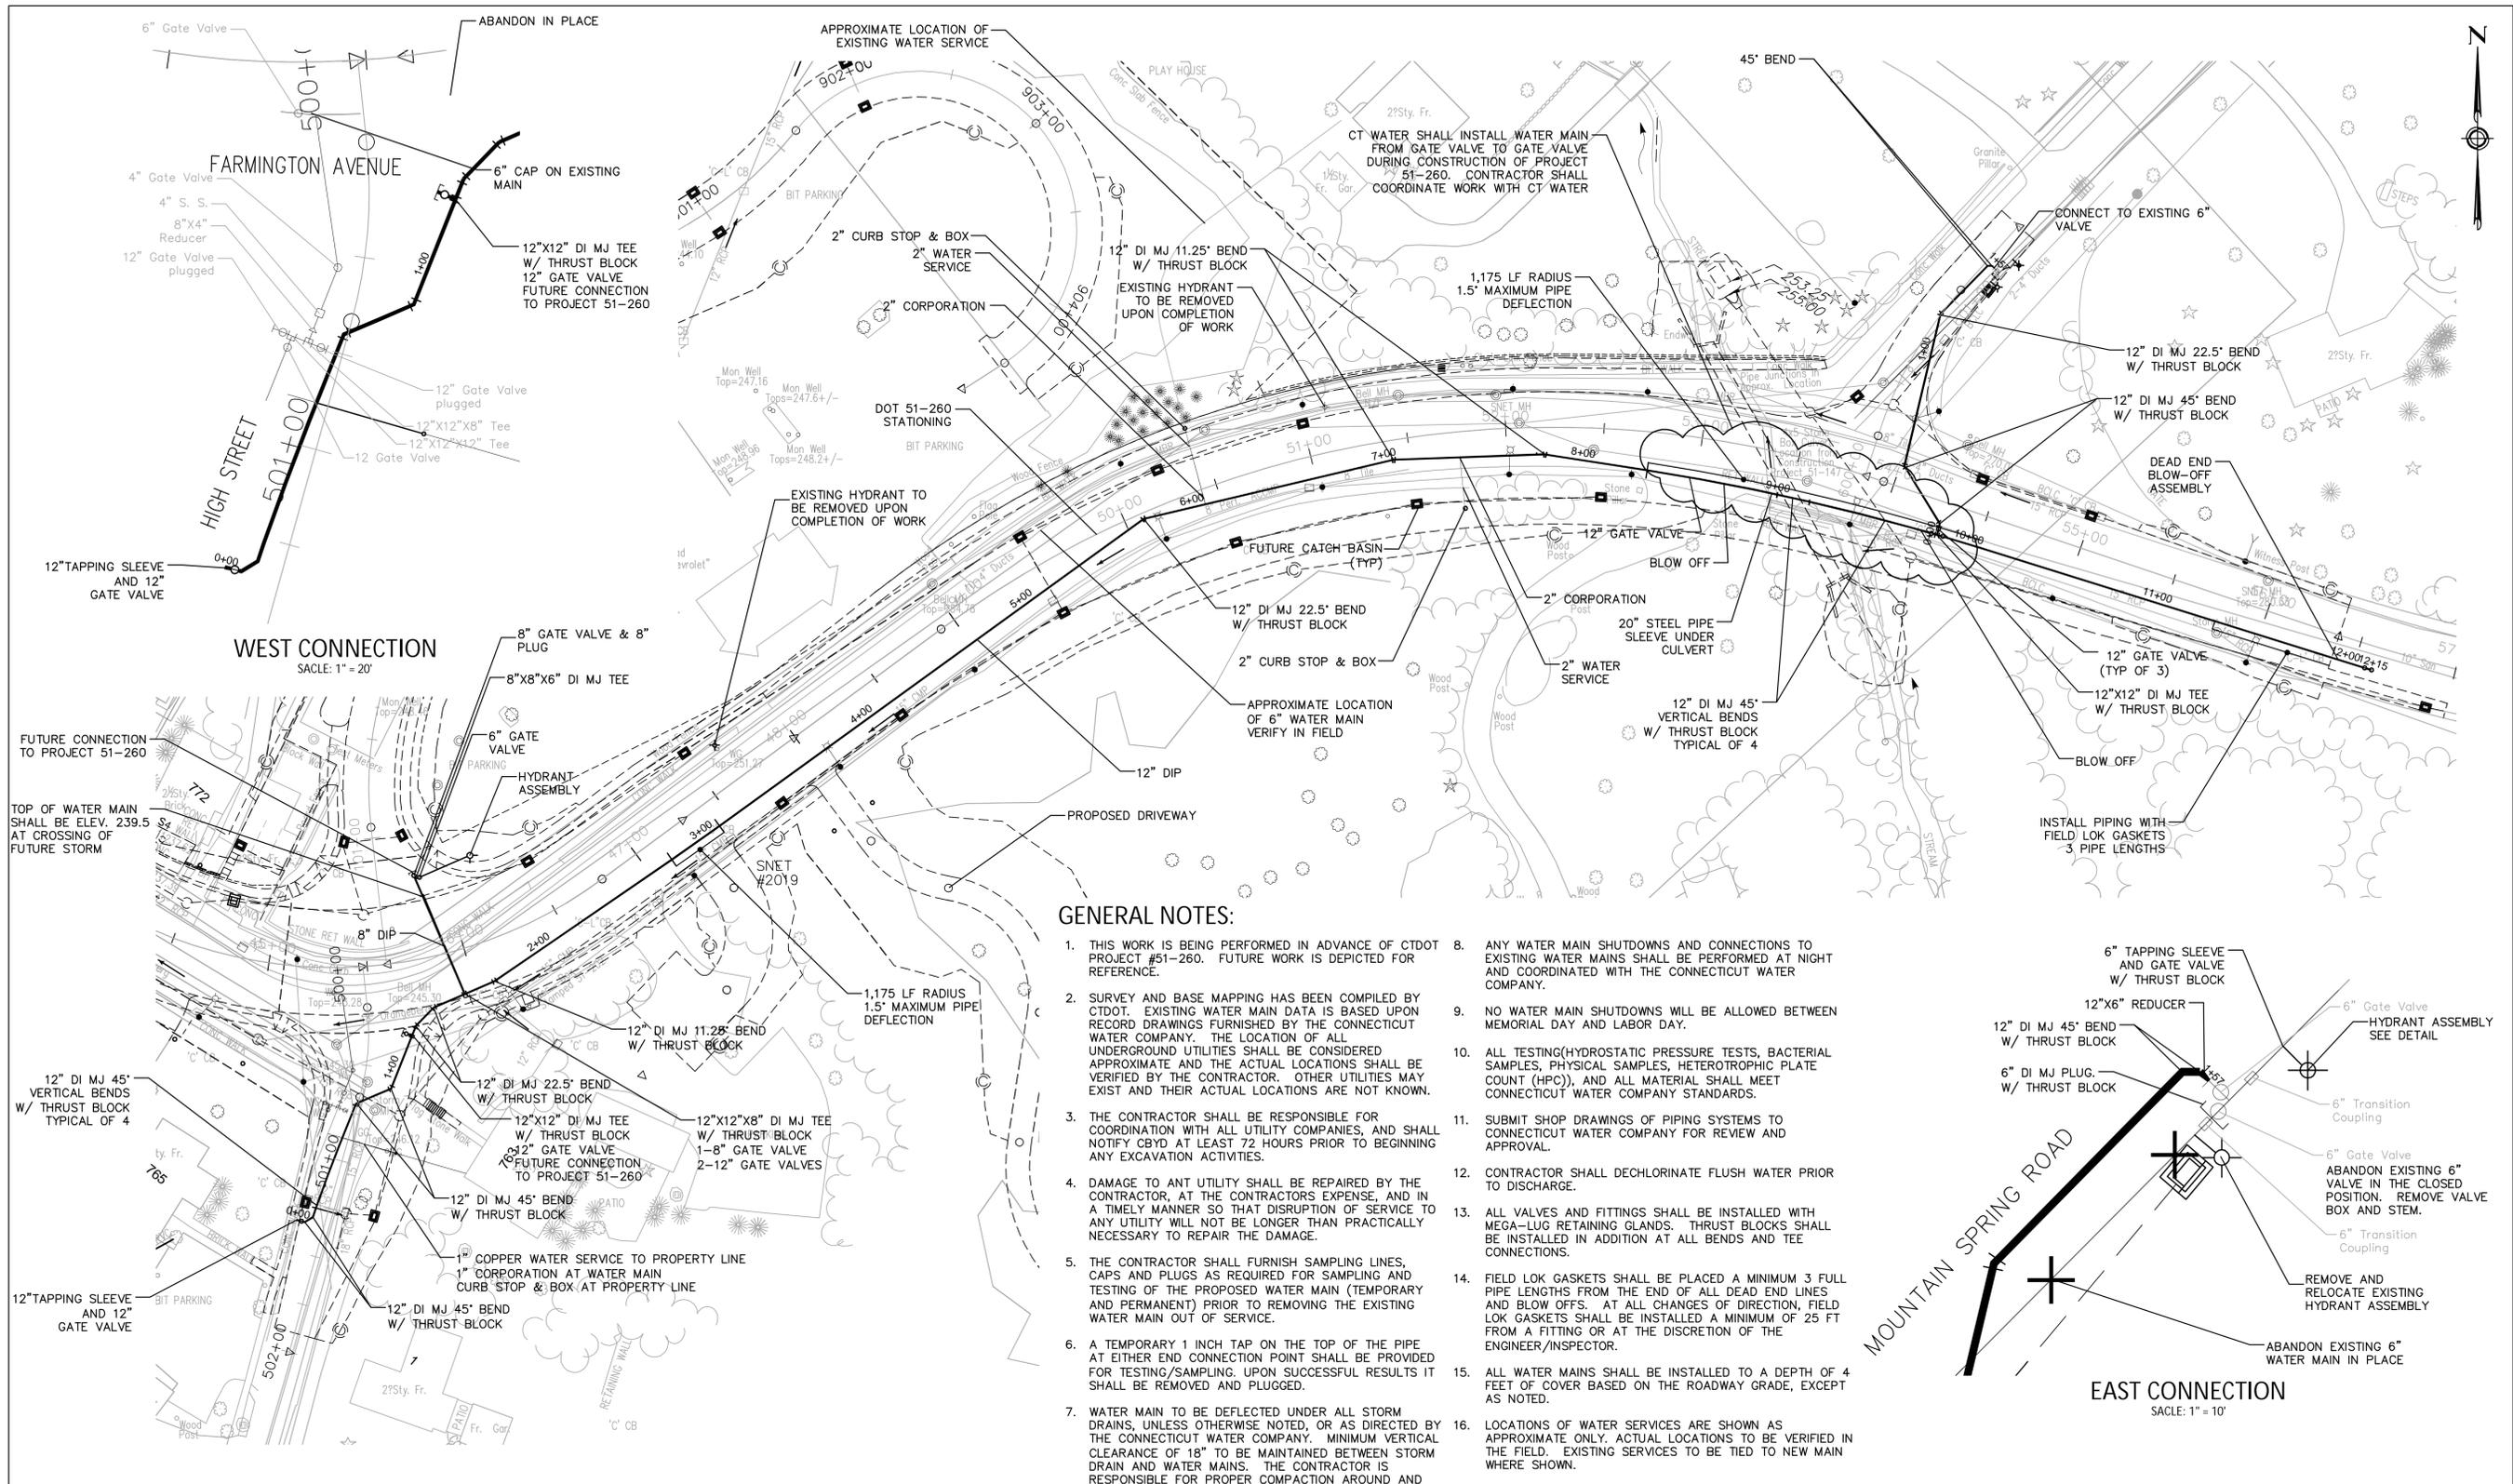

**GENERAL NOTES:**

1. THIS WORK IS BEING PERFORMED IN ADVANCE OF CTDOT PROJECT #51-260. FUTURE WORK IS DEPICTED FOR REFERENCE.
2. SURVEY AND BASE MAPPING HAS BEEN COMPILED BY CTDOT. EXISTING WATER MAIN DATA IS BASED UPON RECORD DRAWINGS FURNISHED BY THE CONNECTICUT WATER COMPANY. THE LOCATION OF ALL UNDERGROUND UTILITIES SHALL BE CONSIDERED APPROXIMATE AND THE ACTUAL LOCATIONS SHALL BE VERIFIED BY THE CONTRACTOR. OTHER UTILITIES MAY EXIST AND THEIR ACTUAL LOCATIONS ARE NOT KNOWN.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION WITH ALL UTILITY COMPANIES, AND SHALL NOTIFY CBYD AT LEAST 72 HOURS PRIOR TO BEGINNING ANY EXCAVATION ACTIVITIES.
4. DAMAGE TO ANT UTILITY SHALL BE REPAIRED BY THE CONTRACTOR, AT THE CONTRACTORS EXPENSE, AND IN A TIMELY MANNER SO THAT DISRUPTION OF SERVICE TO ANY UTILITY WILL NOT BE LONGER THAN PRACTICALLY NECESSARY TO REPAIR THE DAMAGE.
5. THE CONTRACTOR SHALL FURNISH SAMPLING LINES, CAPS AND PLUGS AS REQUIRED FOR SAMPLING AND TESTING OF THE PROPOSED WATER MAIN (TEMPORARY AND PERMANENT) PRIOR TO REMOVING THE EXISTING WATER MAIN OUT OF SERVICE.
6. A TEMPORARY 1 INCH TAP ON THE TOP OF THE PIPE AT EITHER END CONNECTION POINT SHALL BE PROVIDED FOR TESTING/SAMPLING. UPON SUCCESSFUL RESULTS IT SHALL BE REMOVED AND PLUGGED.
7. WATER MAIN TO BE DEFLECTED UNDER ALL STORM DRAINS, UNLESS OTHERWISE NOTED, OR AS DIRECTED BY THE CONNECTICUT WATER COMPANY. MINIMUM VERTICAL CLEARANCE OF 18\"/>
- 8. ANY WATER MAIN SHUTDOWNS AND CONNECTIONS TO EXISTING WATER MAINS SHALL BE PERFORMED AT NIGHT AND COORDINATED WITH THE CONNECTICUT WATER COMPANY.
- 9. NO WATER MAIN SHUTDOWNS WILL BE ALLOWED BETWEEN MEMORIAL DAY AND LABOR DAY.
- 10. ALL TESTING (HYDROSTATIC PRESSURE TESTS, BACTERIAL SAMPLES, PHYSICAL SAMPLES, HETEROTROPHIC PLATE COUNT (HPC)), AND ALL MATERIAL SHALL MEET CONNECTICUT WATER COMPANY STANDARDS.
- 11. SUBMIT SHOP DRAWINGS OF PIPING SYSTEMS TO CONNECTICUT WATER COMPANY FOR REVIEW AND APPROVAL.
- 12. CONTRACTOR SHALL DECHLORINATE FLUSH WATER PRIOR TO DISCHARGE.
- 13. ALL VALVES AND FITTINGS SHALL BE INSTALLED WITH MEGA-LUG RETAINING GLANDS. THRUST BLOCKS SHALL BE INSTALLED IN ADDITION AT ALL BENDS AND TEE CONNECTIONS.
- 14. FIELD LOK GASKETS SHALL BE PLACED A MINIMUM 3 FULL PIPE LENGTHS FROM THE END OF ALL DEAD END LINES AND BLOW OFF'S. AT ALL CHANGES OF DIRECTION, FIELD LOK GASKETS SHALL BE INSTALLED A MINIMUM OF 25 FT FROM A FITTING OR AT THE DISCRETION OF THE ENGINEER/INSPECTOR.
- 15. ALL WATER MAINS SHALL BE INSTALLED TO A DEPTH OF 4 FEET OF COVER BASED ON THE ROADWAY GRADE, EXCEPT AS NOTED.
- 16. LOCATIONS OF WATER SERVICES ARE SHOWN AS APPROXIMATE ONLY. ACTUAL LOCATIONS TO BE VERIFIED IN THE FIELD. EXISTING SERVICES TO BE TIED TO NEW MAIN WHERE SHOWN.

REV.	DATE	REVISION DESCRIPTION	SHEET NO.

THE INFORMATION, INCLUDING ESTIMATED QUANTITIES OF WORK, SHOWN ON THESE SHEETS IS BASED ON LIMITED INVESTIGATIONS BY THE STATE AND IS IN NO WAY WARRANTED TO INDICATE THE CONDITIONS OF ACTUAL QUANTITIES OF WORK WHICH WILL BE REQUIRED.

DESIGNER/DRAFTER: **KJM**  
 CHECKED BY: **RGT**  
 SCALE IN FEET  
 0 40 80  
 SCALE 1" = 40'

DESIGNED BY:  
**AECOM**  
 500 ENTERPRISE DRIVE  
 ROCKY HILL, CT 06067  
 1-(860)-529-8882



**ConnecticutWater**  
 93 WEST MAIN STREET  
 CLINTON, CT 06413  
 www.ctwater.com

PROJECT TITLE:  
**WATER MAIN REPLACEMENT  
 ON ROUTE 4 (FARMINGTON AVE) FROM  
 HIGH ST. TO MOUNTAIN SPRING RD.**

FOR INFORMATION ONLY	
TOWN: <b>FARMINGTON</b>	PROJECT NO. <b>51-260</b>
DRAWING TITLE: <b>WATER MAIN PLAN SHEET</b>	DRAWING NO. <b>WTR-07</b>
	SHEET NO. <b>13.07</b>