

REMOVE 2000 GALLON FUEL OIL UNDERGROUND STORAGE TANK, ALL ASSOCIATED ACCESSORIES, AND CONCRETE SLAB AT GRADE (CONCRETE SLAB REMOVAL TO BE PAID UNDER EARTH EXCAVATION)

REMOVE FUEL OIL PIPING WITHIN PVC ACCESS CONDUIT FROM TANK TO MECHANICAL ROOM. REFER TO M-002 FOR REMOVAL OF FUEL OIL PIPING IN MECHANICAL ROOM. CUT PVC ACCESS CONDUIT WITHIN EXCAVATION LIMITS OF TANK REMOVAL. CUT PVC ACCESS CONDUIT AT TOP OF SLAB WITHIN MECHANICAL ROOM SLAB AND FILL WITH GROUT.

4000 GALLON WASTE WATER HOLDING TANK TO REMAIN

REMOVE FUEL ISLAND, DISPENSERS, PRODUCT PIPING, VENT PIPING, VENT RISERS, LIGHT POLE, LIGHT FIXTURES AND BOLLARDS. REMOVE AND SALVAGE FUEL MANAGEMENT UNIT.

REMOVE CONCRETE APRON (PAID UNDER EARTH EXCAVATION)

REMOVE 4000 GALLON DIESEL FUEL UNDERGROUND STORAGE TANK, ALL ASSOCIATED ACCESSORIES, AND CONCRETE SLAB AT GRADE. SALVAGE PUMP AND DROP TUBE. (CONCRETE SLAB REMOVAL TO BE PAID UNDER EARTH EXCAVATION)

REMOVE 4000 GALLON UNLEADED GASOLINE UNDERGROUND STORAGE TANK, ALL ASSOCIATED ACCESSORIES, AND CONCRETE SLAB AT GRADE. SALVAGE PUMP AND DROP TUBE. (CONCRETE SLAB REMOVAL TO BE PAID UNDER EARTH EXCAVATION)

REV.	DATE	REVISION DESCRIPTION	SHEET NO.


THE INFORMATION, INCLUDING ESTIMATED QUANTITIES OF WORK, SHOWN ON THESE SHEETS IS BASED ON LIMITED INVESTIGATIONS BY THE STATE AND IS IN NO WAY WARRANTED TO INDICATE THE CONDITIONS OF ACTUAL QUANTITIES OF WORK WHICH WILL BE REQUIRED.

Plotted Date: 1/18/2013

DESIGNER/DRAFTER:
JSB

CHECKED BY:
JWW

SCALE IN FEET
0 20 40
SCALE 1"=20'

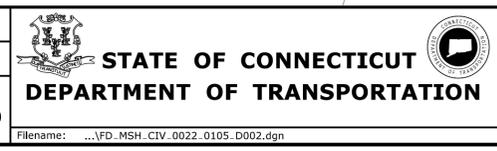

SIGNATURE/
BLOCK:
[Signature]

OFFICE OF ENGINEERING

APPROVED BY:

PROJECT TITLE:
CANTERBURY MAINTENANCE FACILITY TANK REPLACEMENT

TOWN:
CANTERBURY

DRAWING TITLE:
SITE DEMOLITION PLAN

PROJECT NO.
22-105

DRAWING NO.
D-002

SHEET NO.
04.02



REMOVE ALL CONDUCTORS ASSOCIATED WITH FUEL OIL TANK MONITORING SENSORS, REMOVE CONDUITS ABOVE GRADE, ABANDON CONDUITS IN PLACE BELOW GRADE AND REMOVE IF NECESSARY

REMOVE AND SALVAGE IN-TANK PROBE FOR FUEL OIL TANK


ALL CONDUITS ASSOCIATED WITH WASTE WATER HOLDING TANK MONITORING SENSORS TO REMAIN, REMOVE CONDUCTORS AND EXPLOSION PROOF FITTINGS AS NECESSARY

REMOVE AND SALVAGE WASTE WATER HOLDING TANK IN-TANK PROBE AND HYDROSTATIC SENSOR

REMOVE AND SALVAGE IN-TANK PROBE FOR DIESEL TANK

REMOVE AND SALVAGE IN-TANK PROBE FOR UNLEADED TANK

REMOVE ALL CONDUCTORS BETWEEN FUEL CONTROL CENTER AND FUEL TANKS/FUEL ISLAND, REMOVE CONDUITS ABOVE GRADE, ABANDON CONDUITS IN PLACE BELOW GRADE AND REMOVE IF NECESSARY

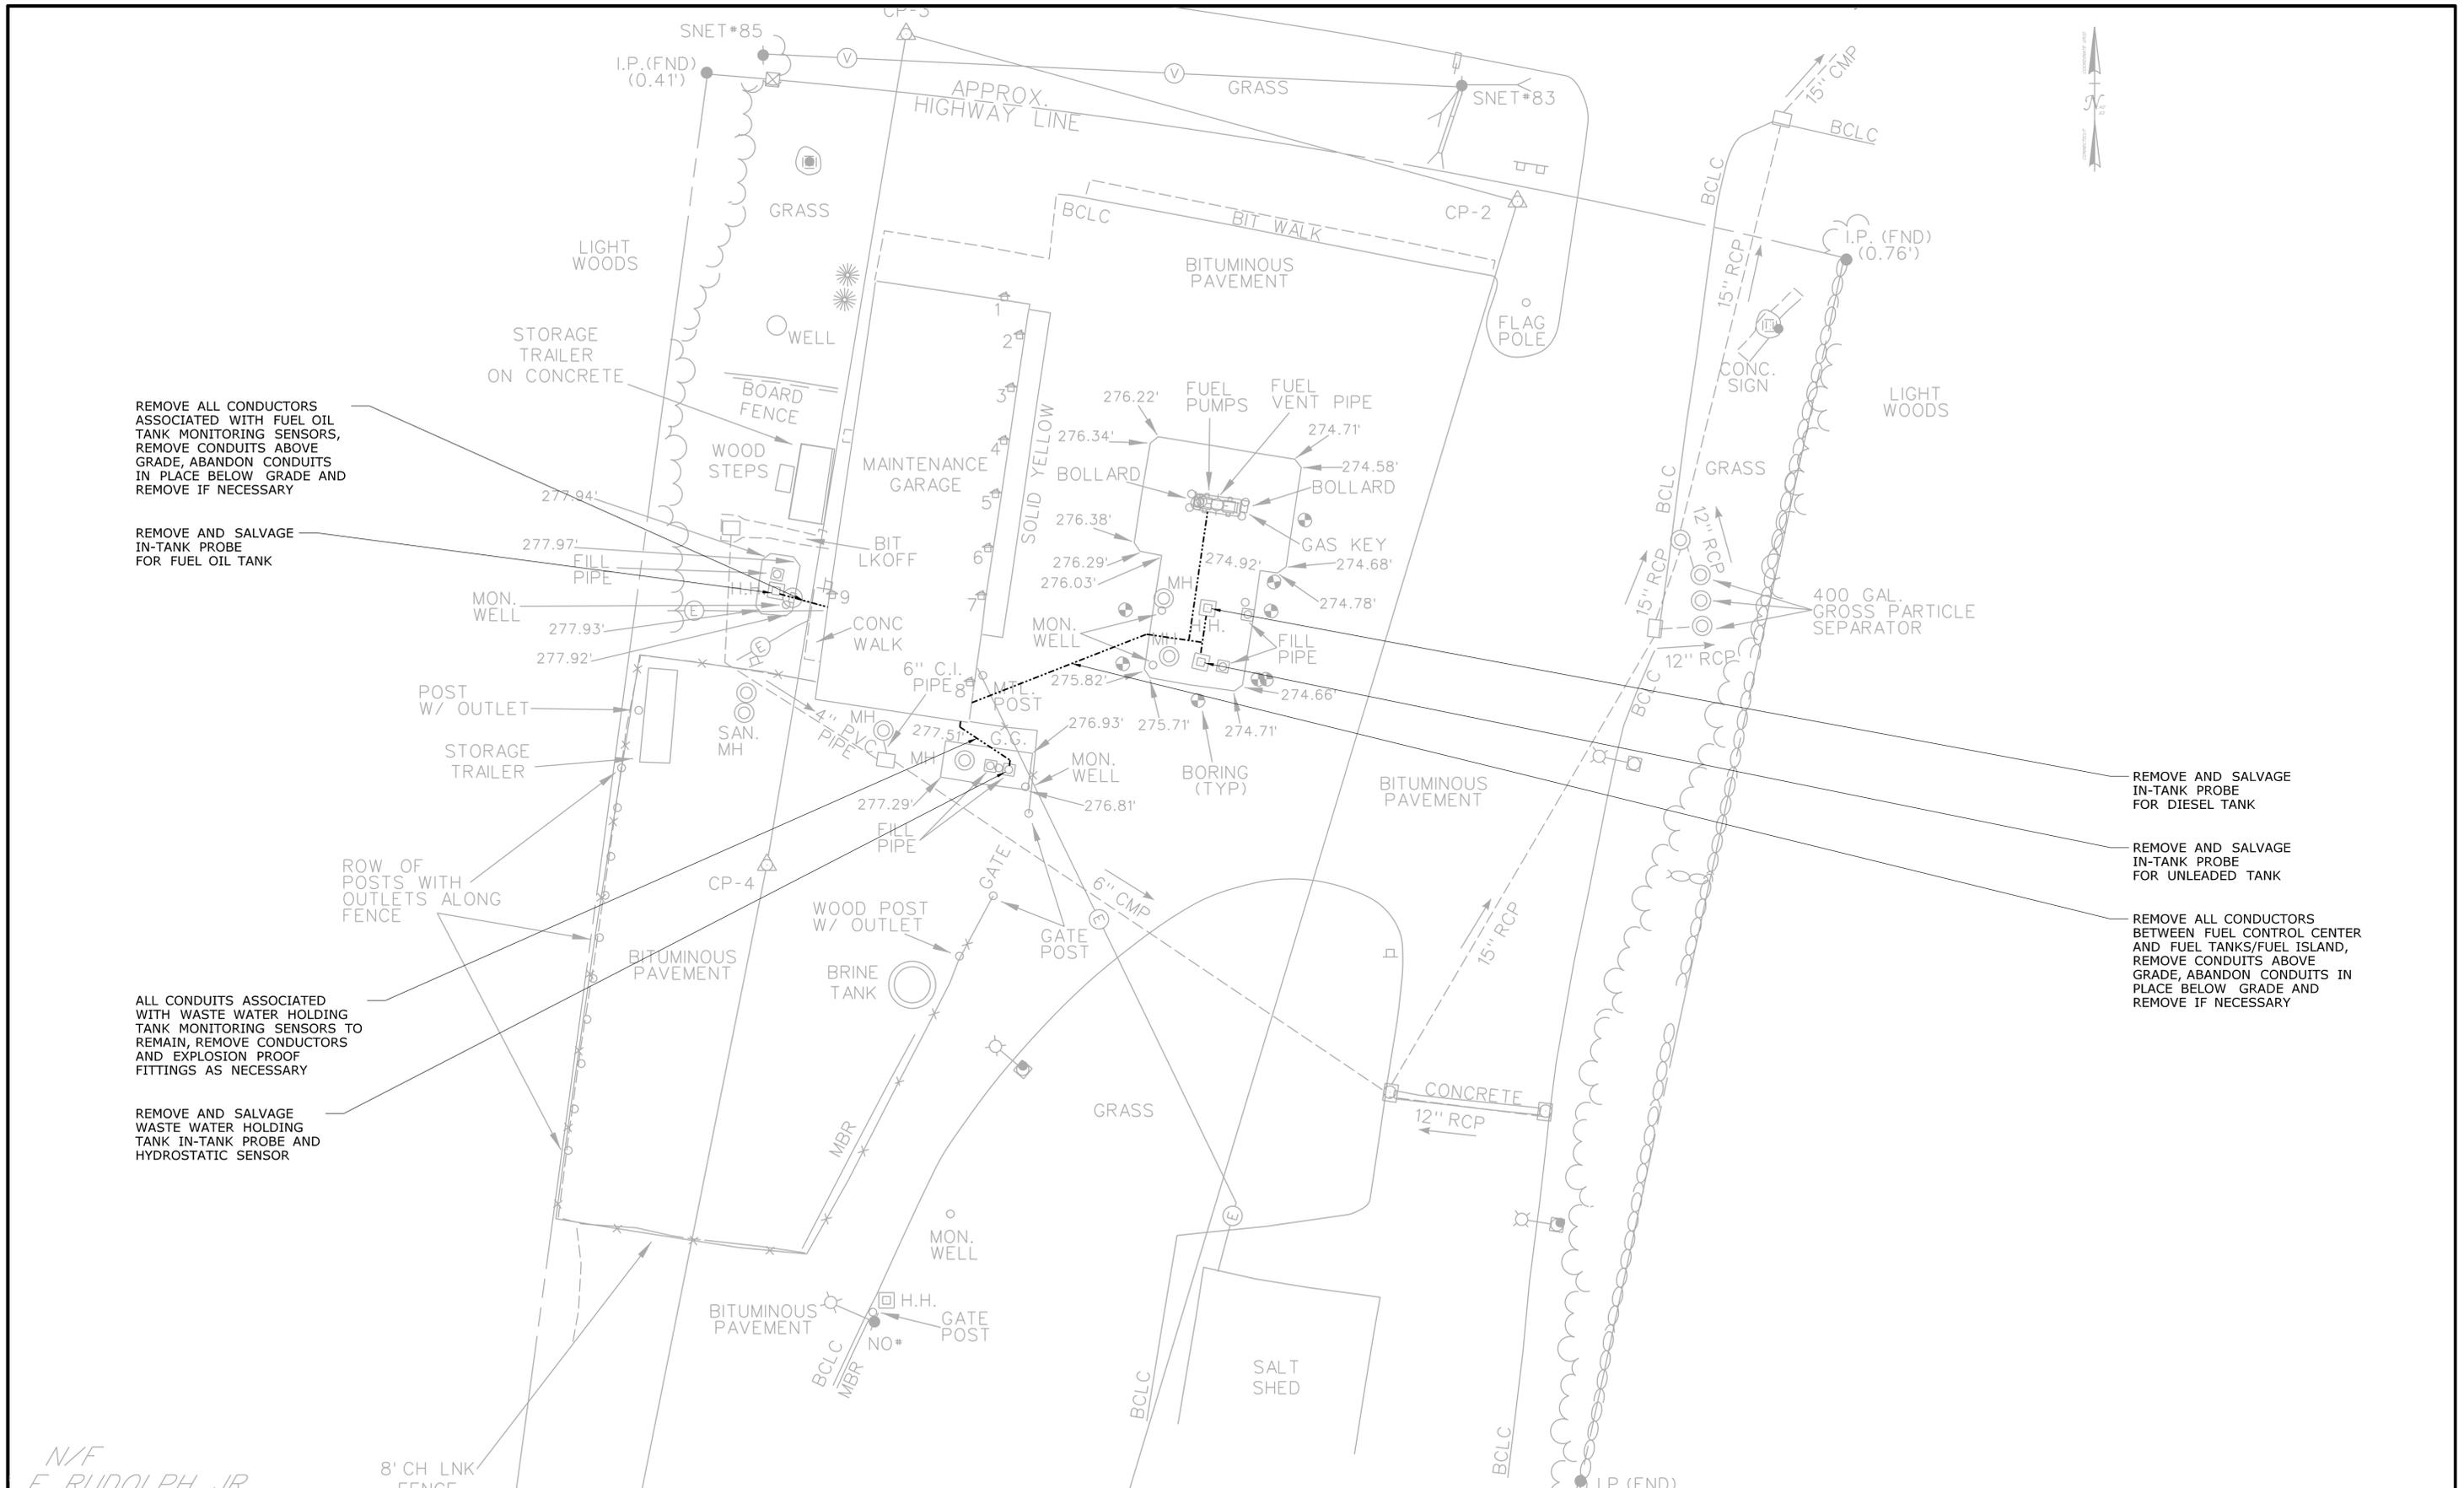

N/F
F. RUDOLPH, JR.

REV.	DATE	REVISION DESCRIPTION	SHEET NO.


THE INFORMATION, INCLUDING ESTIMATED QUANTITIES OF WORK, SHOWN ON THESE SHEETS IS BASED ON LIMITED INVESTIGATIONS BY THE STATE AND IS IN NO WAY WARRANTED TO INDICATE THE CONDITIONS OF ACTUAL QUANTITIES OF WORK WHICH WILL BE REQUIRED.

Plotted Date: 1/18/2013

DESIGNER/DRAFTER:
JSB

CHECKED BY:
JWW

SCALE IN FEET
0 20 40
SCALE 1"=20'

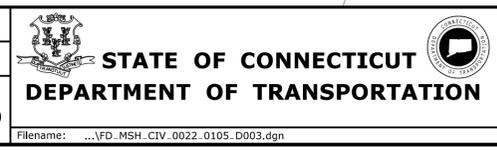

SIGNATURE/
BLOCK:
[Signature]

OFFICE OF ENGINEERING

APPROVED BY:

PROJECT TITLE:
**CANTERBURY MAINTENANCE FACILITY
TANK REPLACEMENT**

TOWN:
CANTERBURY

DRAWING TITLE:
TANK MONITORING DEMOLITION PLAN

PROJECT NO.
22-105

DRAWING NO.
D-003

SHEET NO.
04.03